BROWNING & FARRIS INDUSTRIES

SUBMIT THE FOLLOWING COMPLETED FORM TO YOUR LOCAL PLUMBING INSPECTOR

DATE 12/9/93 NUMBER OF BEDROOMS / Storage Bldg SIZE OF SEPTIC TANK 1000 gal. TYPE OF SOIL Sand	OWNER Browning & Ferris Industries Inc. STREET Bog Road CITY Augusta MAINE TEL. NUMBER 20462
Test Performed by [signature] #1576 Local Plumbing Inspector's Signature [signature]	LOCATION OF PROPOSED INSTALLATION STREET Bog Rd. CITY Augusta MAINE TEL. NUMBER 20462

SKETCH: LOCATION OF BUILDING DISPOSAL SYSTEM, TERRAIN FEATURES, PERCOLATION HOLES, WATER SUPPLIES, ETC.

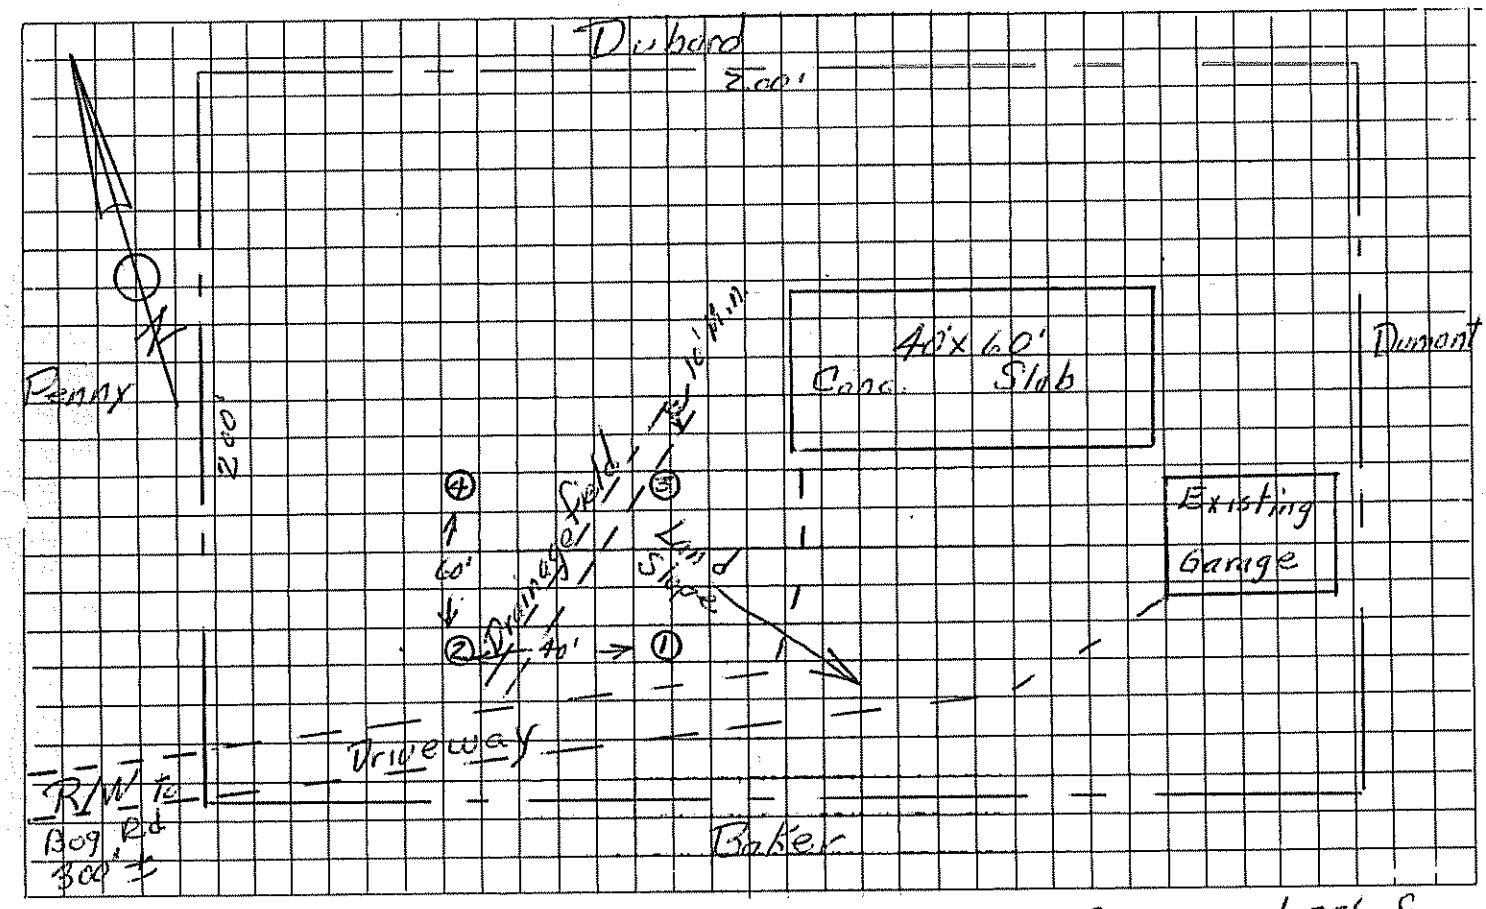

5-7' Depth to Water Table
5'4 Depth to Bedrock
5'4 Depth to Clay or other impervious strata

REMARKS Recommend 2-45' of Absorption trench at Location Shown. 90' Total Well to be Minimum of 100' from System

HOLE	HOLE DEPTH	TIME START	TIME FINISH	DEPTH OF WATER SURFACE START	DEPTH OF WATER SURFACE FINISH	ELAPSED TIME	TOTAL DROP OF WATER	PERCOL. RATE MINUTES/INCH
#1	40 in.	4:11	4:31	19½ in.	36 in.	20 min.	16½ in.	1.2 min/in
#2	36 in.	4:10	4:32	18 in.	35 in.	22 min.	17 in.	1.3 min/in
#3	37 in.	4:13	4:33	15 in.	28 in.	20 min.	13 in.	1.5 min/in
#4	37 in.	4:14	4:33	15 in.	26 in.	19 min.	11 in.	1.7 min/in
						AVERAGE RATE		1.4 min/in