PATTERSON, C. NOV 28 1972

SUBMIT THE FOLLOWING COMPLETED FORM TO YOUR LOCAL PLUMBING INSPECTOR

DATE # 27-72	OWNER R. Gee - C. Patterson
NUMBER OF BEDROOMS 2	STREET
SIZE OF SEPTIC TANK 1000 gal	CITY MAINE
TYPE OF SOIL sand	TEL. NUMBER
Test Performed by [illegible]	LOCATION OF PROPOSED INSTALLATION
	STREET Sanford Rd.
Local Plumbing Inspector's Signature C. F. Morton	CITY Augusta MAINE
	TEL. NUMBER

SKETCH: LOCATION OF BUILDING DISPOSAL SYSTEM, TERRAIN FEATURES, PERCOLATION HOLES, WATER SUPPLIES, ETC.

PERMIT No 118-72

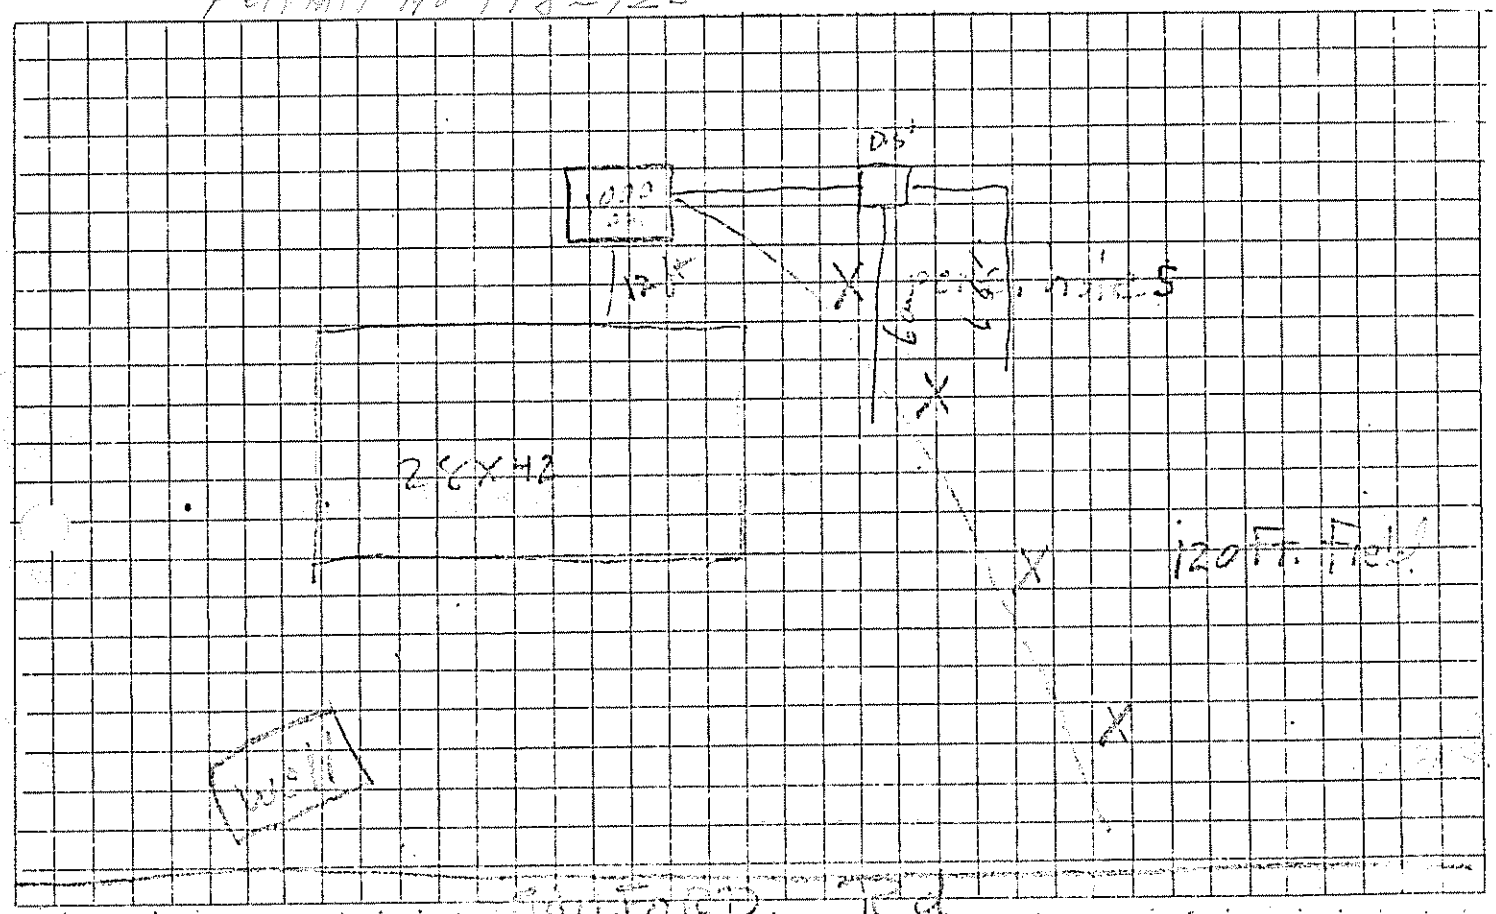

140 Depth to Water Table
130 Depth to Bedrock
NONE Depth to Clay or other impervious strata

REMARKS
Well is 120 Ft. From Field

HOLE	HOLE DEPTH	TIME START	TIME FINISH	DEPTH OF WATER SURFACE START	DEPTH OF WATER SURFACE FINISH	ELAPSED TIME	TOTAL DROP OF WATER	PERCOL. RATE MINUTES/INCH
#1	36" in.	3:05	3:15	12 in.	15 in.	10 min.	3 in.	3 1/3 min/in
#2	36" in.	3:08	3:20	12 in.	14 in.	12 min.	2 in.	6 min/in
#3	36" in.	3:15	3:25	12 in.	15 in.	10 min.	3 in.	3 1/3 min/in
#4	36" in.	3:20	3:35	12 in.	15 in.	15 min.	3 in.	5 min/in
						AVERAGE RATE		4.4 min/in