WESTVILLE DEVELOPMENT #7202

SUBMIT THE FOLLOWING COMPLETED FORM TO YOUR LOCAL PLUMBING INSPECTOR

DATE Sept. 17, 1973
NUMBER OF BEDROOMS Proposed Subdivision
SIZE OF SEPTIC TANK Variable
TYPE OF SOIL Sandy

OWNER Westville Development Corp.
STREET Gould Rd.
CITY Augusta, MAINE
TEL. NUMBER 622-0740

Test Performed by
W. P. Libby R.L.S. #965
Local Plumbing Inspector's Signature
George L. Smith

LOCATION OF PROPOSED INSTALLATION
STREET Gould Rd.
CITY Augusta, MAINE
TEL. NUMBER None

SKETCH: LOCATION OF BUILDING DISPOSAL SYSTEM, TERRAIN FEATURES, PERCOLATION HOLES, WATER SUPPLIES, ETC.

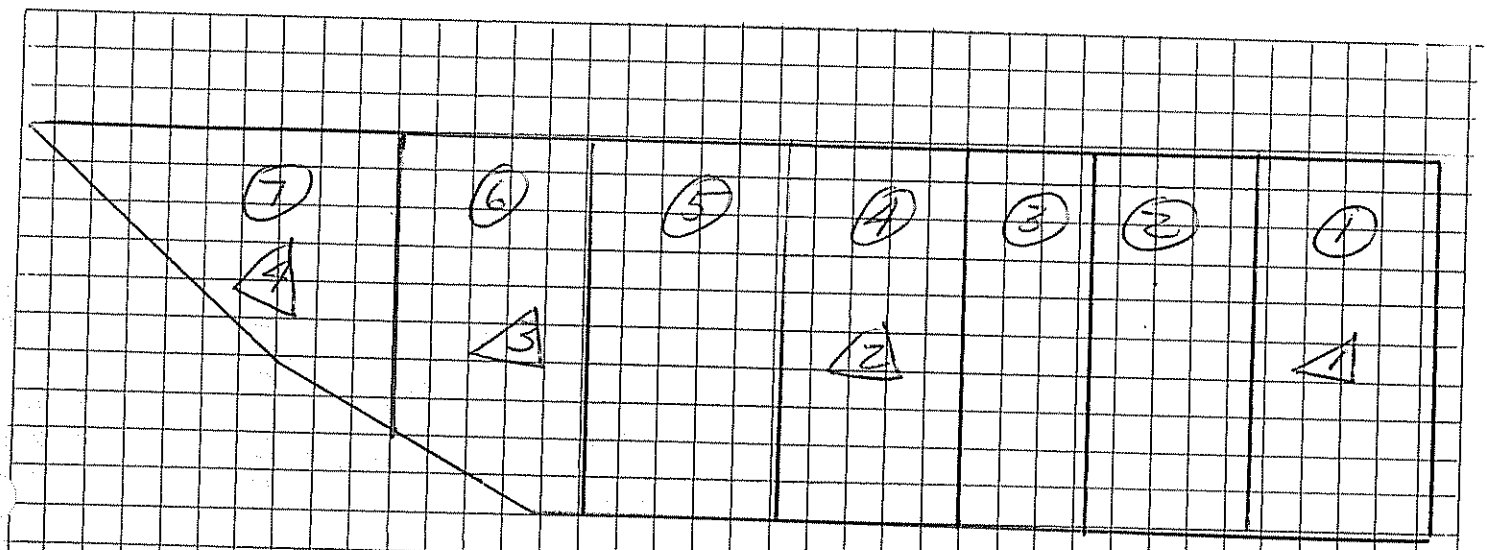


A complete set of "4" tests should be required for each lot before issuing plumbing permit, showing details of each individual proposed installation

Not encountered
" " Depth to Water Table
" " Depth to Bedrock
" " Depth to Clay or other impervious strata

REMARKS
Very fast percolation — Sand — very deep from local sources.

| HOLE | HOLE DEPTH | TIME START | TIME FINISH | DEPTH OF WATER SURFACE START | DEPTH OF WATER SURFACE FINISH | ELAPSED TIME | TOTAL DROP OF WATER | PERCOL. RATE MINUTES/INCH |
|---|---|---|---|---|---|---|---|---|
| #1 | 36 in. | 10:15 | 10:27 | 28 in. | 32 in. | 12 min. | 4 in. | 3.0 min/in |
| #2 | 36 in. | 10:16 | 10:30 | 28 in. | 32 in. | 14 min. | 4 in. | 3.5 min/in |
| #3 | 36 in. | 10:18 | 10:31 | 28 in. | 32 in. | 13 min. | 4 in. | 3.3 min/in |
| #4 | 36 in. | 10:22 | 10:33 | 28 in. | 32 in. | 11 min. | 4 in. | 2.7 min/in |
| | | | | | | AVERAGE RATE | | (NOT APPLICABLE) 3.1 min/in |

WESTVILLE HOMES

# SUBMIT THE FOLLOWING COMPLETED FORM TO YOUR LOCAL PLUMBING INSPECTOR

| | |
|---|---|
| DATE 1-17-73<br>NUMBER OF BEDROOMS Subdivision<br>SIZE OF SEPTIC TANK<br>TYPE OF SOIL Sand | OWNER Westville Homes Corp.<br>STREET Portland<br>CITY Westville, N.H. ~~MAINE~~<br>TEL. NUMBER 603 382-6515 |
| Test ~~Performed~~ by Maxine P. Libby<br>Local Plumbing ~~Inspector's~~ Signature P.O.P. Moulton | LOCATION OF PROPOSED INSTALLATION<br>STREET Gooch Road<br>CITY Hampstead MAINE<br>TEL. NUMBER 1-382-6740 |

SKETCH: LOCATION OF BUILDING DISPOSAL SYSTEM, TERRAIN FEATURES, PERCOLATION HOLES, WATER SUPPLIES, ETC.

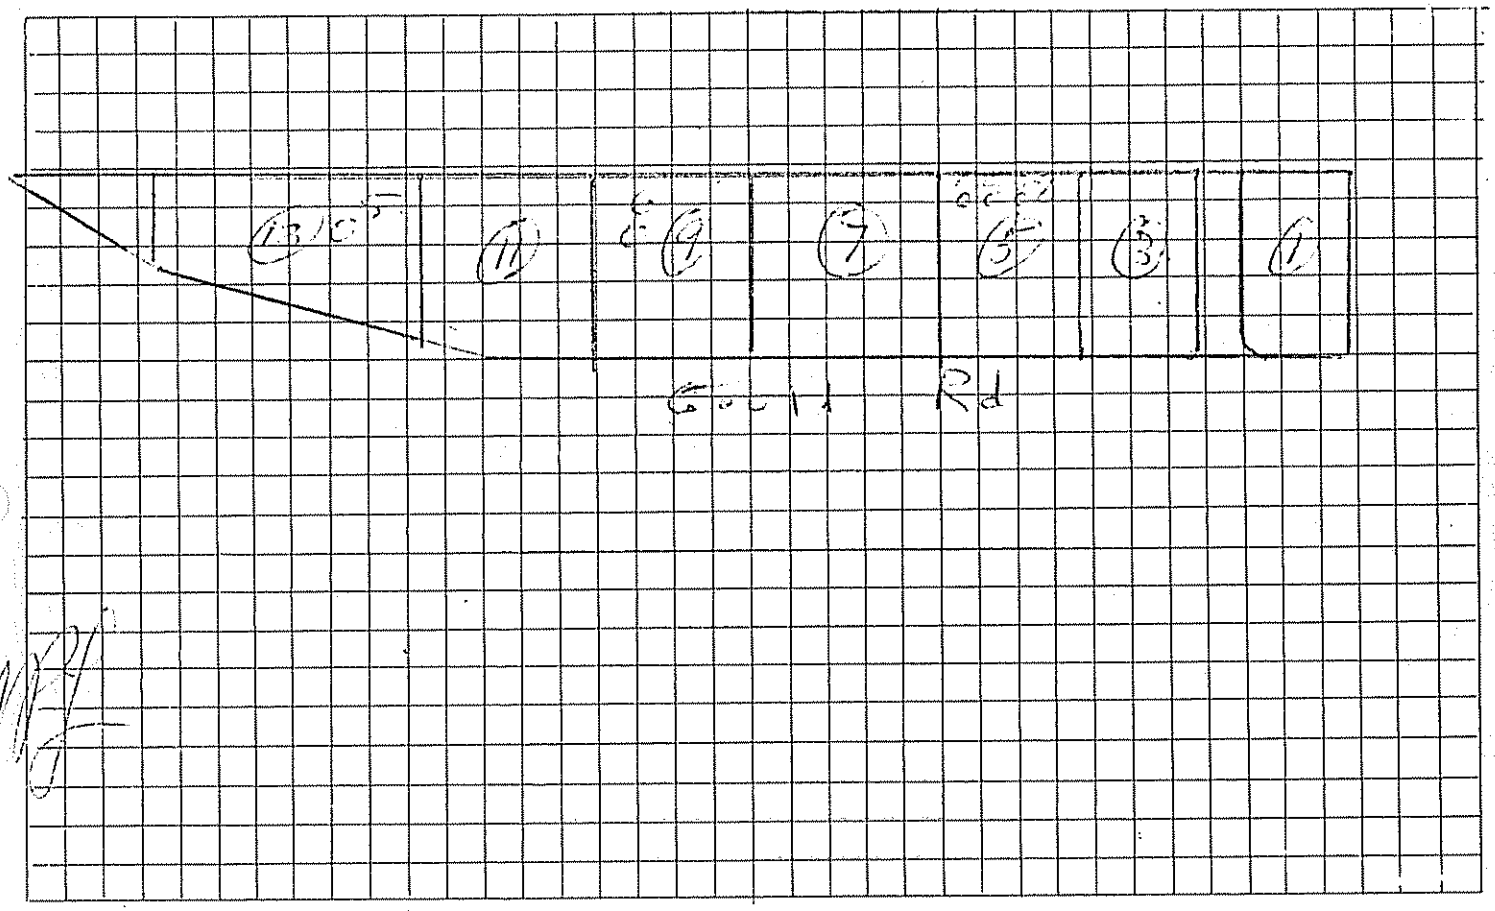


2.70' Depth to Water Table
2.52' Depth to Bedrock
Depth to Clay or other impervious strata
} from well data

REMARKS
Tests #1 thru 4 taken for Robert Benedict
Test #5 [illegible]

| HOLE | HOLE DEPTH | TIME START | TIME FINISH | DEPTH OF WATER SURFACE START | DEPTH OF WATER SURFACE FINISH | ELAPSED TIME | TOTAL DROP OF WATER | PERCOL. RATE MINUTES/INCH |
|---|---|---|---|---|---|---|---|---|
| #1 | 36 in. | 12:55 | 12:58 | 28 in. | 32 in. | 2 min. | 4 in. | 0.5 min/in |
| #2 | 36 in. | 1:03 | 1:07 | 28 in. | 32 in. | 4 min. | 4 in. | 1.0 min/in |
| #3 | 36 in. | 1:23 | 1:28 | 28 in. | 32 in. | 5 min. | 4 in. | 1.25 min/in |
| #4 | 36 in. | 1:40 | 1:44 | 28 in. | 32 in. | 4 min. | 4 in. | 1.0 min/in |
| #5 | 36 | 1:53 | 1:57 | 28" | 32" | 4 min. | 4" | 1.0 min/in |
| #6 | 36 | 2:03 | 2:10 | 28" | 32" | 7 min. | 4" | 1.75 min/in |
| AVERAGE RATE | | | | | | | | 1.1 min/in |