BAILLARGEON, DENIS #7340

SUBMIT THE FOLLOWING COMPLETED FORM TO YOUR LOCAL PLUMBING INSPECTOR

DATE 23 OCT. 1973	OWNER Denis Baillargeon
NUMBER OF BEDROOMS Three	STREET Gould Road
SIZE OF SEPTIC TANK 1000 gal.	CITY Manchester, MAINE
TYPE OF SOIL sandy	TEL. NUMBER 622-5649
Test Performed by Wayne P. Libby R.L.S. #965 Wayne P. Libby	LOCATION OF PROPOSED INSTALLATION STREET Gould Road
Local Plumbing Inspector's Signature George A. Smith	CITY Augusta MAINE
	TEL. NUMBER None

SKETCH: LOCATION OF BUILDING DISPOSAL SYSTEM, TERRAIN FEATURES, PERCOLATION HOLES, WATER SUPPLIES, ETC.

NOTE: Not to scale.

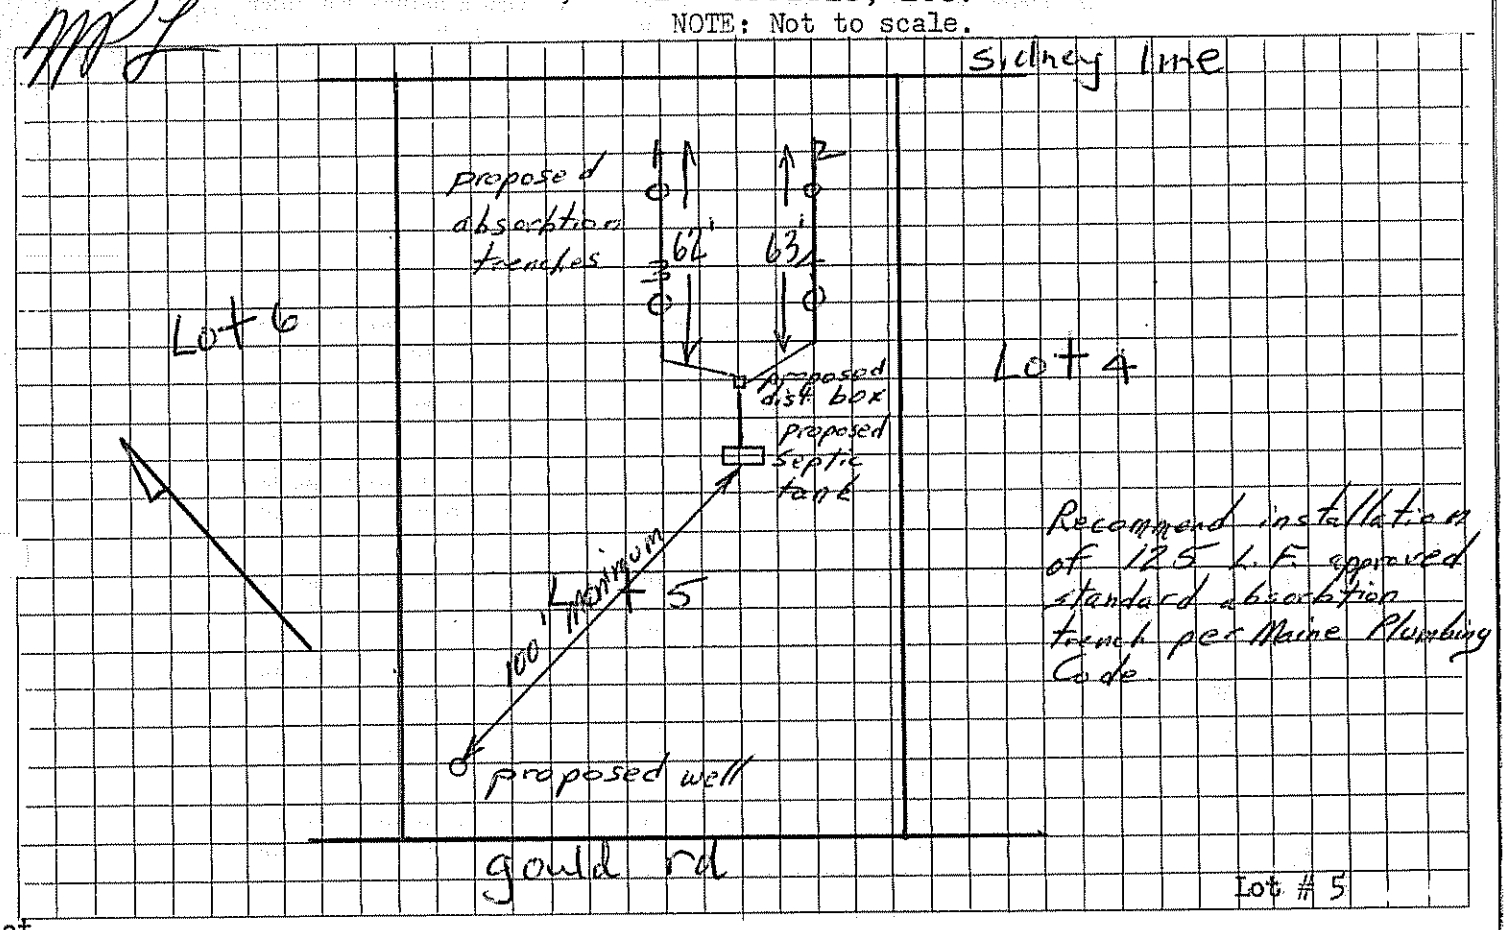

not encountered Depth to Water Table

" Depth to Bedrock

" Depth to Clay or other impervious strata

REMARKS rapid percolation, very sandy soil, apparently deep strata

HOLE	HOLE DEPTH	TIME START	TIME FINISH	DEPTH OF WATER SURFACE START	DEPTH OF WATER SURFACE FINISH	ELAPSED TIME	TOTAL DROP OF WATER	PERCOL. RATE MINUTES/INCH
#1	36 in.	0 : 0: 0	0:01:55	36 in.	32 in.	1:55 min.	4 in.	0:479 min/in
#2	36 in.	0 : 0: 0	0:02:12	36 in.	32 in.	2:12 min.	4 in.	0:550 min/in
#3	36 in.	0 : 0: 0	0:02:45	31 in.	35 in.	2:45 min.	4 in.	0.688 min/in
#4	36 in.	0 : 0: 0	0:02:30	32 in.	36 in.	2:30 min.	4 in.	0.625 min/in
						AVERAGE RATE		0.585 min/in