McDONALD, JOHN

SUBMIT THE FOLLOWING COMPLETED FORM TO YOUR LOCAL PLUMBING INSPECTOR

DATE 5/11/74
NUMBER OF BEDROOMS 3
SIZE OF SEPTIC TANK 1000
TYPE OF SOIL loamy Sandy Loam

OWNER John McDonald
STREET Pleasant St.
CITY Augusta MAINE
TEL. NUMBER Lot 12

Test Performed by
Rolfes Plumbing & Heating #1620

Local Plumbing Inspector's Signature
George L. Smith

LOCATION OF PROPOSED INSTALLATION
STREET Claire St.
CITY Augusta MAINE
TEL. NUMBER

SKETCH: LOCATION OF BUILDING DISPOSAL SYSTEM, TERRAIN FEATURES, PERCOLATION HOLES, WATER SUPPLIES, ETC.

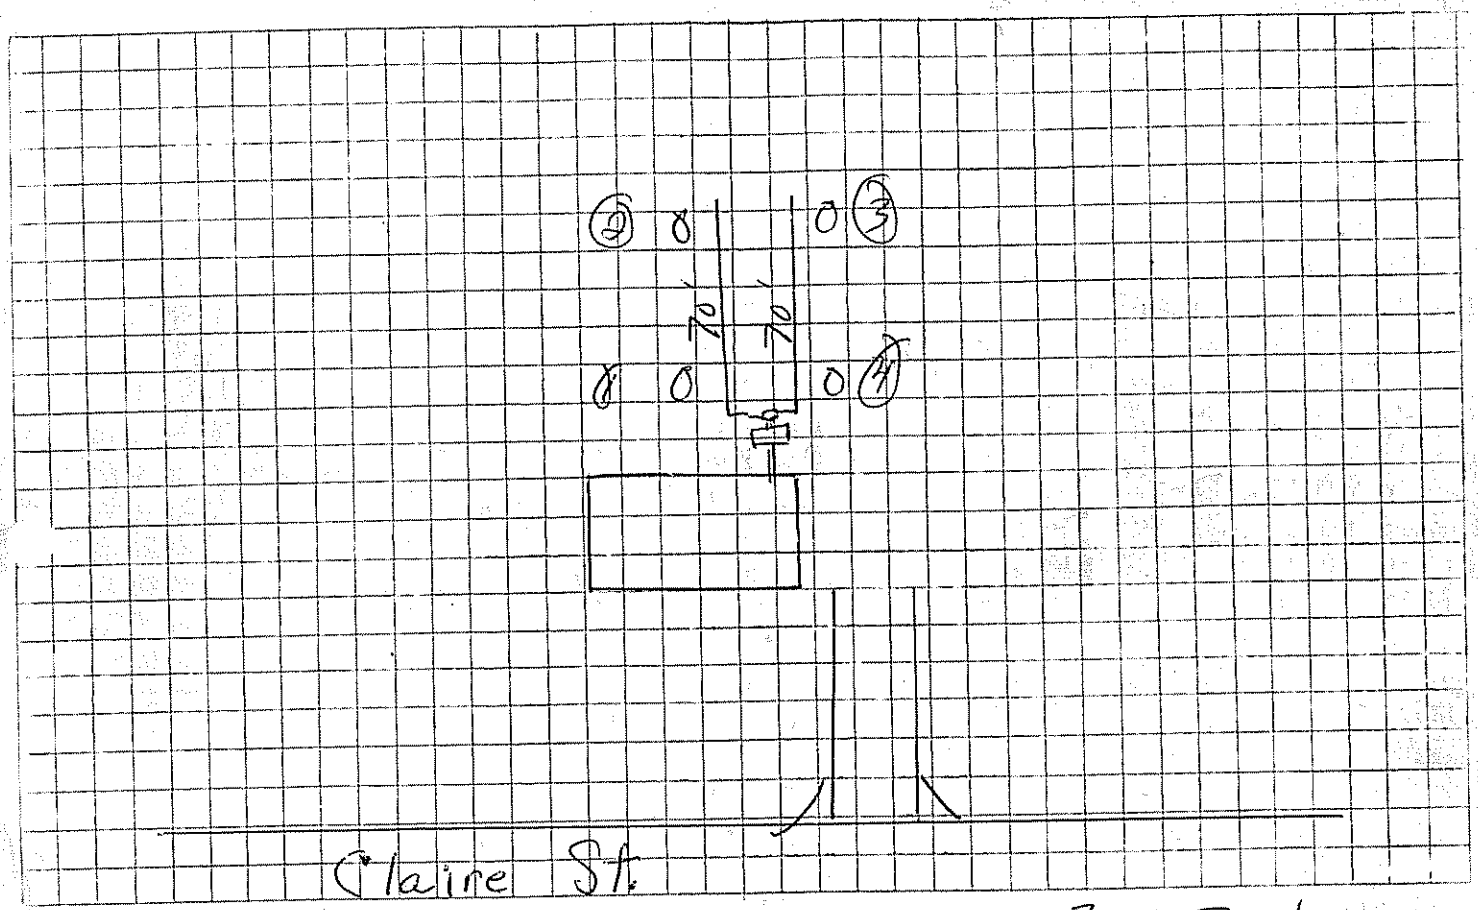

5+ Depth to Water Table
80 Depth to Bedrock
5+ Depth to Clay or other impervious strata

REMARKS 3/4 X 0 3 stone or crushed stone

HOLE	HOLE DEPTH	TIME START	TIME FINISH	DEPTH OF WATER SURFACE START	DEPTH OF WATER SURFACE FINISH	ELAPSED TIME	TOTAL DROP OF WATER	PERCOL. RATE MINUTES/INCH
#1	36 in.	3:15	4:15	34 in.	26 in.	60 min.	8 in.	7.5-1 min/in
#2	36 in.	3:20	4:20	34 in.	25 in.	60 min.	9 in.	6.6-1 min/in
#3	36 in.	3:25	4:25	34 in.	24 in.	60 min.	7 in.	8.6-1 min/in
#4	36 in.	3:30	4:30	34 in.	26 in.	60 min.	8 in.	7.5-1 min/in
						AVERAGE RATE		7.5-1 min/in