CDC

B.P. 1553

Wallace

SUBMIT THE FOLLOWING COMPLETED FORM TO YOUR LOCAL PLUMBING INSPECTOR

DATE 5/21/74	OWNER C.D.C. INC.
NUMBER OF BEDROOMS 3	STREET 150 Mt. Vernon Ave.
SIZE OF SEPTIC TANK 1000	CITY Augusta MAINE
TYPE OF SOIL Loam Sand	TEL. NUMBER 622 5919
Test Performed by Rolfe's Plumbing	LOCATION OF PROPOSED INSTALLATION
Local Plumbing Inspector's Signature George L. Smith	STREET Claire St.
	CITY Augusta MAINE
	TEL. NUMBER Lot 21

SKETCH: LOCATION OF BUILDING DISPOSAL SYSTEM, TERRAIN FEATURES, PERCOLATION HOLES, WATER SUPPLIES, ETC.

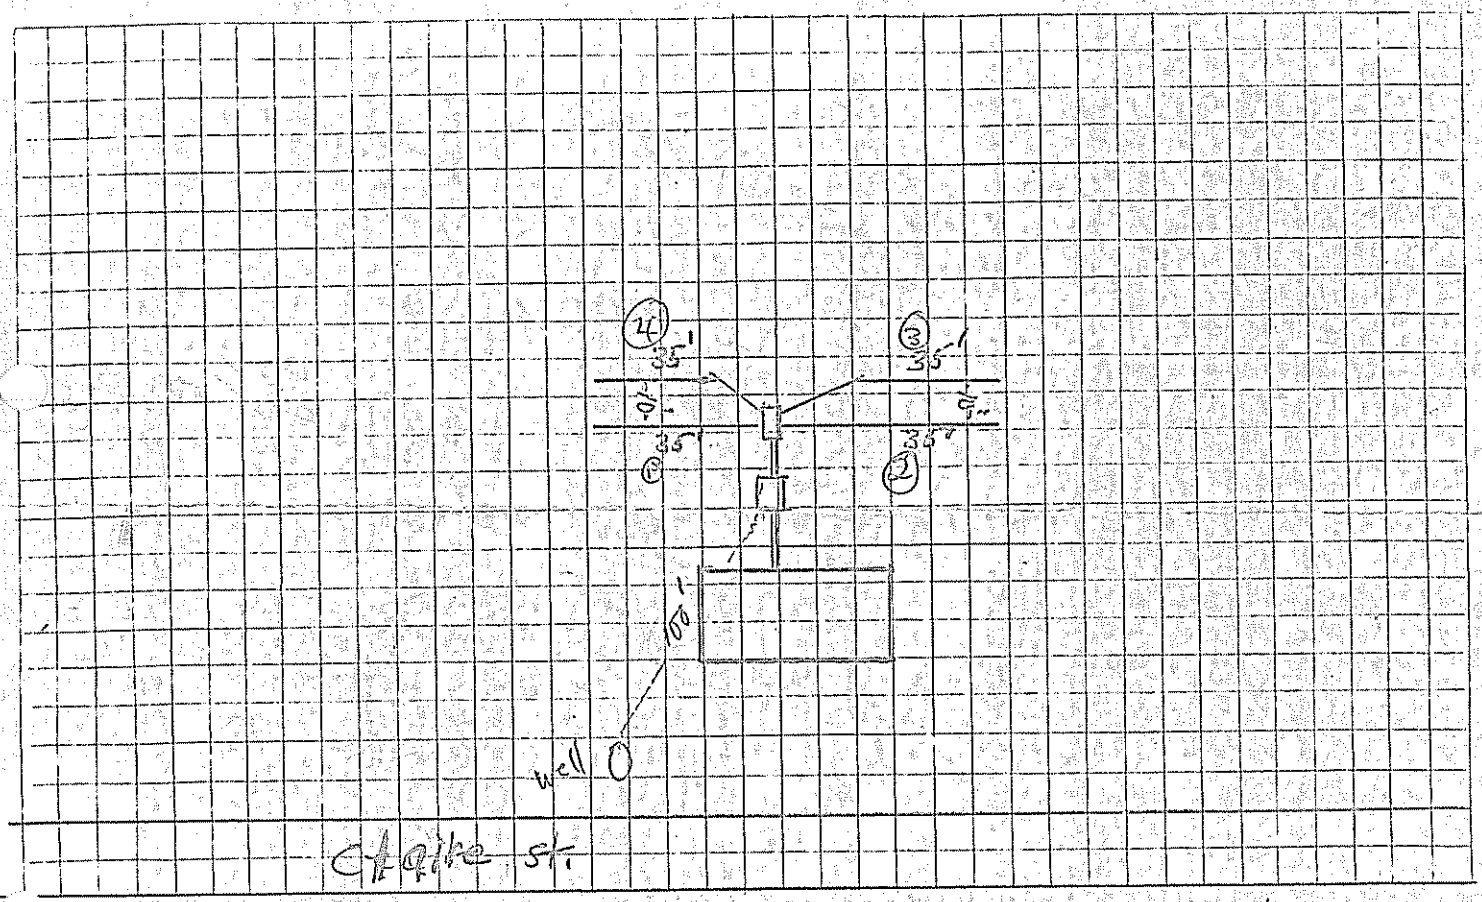

5' Depth to Water Table
76' Depth to Bedrock
5' Depth to Clay or other impervious strata

REMARKS 3/4 x 3 stone or crushed stone for Drain field

HOLE	HOLE DEPTH	TIME START	TIME FINISH	DEPTH OF WATER SURFACE START	DEPTH OF WATER SURFACE FINISH	ELAPSED TIME	TOTAL DROP OF WATER	PERCOL. RATE MINUTES/INCH
#1	36 in.	2:22	3:22	31 in.	25 in.	60 min.	6 in.	10-1 min/in
#2	36 in.	2:30	3:30	31 in.	23 in.	60 min.	8 in.	7-1 min/in
#3	36 in.	2:37	3:37	30 in.	24 in.	60 min.	6 in.	10-1 min/in
#4	36 in.	2:48	3:48	33 in.	26 in.	60 min.	7 in.	8-1 min/in
						AVERAGE RATE		8-1 min/in