BRETON, NORMAN

SUBMIT THE FOLLOWING COMPLETED FORM TO YOUR LOCAL PLUMBING INSPECTOR

DATE 5-30-72
NUMBER OF BEDROOMS 3
SIZE OF SEPTIC TANK 900 gal.
TYPE OF SOIL SANDY

OWNER MR. NORMAN BRETON
STREET 56 FRANKLIN ST.
CITY AUGUSTA MAINE 04330
TEL. NUMBER 622-5301

Test Performed by Redington R Robbins
R. ROBBINS & H. McCLAUFLIN

Local Plumbing Inspector's Signature
C. G. [illegible]

LOCATION OF PROPOSED INSTALLATION
STREET MIDDLE ROAD
CITY AUGUSTA MAINE
TEL. NUMBER NONE YET

SKETCH: LOCATION OF BUILDING DISPOSAL SYSTEM, TERRAIN FEATURES, PERCOLATION HOLES, WATER SUPPLIES, ETC.

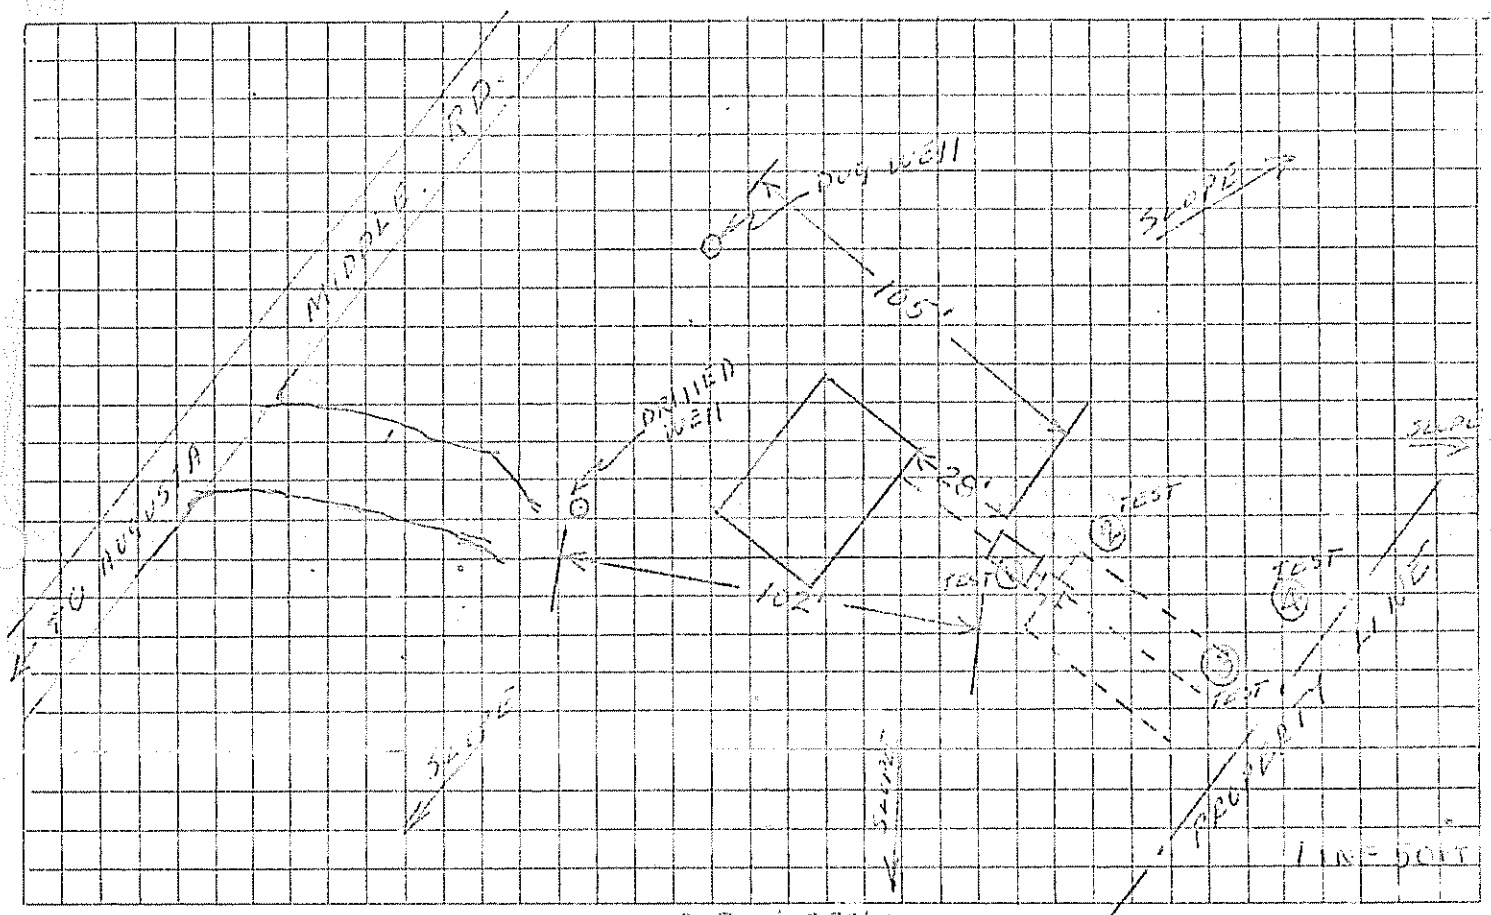

LOT SIZE 200'x270'

OVER 5' Depth to Water Table
23 ± Depth to Bedrock
20 ± Depth to Clay or other impervious strata

REMARKS 5-42 FT. DISPOSAL TRENCHES WITH AT LEAST 10' OF UNDISTURBED EARTH BETWEEN TRENCHES NEEDED
2 AT MINIMUM 125 FT OF DISPOSAL TRENCH.

HOLE	HOLE DEPTH	TIME START	TIME FINISH	DEPTH OF WATER SURFACE START	DEPTH OF WATER SURFACE FINISH	ELAPSED TIME	TOTAL DROP OF WATER	PERCOL. RATE MINUTES/INCH
#1	36 in.	6:10 PM	6:18 PM	28 in.	34 in.	8 min.	6 in.	1.33 min/in
#2	36 in.	6:12 PM	6:20 PM	27.5 in.	31.5 in.	8 min.	4 in.	2.00 min/in
#3	36 in.	6:15 PM	6:22 PM	26.5 in.	31.5 in.	7 min.	5 in.	1.40 min/in
#4	36 in.	6:17 PM	6:23 PM	26.7 in.	31.2 in.	6 min.	4.5 in.	1.33 min/in
						AVERAGE RATE		1.51 min/in