BRETON, D.

SUBMIT THE FOLLOWING COMPLETED FORM TO YOUR LOCAL PLUMBING INSPECTOR

DATE 6-28-73	OWNER D Breton
NUMBER OF BEDROOMS —	STREET 1 Savage St.
SIZE OF SEPTIC TANK 1000 Min	CITY Augusta MAINE
TYPE OF SOIL Sandy loam	TEL. NUMBER
Test Performed by [signature] PE #1576	LOCATION OF PROPOSED INSTALLATION
Local Plumbing Inspector's Signature George L. Smith	STREET Middle Rd
	CITY Augusta MAINE
	TEL. NUMBER

SKETCH: LOCATION OF BUILDING DISPOSAL SYSTEM, TERRAIN FEATURES, PERCOLATION HOLES, WATER SUPPLIES, ETC.

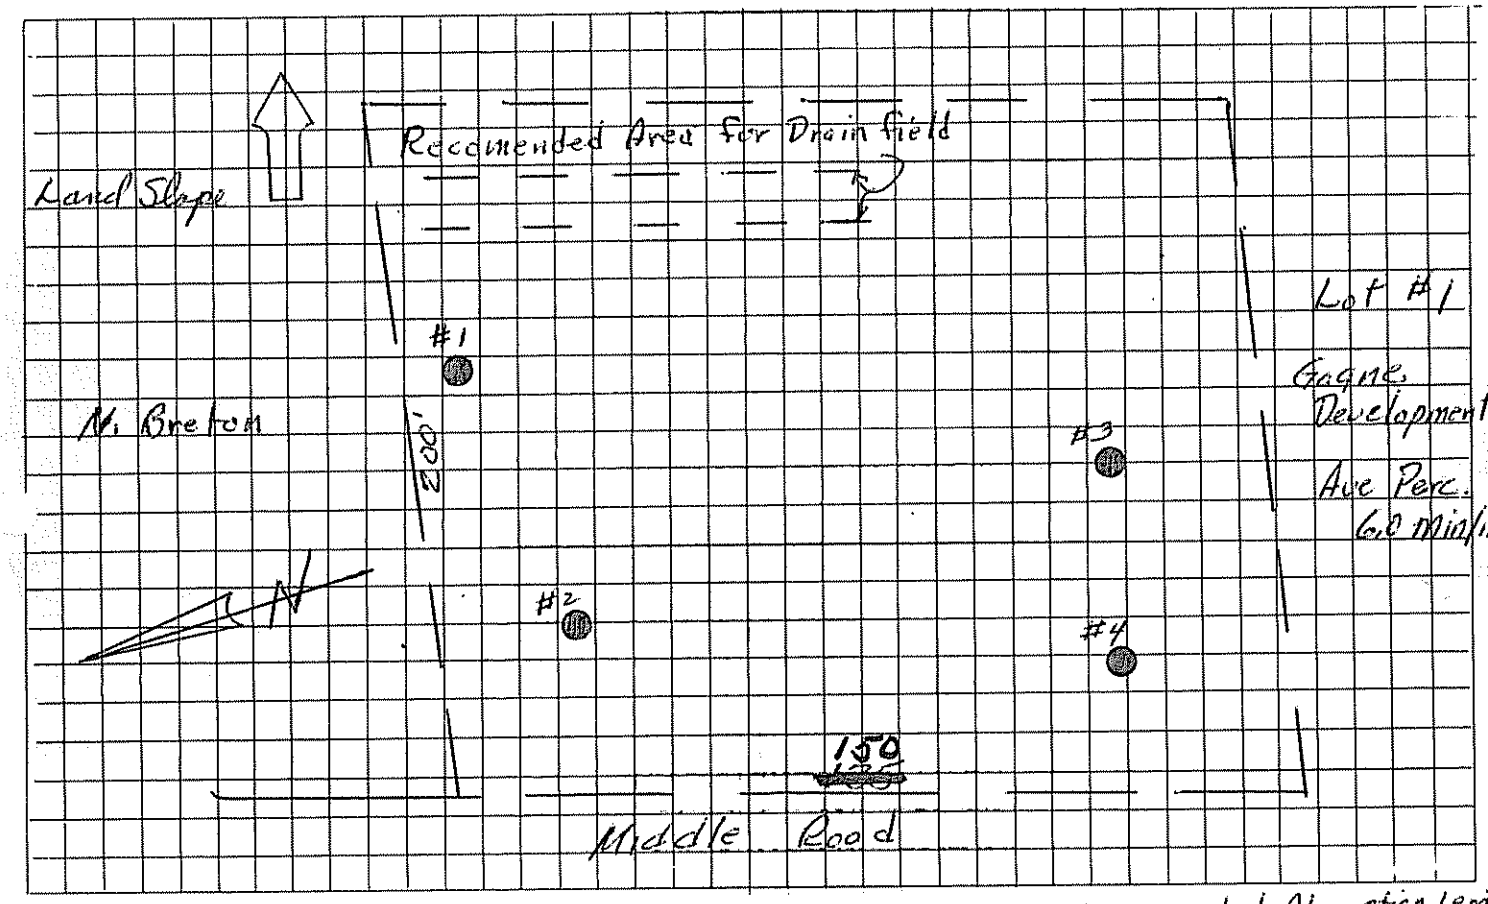

5' Depth to Water Table
30'+ Depth to Bedrock
5'+ Depth to Clay or other impervious strata

REMARKS Recommended Absorption Length
1 Bedroom 50 LF
2 Bedroom 65 LF
3 Bedroom 100 LF
4 Bedroom 125 LF

HOLE	HOLE DEPTH	TIME START	TIME FINISH	DEPTH OF WATER SURFACE START	DEPTH OF WATER SURFACE FINISH	ELAPSED TIME	TOTAL DROP OF WATER	PERCOL. RATE MINUTES/INCH
#1	36 in.	5:57	6:31	18 in.	27 in.	34 min.	9 in.	3.8 min/in
#2	36 in.	6:02	6:32	18 in.	36 in.	30 min.	18 in.	1.7 min/in
#3	36 in.	6:06	6:32	18 in.	36 in.	26 min.	18 in.	1.6 min/in
#4	36 in.	6:12	6:33	18 in.	31 in.	21 min.	13 in.	1.6 min/in
						AVERAGE RATE		2.2 min/in