MIVILLE, MARGUERITE

SUBMIT THE FOLLOWING COMPLETED FORM TO YOUR LOCAL PLUMBING INSPECTOR

DATE 6/3/73
NUMBER OF BEDROOMS 3
SIZE OF SEPTIC TANK 1000 gal Min.
TYPE OF SOIL Sandy Loam

Test Performed by [signature] PE #1576

Local Plumbing Inspector's Signature George L. Smith

OWNER Marguerite L. Miville
STREET Lafayette St
CITY Augusta MAINE
TEL. NUMBER

LOCATION OF PROPOSED INSTALLATION
STREET Lot #2 Gagne Development - Middle Rd
CITY Augusta MAINE
TEL. NUMBER

SKETCH: LOCATION OF BUILDING DISPOSAL SYSTEM, TERRAIN FEATURES, PERCOLATION HOLES, WATER SUPPLIES, ETC.

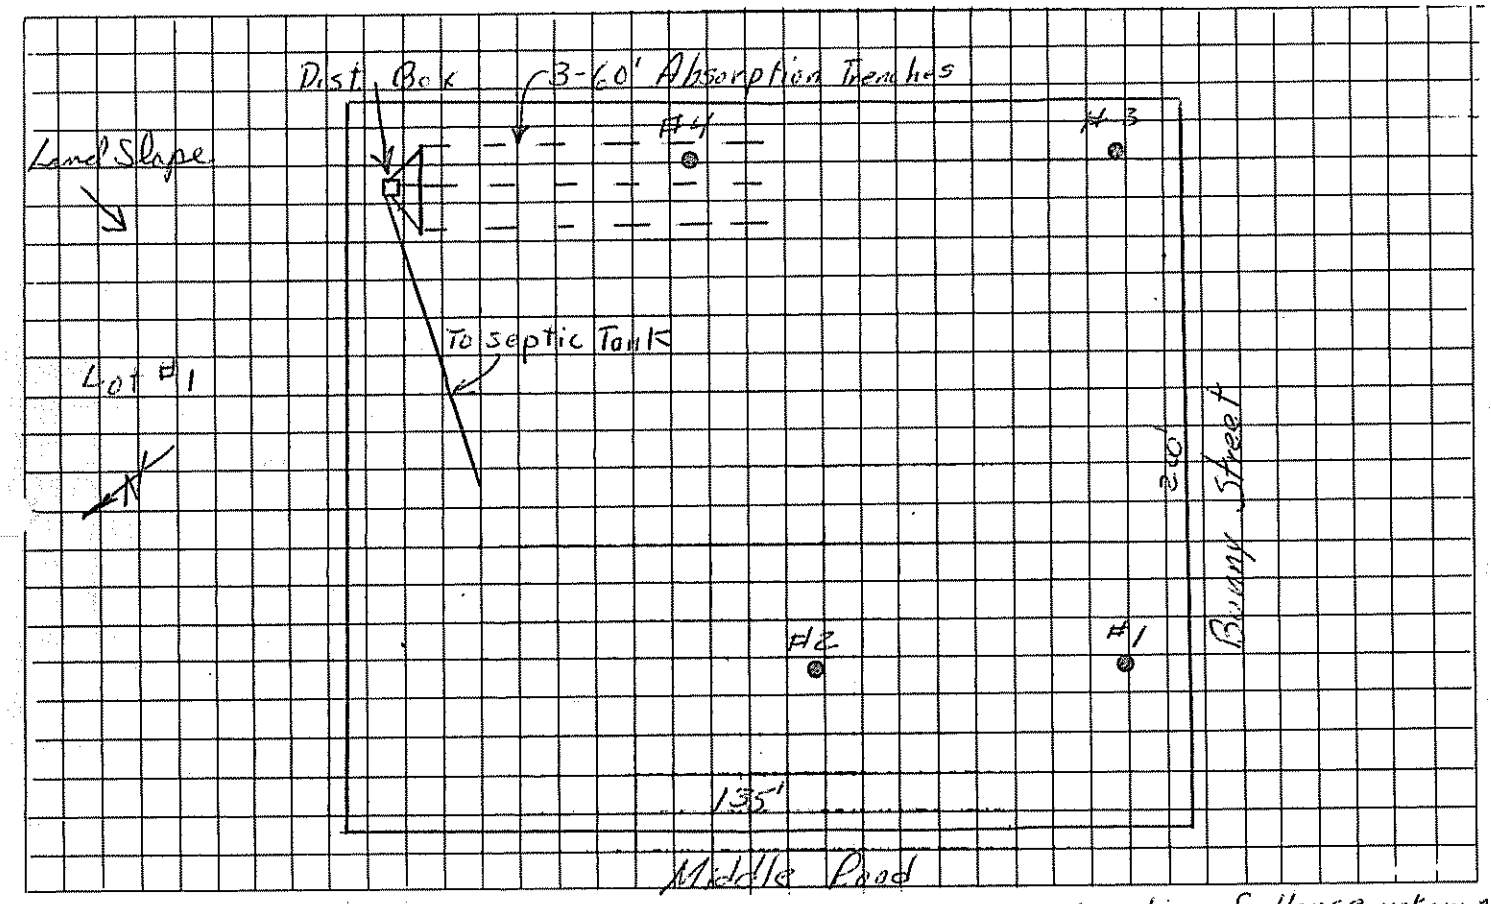

5'+ Depth to Water Table
30'± Depth to Bedrock
30'+ Depth to Clay or other impervious strata

REMARKS Location of House unknown at this time, IT is recommended that the field be located in Northeast quadrant of Lot to minimize problems for other Lots. Recommend 3-60' Lines as shown.

HOLE	HOLE DEPTH	TIME START	TIME FINISH	DEPTH OF WATER SURFACE START	DEPTH OF WATER SURFACE FINISH	ELAPSED TIME	TOTAL DROP OF WATER	PERCOL. RATE MINUTES/INCH
#1	36 in.	4:28	5:45	21 in.	24 in.	77 min.	3 in.	26 min/in
#2	36 in.	5:26	6:27	18 in.	20 in.	43 min.	2 in.	22 min/in
#3	36 in.	4:32	5:10	18 in.	28 in.	38 min.	10 in.	3.8 min/in
#4	36 in.	4:32	5:10	20 in.	36 in.	38 min.	16 in.	2.4 min/in
						AVERAGE RATE		14 min/in