POULIN, PHILIP

Bldg Permit 1472

SUBMIT THE FOLLOWING COMPLETED FORM TO YOUR LOCAL PLUMBING INSPECTOR

DATE June 3 1973
NUMBER OF BEDROOMS 2 or 3
SIZE OF SEPTIC TANK Rec 1000 gal
TYPE OF SOIL Loamy Sand

OWNER Philip A. Poulin
STREET 27 Green leaf St.
CITY Augusta MAINE
TEL. NUMBER 24639

Test Performed by Walter B Lovett PE # 1576

Local Plumbing Inspector's Signature George L. Smith

LOCATION OF PROPOSED INSTALLATION
STREET Lot #9 Gagne Development Middle Rd.
CITY Augusta MAINE
TEL. NUMBER

SKETCH: LOCATION OF BUILDING DISPOSAL SYSTEM, TERRAIN FEATURES, PERCOLATION HOLES, WATER SUPPLIES, ETC.

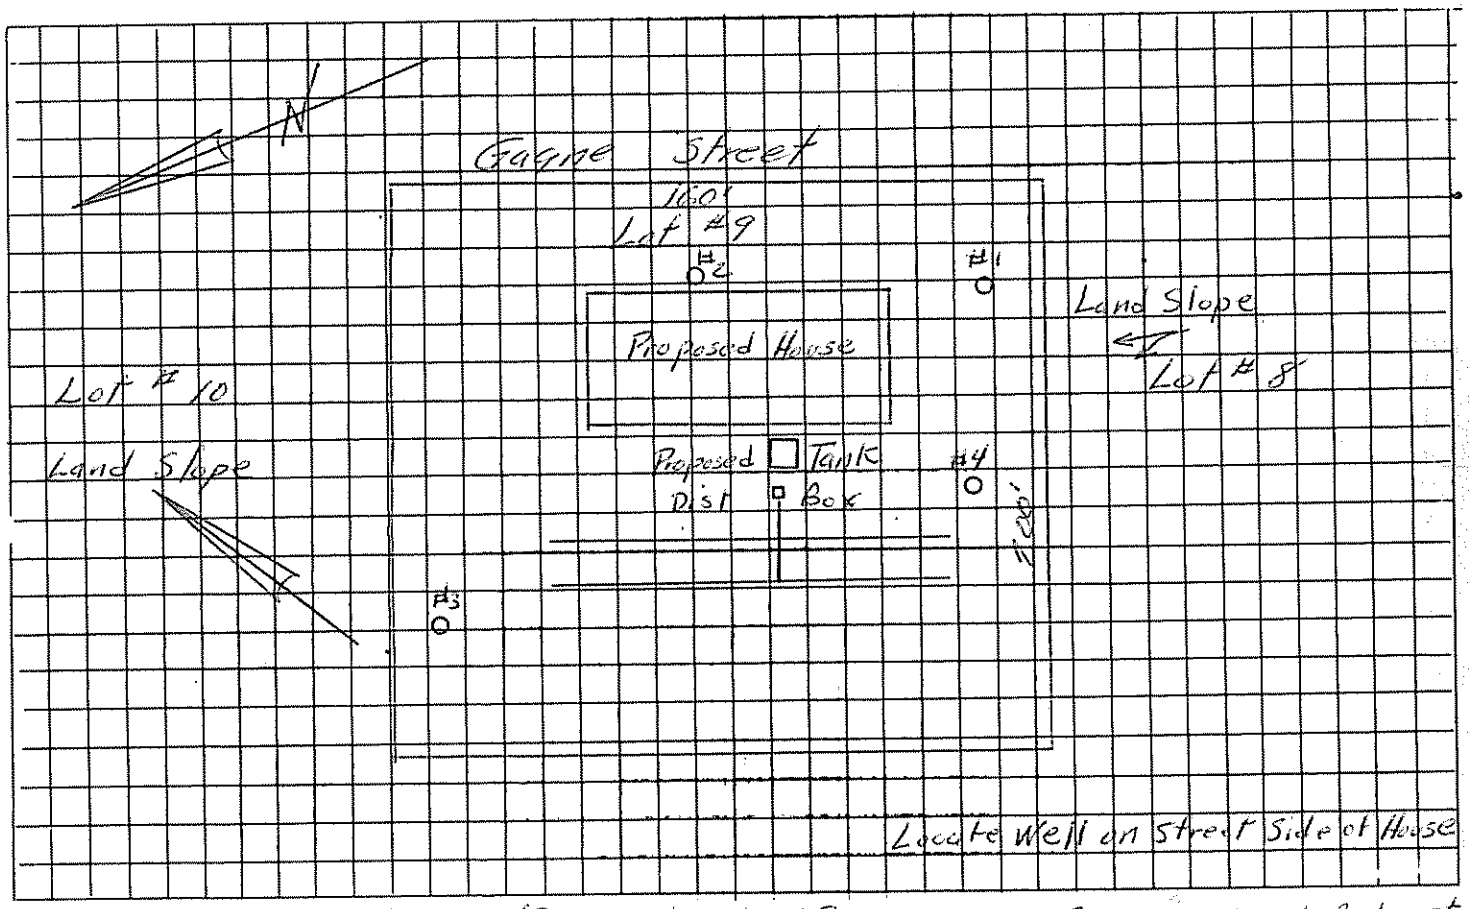

5'± Depth to Water Table (Recommend Sand Fill for Grading & Water Table (2'-3') in area of Absorption Trenches)
35'± Depth to Bedrock
10-12'± Depth to Clay or other impervious strata

REMARKS Recommend 85' of absorption Trench for 2 Bedroom House & 2-65' Trenches for 3 Bedroom House

HOLE	HOLE DEPTH	TIME START	TIME FINISH	DEPTH OF WATER SURFACE START	DEPTH OF WATER SURFACE FINISH	ELAPSED TIME	TOTAL DROP OF WATER	PERCOL. RATE MINUTES/INCH
#1	36 in.	4:51	5:16	14 in.	30 in.	25 min.	16 in.	1.6 min/in
#2	36 in.	4:47	5:15	19 in.	36 in.	28 min.	17 in.	1.7 min/in
#3	36 in.	3:38	4:42	16 in.	20 in.	64 min.	4 in.	16 min/in
#4	36 in.	5:18	5:50	18 in.	36 in.	32 min.	18 in.	1.7 min/in
						AVERAGE RATE		4 min/in