Dumont, B & L

SUBMIT THE FOLLOWING COMPLETED FORM TO YOUR LOCAL PLUMBING INSPECTOR

DATE 6/21/74	OWNER B & L Dumont
NUMBER OF BEDROOMS 3	STREET Hawthorne Ave.
SIZE OF SEPTIC TANK 1000	CITY Augusta MAINE
TYPE OF SOIL Sand, loam, gravel	TEL. NUMBER
Test Performed by Rolfes Plumbing & Heating #1620	LOCATION OF PROPOSED INSTALLATION STREET Cathy Dr. LOT #12
Local Plumbing Inspector's Signature George L. Smith	CITY Augusta MAINE TEL. NUMBER 622-2564

SKETCH: LOCATION OF BUILDING DISPOSAL SYSTEM, TERRAIN FEATURES, PERCOLATION HOLES, WATER SUPPLIES, ETC.

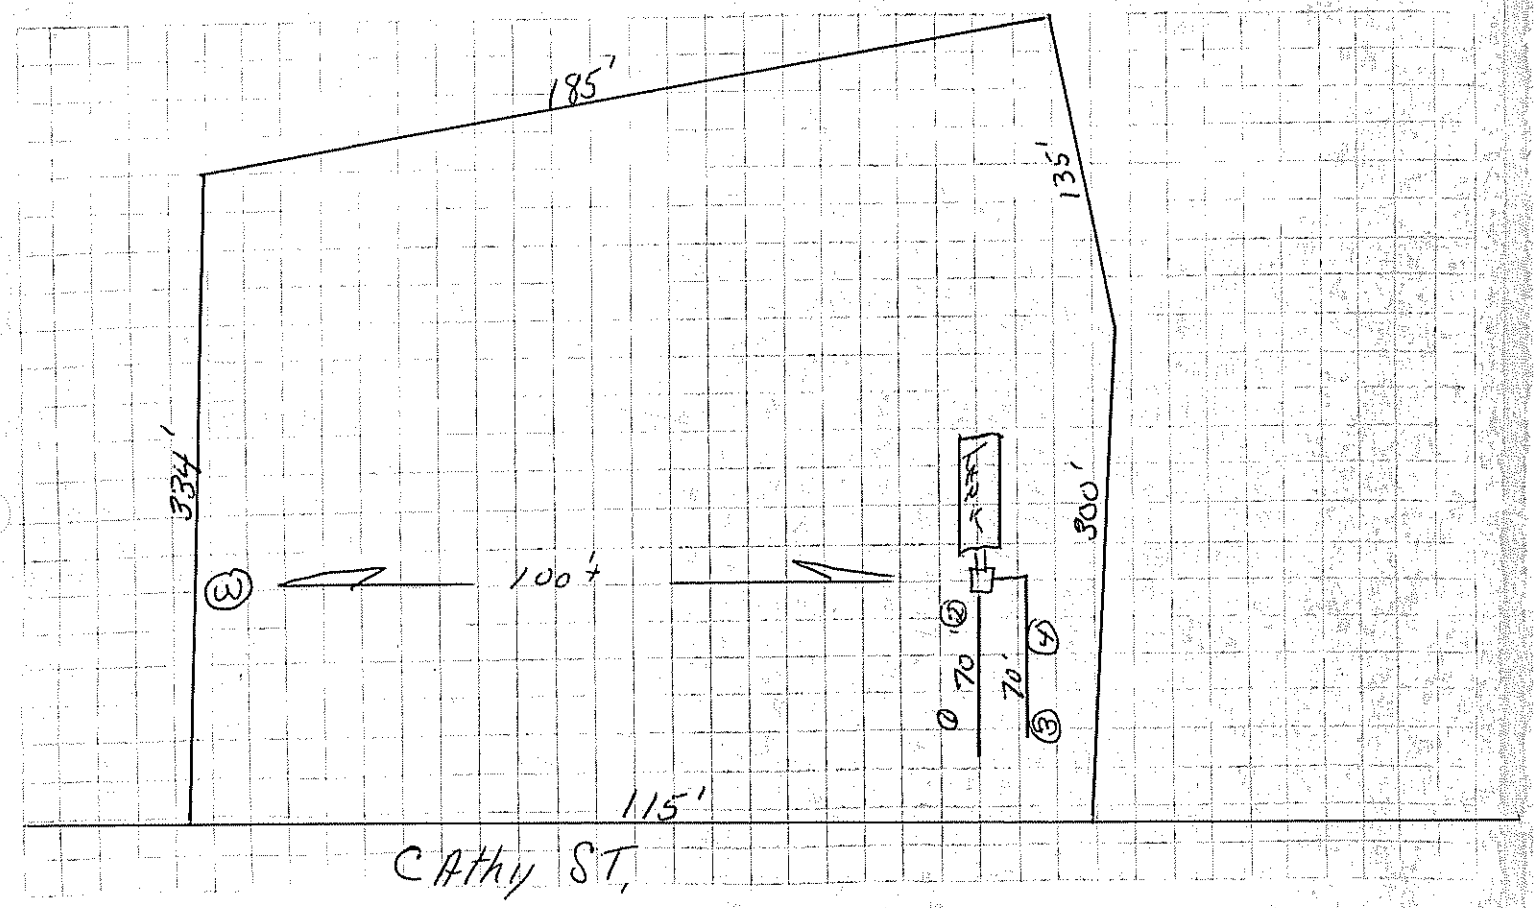

5'+ Depth to Water Table

6'+ Depth to Bedrock

5'+ Depth to Clay or other impervious strata

REMARKS

HOLE	HOLE DEPTH	TIME START	TIME FINISH	DEPTH OF WATER SURFACE START	DEPTH OF WATER SURFACE FINISH	ELAPSED TIME	TOTAL DROP OF WATER	PERCOL. RATE MINUTES/INCH
#1	36 in.	9:20	10:20	34 in.	21 in.	60 min.	13 in.	4.6 - 1 min/in
#2	36 in.	9:25	10:25	34 in.	19 in.	60 min.	15 in.	4.0 - 1 min/in
#3	36 in.	9:30	10:30	34 in.	14 in.	60 min.	20 in.	3.0 - 1 min/in
#4	36 in.	9:35	10:35	34 in.	16 in.	60 min.	18 in.	3.3 - 1 min/in
						AVERAGE RATE		3.7 - 1 min/in