Dulac, Arthur

SUBMIT THE FOLLOWING COMPLETED FORM TO YOUR LOCAL PLUMBING INSPECTOR

DATE 11-7-92	OWNER Arthur Dulac
NUMBER OF BEDROOMS 3	STREET 21 Lafayette
SIZE OF SEPTIC TANK 1000	CITY Augusta MAINE
TYPE OF SOIL Clean Fine Sand	TEL. NUMBER 276 05
Test Performed by [signature] REG 1576	LOCATION OF PROPOSED INSTALLATION
Local Plumbing Inspector's Signature [signature]	STREET 8 Red Road
	CITY Augusta MAINE
	TEL. NUMBER

SKETCH: LOCATION OF BUILDING DISPOSAL SYSTEM, TERRAIN FEATURES, PERCOLATION HOLES, WATER SUPPLIES, ETC.

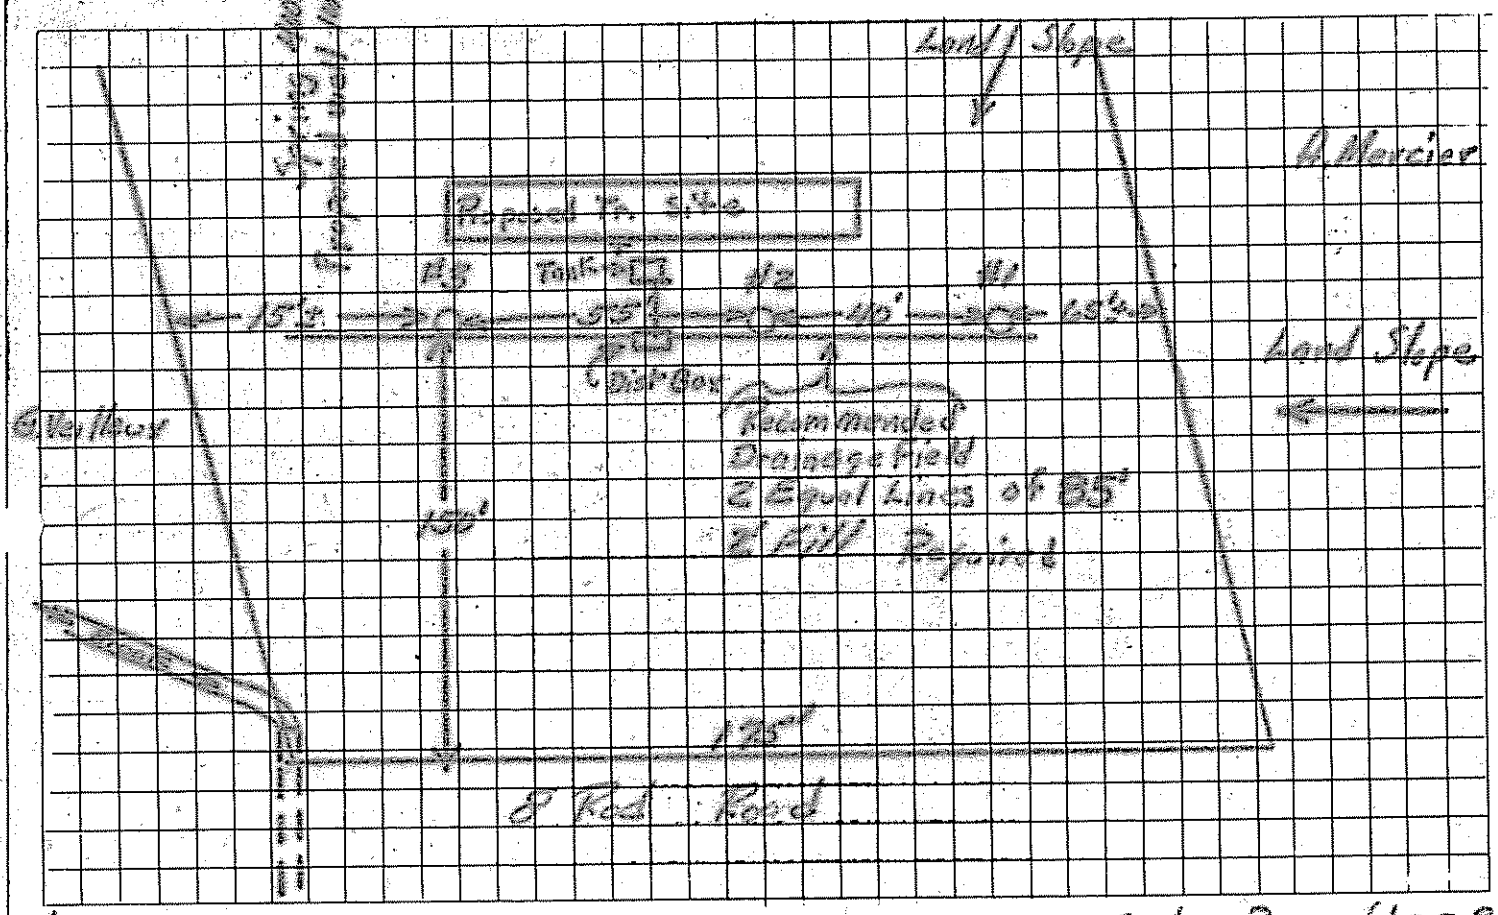

5' None Depth to Water Table
4' Depth to Bedrock Average
3'-4' Depth to Clay or other impervious strata

REMARKS Tests Run after 2 Days of Heavy Rains 11-2 & 3 (Tested on 11-5)

HOLE	HOLE DEPTH	TIME START	TIME FINISH	DEPTH OF WATER SURFACE START	DEPTH OF WATER SURFACE FINISH	ELAPSED TIME	TOTAL DROP OF WATER	PERCOL. RATE MINUTES/INCH
#1	36 in.	8:58	9:51	12½ in.	19 in.	53 min.	6½ in.	8 min/in
#2	36 in.	8:59	9:52	16½ in.	19½ in.	53 min.	3 in.	18 min/in
#3	36 in.	9:01	9:53	15 in.	21 in.	52 min.	6 in.	9 min/in
#4	in.			in.	in.	min.	in.	min/in
						AVERAGE RATE		11 min/in