Edward's B.K.

SUBMIT THE FOLLOWING COMPLETED FORM TO YOUR LOCAL PLUMBING INSPECTOR

DATE 6/8/73	OWNER B.K. Edwards
NUMBER OF BEDROOMS 4	STREET Church Hill Rd
SIZE OF SEPTIC TANK 1000	CITY Augusta MAINE
TYPE OF SOIL Buxton Silty Loam	TEL. NUMBER
Test Performed by [signature] PE #1576	LOCATION OF PROPOSED INSTALLATION
Local Plumbing Inspector's Signature George L. Smith	STREET Church Hill Rd.
	CITY Augusta MAINE
	TEL. NUMBER

SKETCH: LOCATION OF BUILDING DISPOSAL SYSTEM, TERRAIN FEATURES, PERCOLATION HOLES, WATER SUPPLIES, ETC.

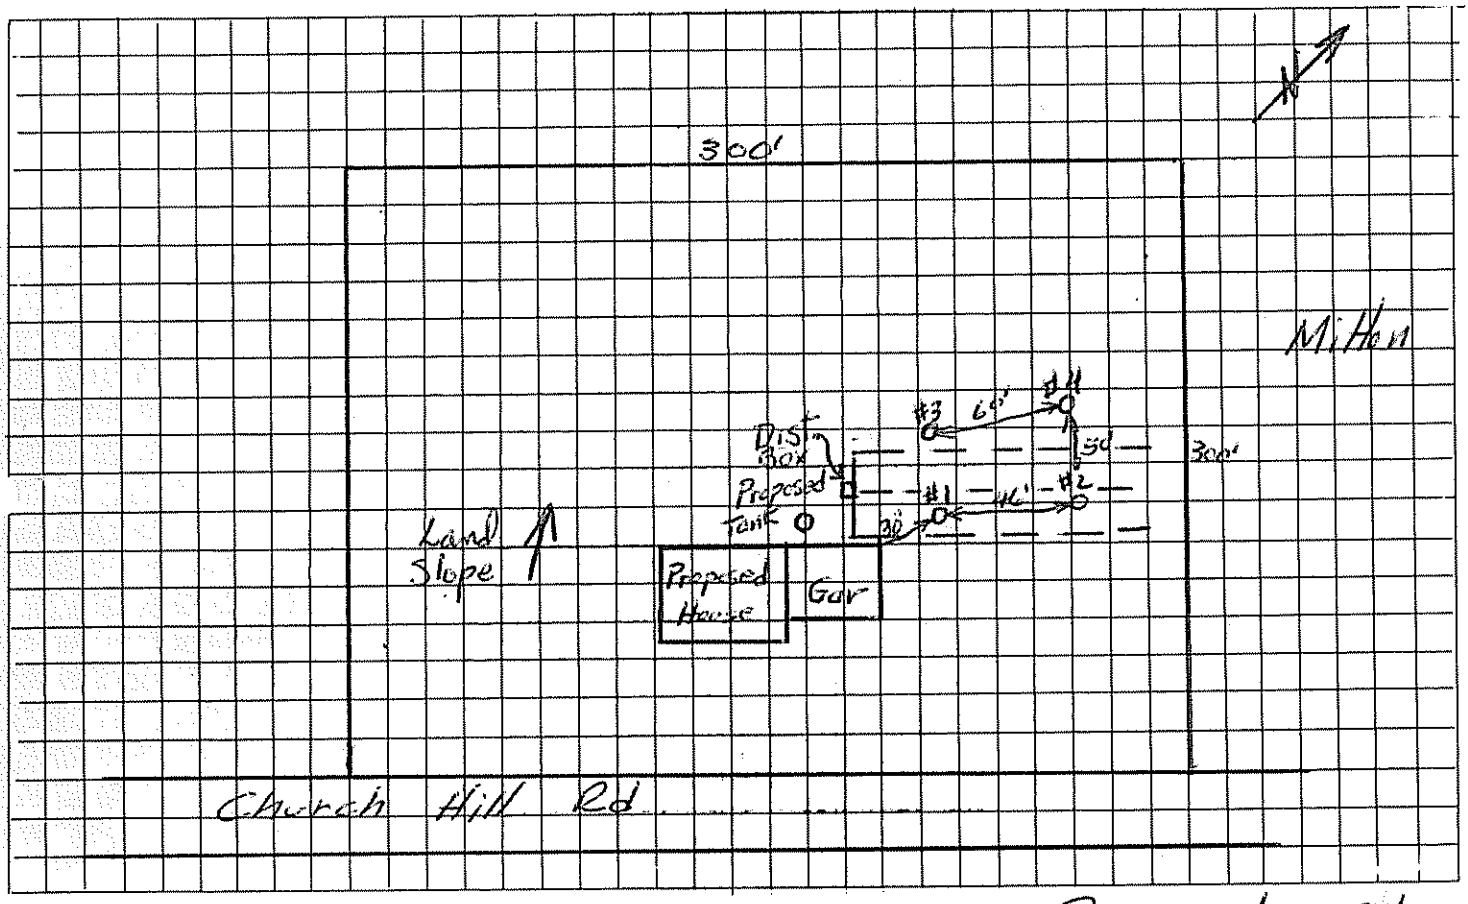

5'+ Depth to Water Table
5'+ Depth to Bedrock
5'+ Depth to Clay or other impervious strata

REMARKS Recommend 3-70' Absorption Trenches To The North (as shown) of Proposed House and parallel To Church Hill Road To fit Contours

HOLE	HOLE DEPTH	TIME START	TIME FINISH	DEPTH OF WATER SURFACE START	DEPTH OF WATER SURFACE FINISH	ELAPSED TIME	TOTAL DROP OF WATER	PERCOL. RATE MINUTES/INCH
#1	36 in.	4:35	5:27	19 in.	23 in.	44 min.	4 in.	11 min/in
#2	36 in.	4:36	5:09	19 in.	22½ in.	35 min.	3½ in.	10 min/in
#3	36 in.	4:45	5:16	12 in.	16 in.	4 min.	31 in.	8 min/in
#4	36 in.	4:47	5:12	16½ in.	20½ in.	4 min.	25 in.	6 min/in
						AVERAGE RATE		9 min/in