SUBMIT THE FOLLOWING COMPLETED FORM TO YOUR LOCAL PLUMBING INSPECTOR

WELLS, ROBERT

DATE Sept 11, 1972	OWNER Robert C Wells
NUMBER OF BEDROOMS 2	STREET PO Box 404
SIZE OF SEPTIC TANK 1000 GAL	CITY Augusta MAINE
TYPE OF SOIL	TEL. NUMBER [illegible]
Test Performed by Robert Wells & J.E. Saleeby PE. 2160	LOCATION OF PROPOSED INSTALLATION
Local Plumbing Inspector's Signature C. F. Morton	STREET Church Hill Road
	CITY Augusta MAINE
	TEL. NUMBER

SKETCH: LOCATION OF BUILDING DISPOSAL SYSTEM, TERRAIN FEATURES, PERCOLATION HOLES, WATER SUPPLIES, ETC.

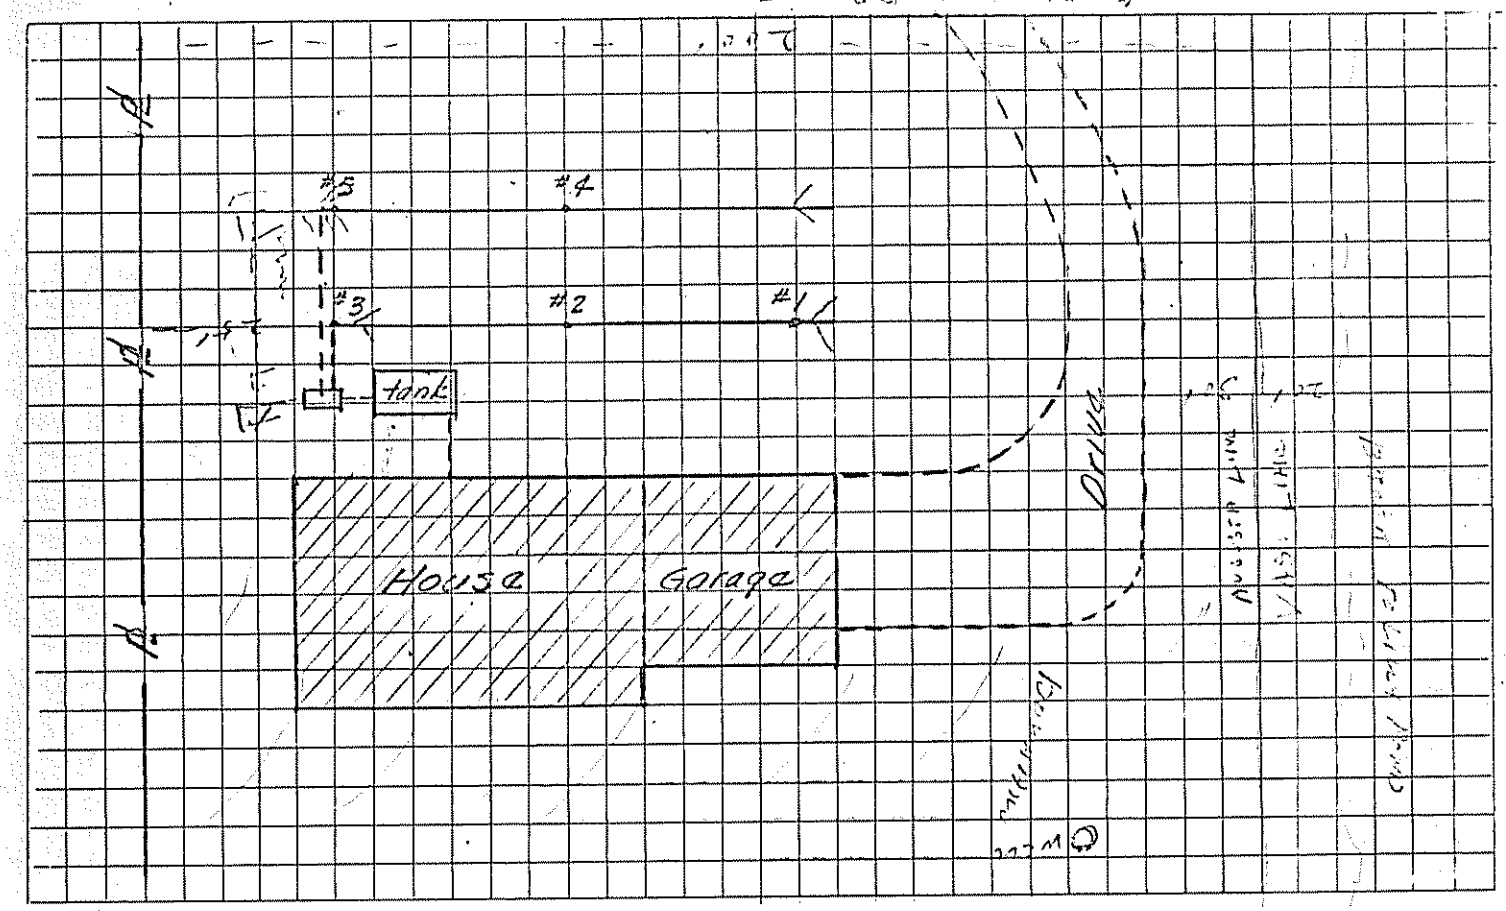

_____ Depth to Water Table 40' on well

_____ Depth to Bedrock None

_____ Depth to Clay or other impervious strata 0'

REMARKS

HOLE	HOLE DEPTH	TIME START	TIME FINISH	DEPTH OF WATER SURFACE START	DEPTH OF WATER SURFACE FINISH	ELAPSED TIME	TOTAL DROP OF WATER	PERCOL. RATE MINUTES/INCH
#1	31 in.	9am	12noon	10 in.	21 in.	180 min.	11 in.	16 min/in
#2	32 in.	"	"	9 in.	24 in.	180 min.	15 in.	12 min/in
#3	32 in.	"	"	10 in.	20 in.	180 min.	10 in.	18 min/in
#4	31 in.	"	"	9 in.	20 in.	180 min.	11 in.	16 min/in
#5	32	"	"	11	26		15 in.	12
						AVERAGE RATE		15 min/in