SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION

Department of Human Services
Division of Health Engineering
(207)289-3826

PROPERTY ADDRESS

Town Or Plantation	Augusta
Street Subdivision Lot #	~~Crosshill Rd.~~ Dam Pond Rd.

PROPERTY OWNERS NAME

Last: Wendy First: True

Applicant Name:	Same
Mailing Address of Owner/Applicant (If Different)	RFD #6 Crosshill Rd. Augusta, Me. 04330

AUGUSTA 2026 TOWN COPY

Caution: Permit Required

Date Permit Issued: 11,6,90 $ 40 FEE ☐ If Double Fee Charged

John Piccirelli L.P.I. # 962

Local Plumbing Inspector Signature

Owner/Applicant Statement

I certify that the information submitted is correct to the best of my knowledge and understand that any falsification is reason for the Local Plumbing Inspector to deny a Permit.

Signature of Owner/Applicant — Date

Caution: Inspection Required

I have inspected the installation authorized above and found it to be in compliance with the Subsurface Wastewater Disposal Rules.

John Piccirelli — Local Plumbing Inspector Signature

11-7-90 — Date Approved

PERMIT INFORMATION

THIS APPLICATION IS FOR:
1. ☒ NEW SYSTEM
2. ☐ REPLACEMENT SYSTEM
3. ☐ EXPANDED SYSTEM
4. ☐ EXPERIMENTAL SYSTEM

SEASONAL CONVERSION
to be completed by the LPI
5. ☐ SYSTEM COMPLIES WITH RULES
6. ☐ CONNECTED TO SANITARY SEWER
7. ☐ SYSTEM INSTALLED – P# _____
8. ☐ SYSTEM DESIGN RECORDED AND ATTACHED

IF REPLACEMENT SYSTEM:
YEAR FAILING SYSTEM INSTALLED _____
THE FAILING SYSTEM IS:
1. ☐ BED 3. ☐ TRENCH
2. ☐ CHAMBER 4. ☐ OTHER: _____

SIZE OF PROPERTY	ZONING
3 Acres	Rural

THIS APPLICATION REQUIRES:
1. ☒ NO RULE VARIANCE
2. ☐ NEW SYSTEM VARIANCE
   Attach New System Variance Form
3. ☐ REPLACEMENT SYSTEM VARIANCE
   Attach Replacement System Variance Form
   a. ☐ Requiring Local Plumbing Inspector Approval
   b. ☐ Requires State and Local Plumbing Inspector Approval
4. ☐ MINIMUM LOT SIZE VARIANCE

DISPOSAL SYSTEM TO SERVE:
1. ☐ SINGLE FAMILY DWELLING
2. ☒ MODULAR OR MOBILE HOME
3. ☐ MULTIPLE FAMILY DWELLING
4. ☐ OTHER _____ SPECIFY

INSTALLATION IS:
COMPLETE SYSTEM
1. ☒ NON-ENGINEERED SYSTEM
2. ☐ PRIMITIVE SYSTEM (Includes Alternative Toilet)
3. ☐ ENGINEERED (+2000 gpd)

INDIVIDUALLY INSTALLED COMPONENTS:
4. ☐ TREATMENT TANK (ONLY)
5. ☐ HOLDING TANK _____ GAL
6. ☐ ALTERNATIVE TOILET (ONLY)
7. ☐ NON-ENGINEERED DISPOSAL AREA (ONLY)
8. ☐ ENGINEERED DISPOSAL AREA (ONLY)
9. ☐ SEPARATED LAUNDRY SYSTEM

TYPE OF WATER SUPPLY
To be drilled

DESIGN DETAILS (SYSTEM LAYOUT SHOWN ON PAGE 3)

TREATMENT TANK
1. ☒ SEPTIC: ☒ Regular ☐ Low Profile
2. ☐ AEROBIC

SIZE: 1000 GALS.

WATER CONSERVATION
1. ☒ NONE
2. ☐ LOW VOLUME TOILET
3. ☐ SEPARATED LAUNDRY SYSTEM
4. ☐ ALTERNATIVE TOILET
   SPECIFY: _____

PUMPING
1. ☒ NOT REQUIRED
2. ☐ MAY BE REQUIRED (DEPENDING ON TREATMENT TANK LOCATION AND ELEVATION)
3. ☐ REQUIRED

DOSE: _____ GALS.

CRITERIA USED FOR DESIGN FLOW (BEDROOMS, SEATING, EMPLOYEES, WATER RECORDS, ETC.)
3 bedroom.
24 infiltrator units
3 rows of 8.

SOIL CONDITIONS USED FOR DESIGN PURPOSES

PROFILE	CONDITION
2	B

DEPTH TO LIMITING FACTOR: 48.

SIZE RATINGS USED FOR DESIGN PURPOSES
1. ☐ SMALL
2. ☐ MEDIUM
3. ☒ MEDIUM-LARGE
4. ☐ LARGE
5. ☐ EXTRA LARGE

DISPOSAL AREA TYPE/SIZE
1. ☐ BED _____ Sq. Ft.
2. ☒ CHAMBER 612 Sq. Ft.
   ☐ REGULAR ☐ H-20
3. ☐ TRENCH _____ Linear Ft.
4. ☐ OTHER: _____

DESIGN FLOW: 360 (GALLONS/DAY)

SITE EVALUATOR STATEMENT

On 10/1/89 (date) I conducted a site evaluation for this project and certify that the data reported is accurate. The system I propose is in accordance with the Subsurface Wastewater Disposal Rules.

Site Evaluator Signature — SE# 260 — Date 10/8/89

(Local Plumbing Inspector's Signature if permit is for Seasonal Conversion.)

SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION

Department of Human Services
Division of Health Engineering

Town, City, Plantation: Augusta

Street, Road, Subdivision: Damn Pond Rd.

Owners Name: Wendy True

SITE PLAN

Scale 1" = 50 Ft.

SITE LOCATION PLAN (Attach Map from Maine Atlas for New System Variance)

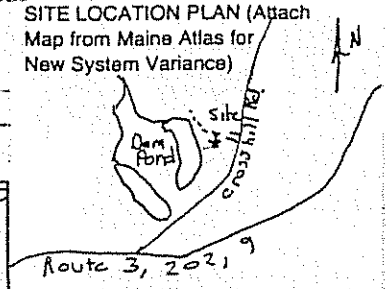

map 13

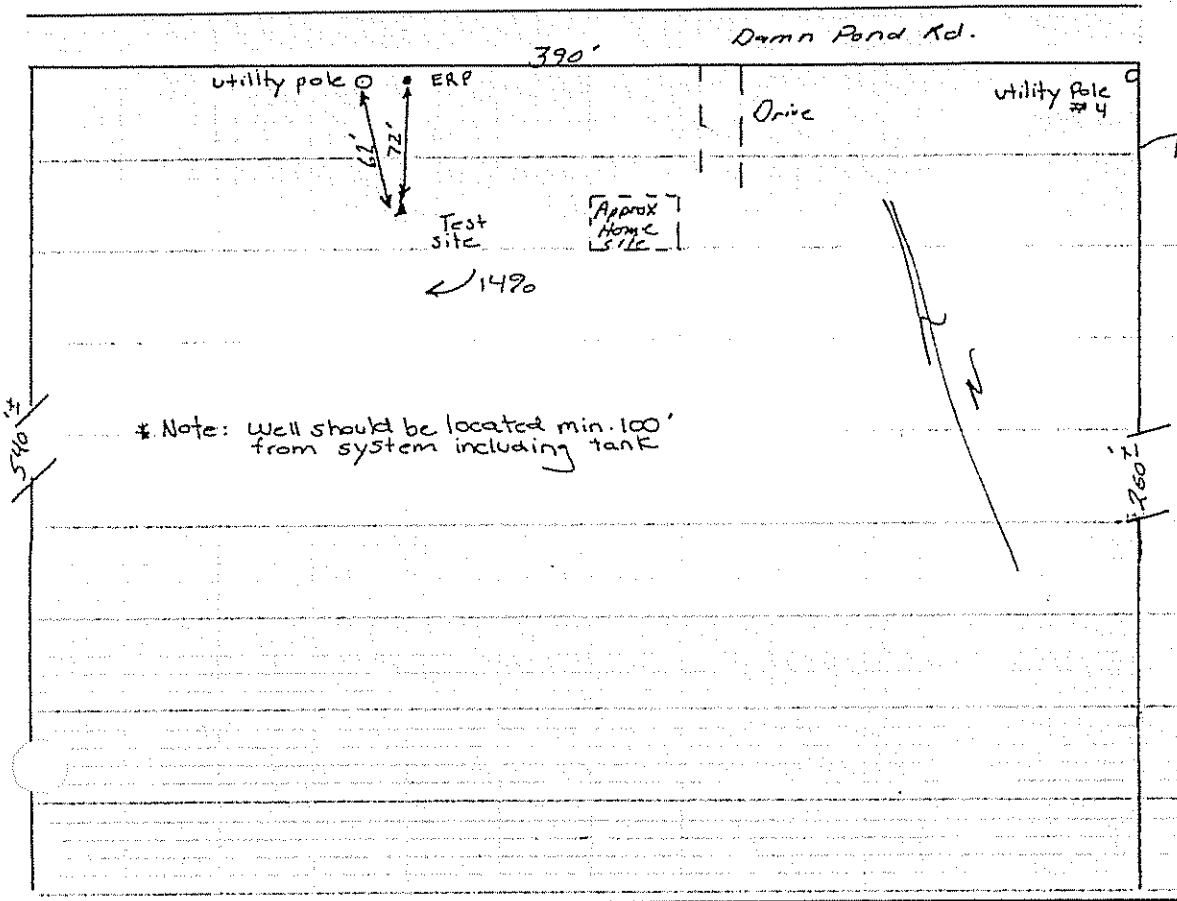

SOIL DESCRIPTION AND CLASSIFICATION (Location of Observation Holes Shown Above)

Observation Hole #1 ☒ Test Pit ☒ Boring

1" Depth of Organic Horizon Above Mineral Soil

DEPTH BELOW MINERAL SOIL SURFACE (Inches)

Depth	Texture	Consistency	Color	Mottling
0	Sandy	Friable		Free
6	Loam		yellow	
10			Brown	
15				
20				
30			light Brown	
40				
50				

Soil	Classification	Slope	Limiting Factor	
2 (Profile)	B (Condition)	14 %	—	☐ Ground Water ☐ Restrictive Layer ☐ Bedrock

Observation Hole _____ ☐ Test Pit ☐ Boring

_____" Depth of Organic Horizon Above Mineral Soil

DEPTH BELOW MINERAL SOIL SURFACE (Inches)

Depth	Texture	Consistency	Color	Mottling
0				
6				
10				
15				
20				
30				
40				
50				

Soil	Classification	Slope	Limiting Factor	
(Profile)	(Condition)	%		☐ Ground Water ☐ Restrictive Layer ☐ Bedrock

Robin Knapp
Site Evaluator Signature

260
SE#

10/8/89
Date

HHE-200 Rev. 1/84

SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION

Department of Human Services
Division of Health Engineering

Town, City, Plantation	Street, Road, Subdivision	Owners Name
Augusta	Damn Pond Rd.	Wendy True

SUBSURFACE WASTEWATER DISPOSAL PLAN

Scale 1" = 20 Ft.

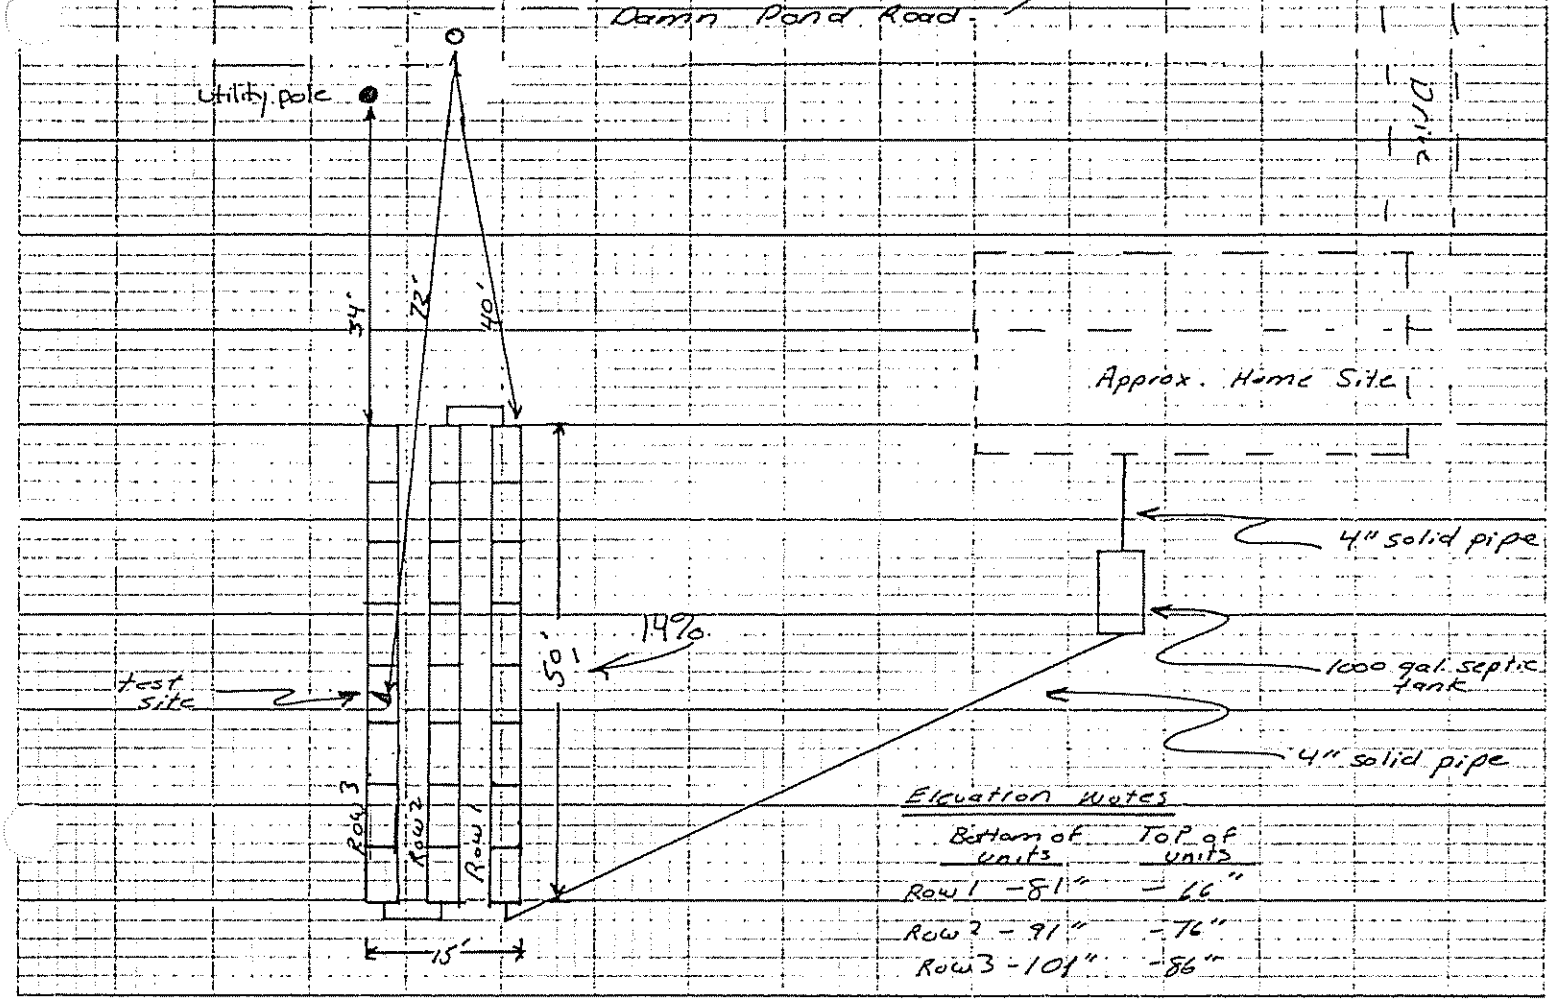

Elevation Notes

	Bottom of units	Top of units
Row 1	-81"	-66"
Row 2	-91"	-76"
Row 3	-101"	-86"

FILL REQUIREMENTS

Depth of Fill (Upslope) 0 '

Depth of Fill (Downslope) 0 '

CONSTRUCTION ELEVATIONS

Reference Elevation is 0.00 (see above notes)

Bottom of Disposal Area

Top of Distribution Lines or Chambers

ELEVATION REFERENCE POINT LOCATION & DESCRIPTION

ERP oak 5' 4" up. Flagged nail 72' from TP 40' From Topcorner

DISPOSAL AREA CROSS SECTION

Scale:

Vertical: 1 inch = 5 Ft.

Horizontal: 1 inch = 5 Ft.

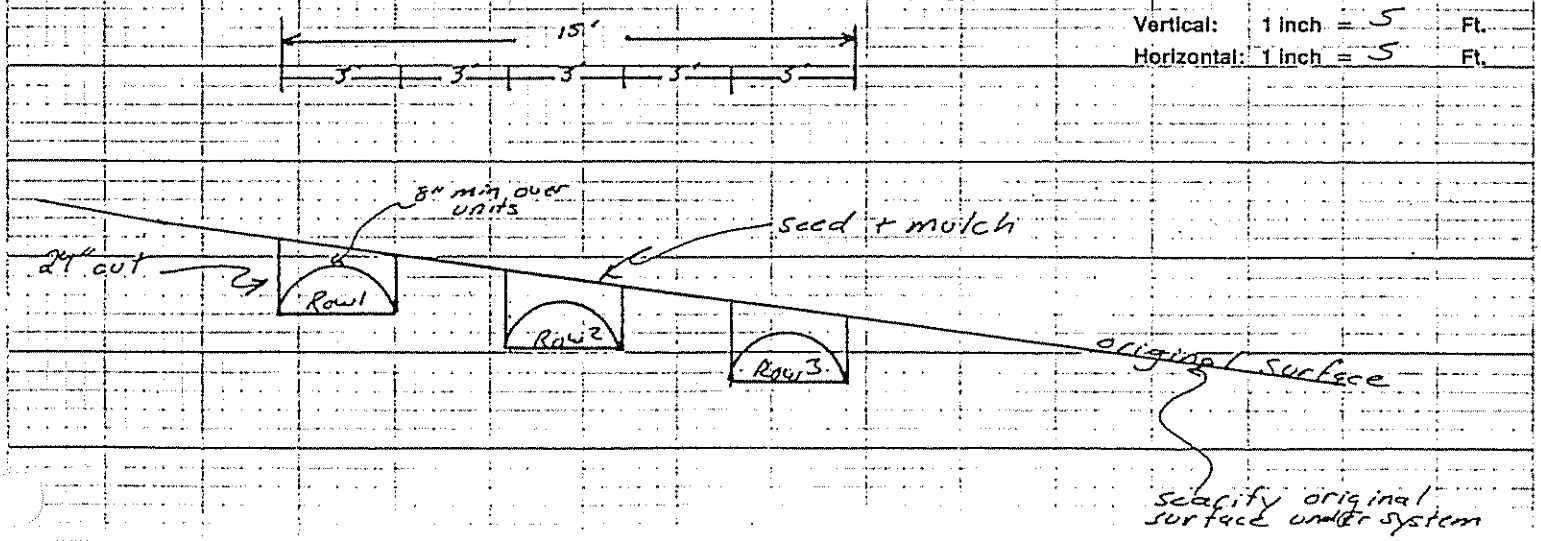

Site Evaluator Signature

SE# 260

Date 10/8/89

Corinne Knapp
P.O. Box 335
Newport, Me. 04953

Ms. Wendy True
RFD 6 Crosshill Road
Augusta, Me. 04330

October 12, 1989

Dear Wendy;

On October 1, 1989 I conducted a site evaluation on Property Located off the Crosshill Road on the Dam Pond Road in Augusta. The site was satisfactory for on-site septic sewage disposal. I have designed a 24 unit infiltrator system which I feel best fits the landscape and slope conditions.

Enclosed please find three copies of the Subsurface wastewater Disposal Application. You should sign all three copies and present them to the Local Plumbing Inspector for the Town of Augusta, who may then issue a permit good for up to two years.

The contractor or installer is responsible for the proper installation of the system which shall be in accordance with The Maine Subsurface Wastewater Disposal Rules. Property lines should be verified by the owner prior to construction. For the best results the tank should be pumped every 2-3 years under normal use.

Sincerely,

Corinne S. Knapp
SE # 260