Dostie, Gerard

SUBMIT THE FOLLOWING COMPLETED FORM TO YOUR LOCAL PLUMBING INSPECTOR

DATE 4-27-73	OWNER Gerard Dostie
NUMBER OF BEDROOMS 2	STREET Wade Road
SIZE OF SEPTIC TANK 1000 Gal	CITY Augusta MAINE
TYPE OF SOIL Suffield Silty Loam	TEL. NUMBER 24150
Test Performed by [signature] PE #1576	LOCATION OF PROPOSED INSTALLATION
Local Plumbing Inspector's Signature George L. Smith	STREET Mt Vernon Road
	CITY Augusta MAINE
	TEL. NUMBER —

SKETCH: LOCATION OF BUILDING DISPOSAL SYSTEM, TERRAIN FEATURES, PERCOLATION HOLES, WATER SUPPLIES, ETC.

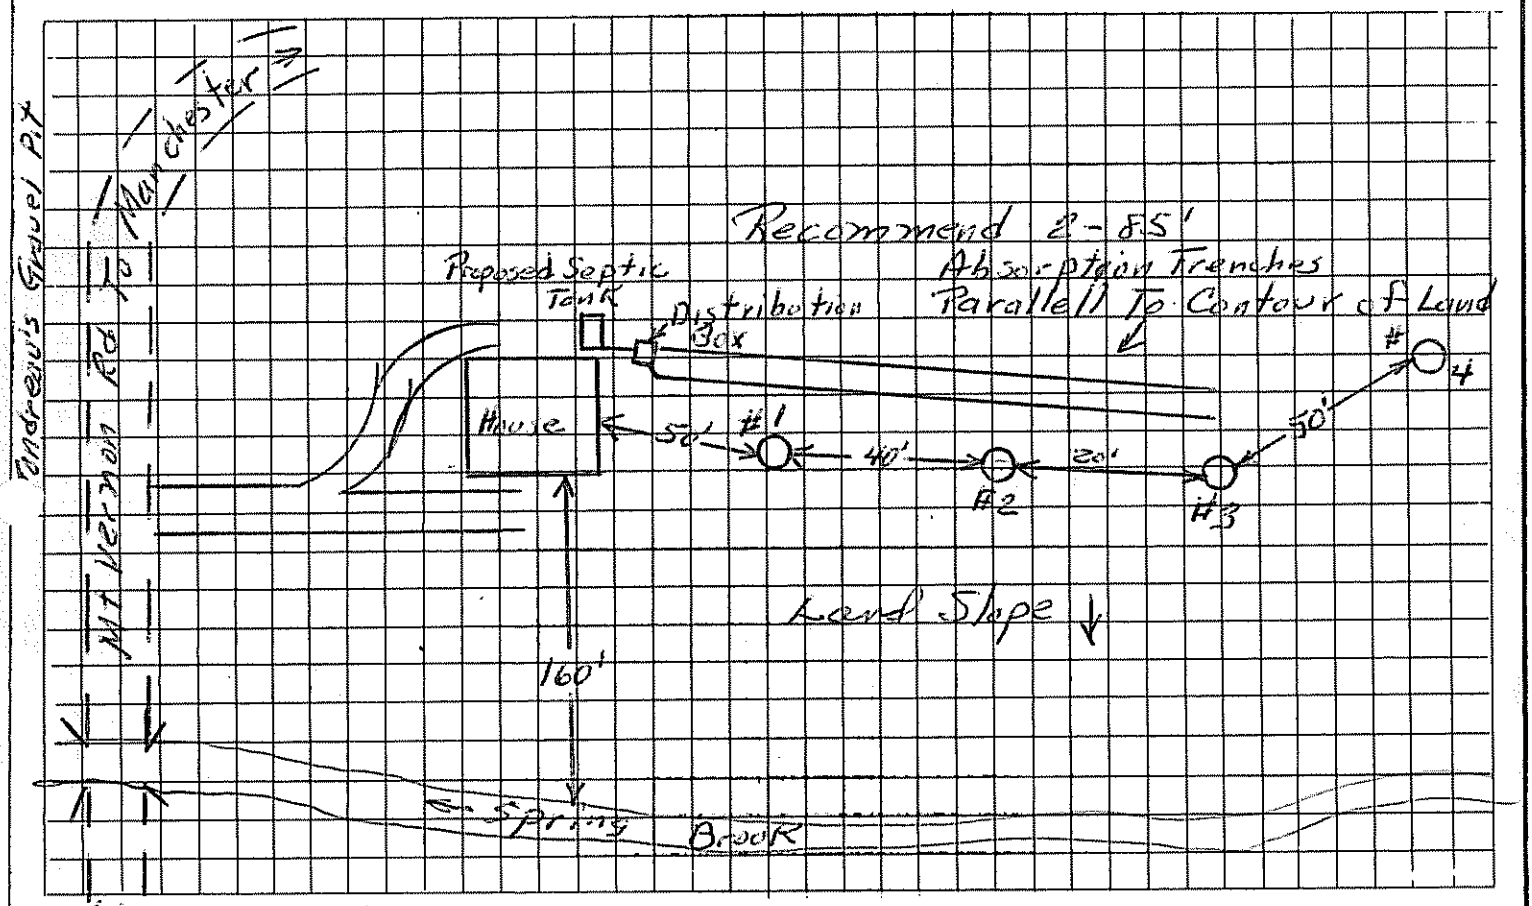

5'+ Depth to Water Table
5'+ Depth to Bedrock
4-6'± Depth to Clay or other impervious strata

REMARKS

HOLE	HOLE DEPTH	TIME		DEPTH OF WATER SURFACE		ELAPSED TIME	TOTAL DROP OF WATER	PERCOL. RATE MINUTES/INCH
		START	FINISH	START	FINISH			
#1	36" in.	4:52	6:15	24 in.	29 in.	83 min.	5 in.	16½ min/in
#2	36" in.	4:53	6:17	28½ in.	31½ in.	84 min.	2 in.	42 min/in
#3	36" in.	4:54	6:18	24½ in.	28½ in.	84 min.	4 in.	21 min/in
#4	36" in.	4:55	6:19	20½ in.	22½ in.	84 min.	2 in.	42 min/in
						AVERAGE RATE		30 min/in