Dostie, Raymond

# SUBMIT THE FOLLOWING COMPLETED FORM TO YOUR LOCAL PLUMBING INSPECTOR

DATE August 24, 1972
NUMBER OF BEDROOMS
SIZE OF SEPTIC TANK
TYPE OF SOIL Fine Sandy loam

Test Performed by [signature]
W. B. Lovett Jr. L.S. # 41 P.E. 1576

Local Plumbing Inspector's Signature
C. J. Morton

OWNER Raymond Dostie
STREET R # 4
CITY Augusta MAINE
TEL. NUMBER 622-2575

LOCATION OF PROPOSED INSTALLATION
STREET Eight Rod Road
CITY Augusta MAINE
TEL. NUMBER --------

SKETCH: LOCATION OF BUILDING DISPOSAL SYSTEM, TERRAIN FEATURES, PERCOLATION HOLES, WATER SUPPLIES, ETC.

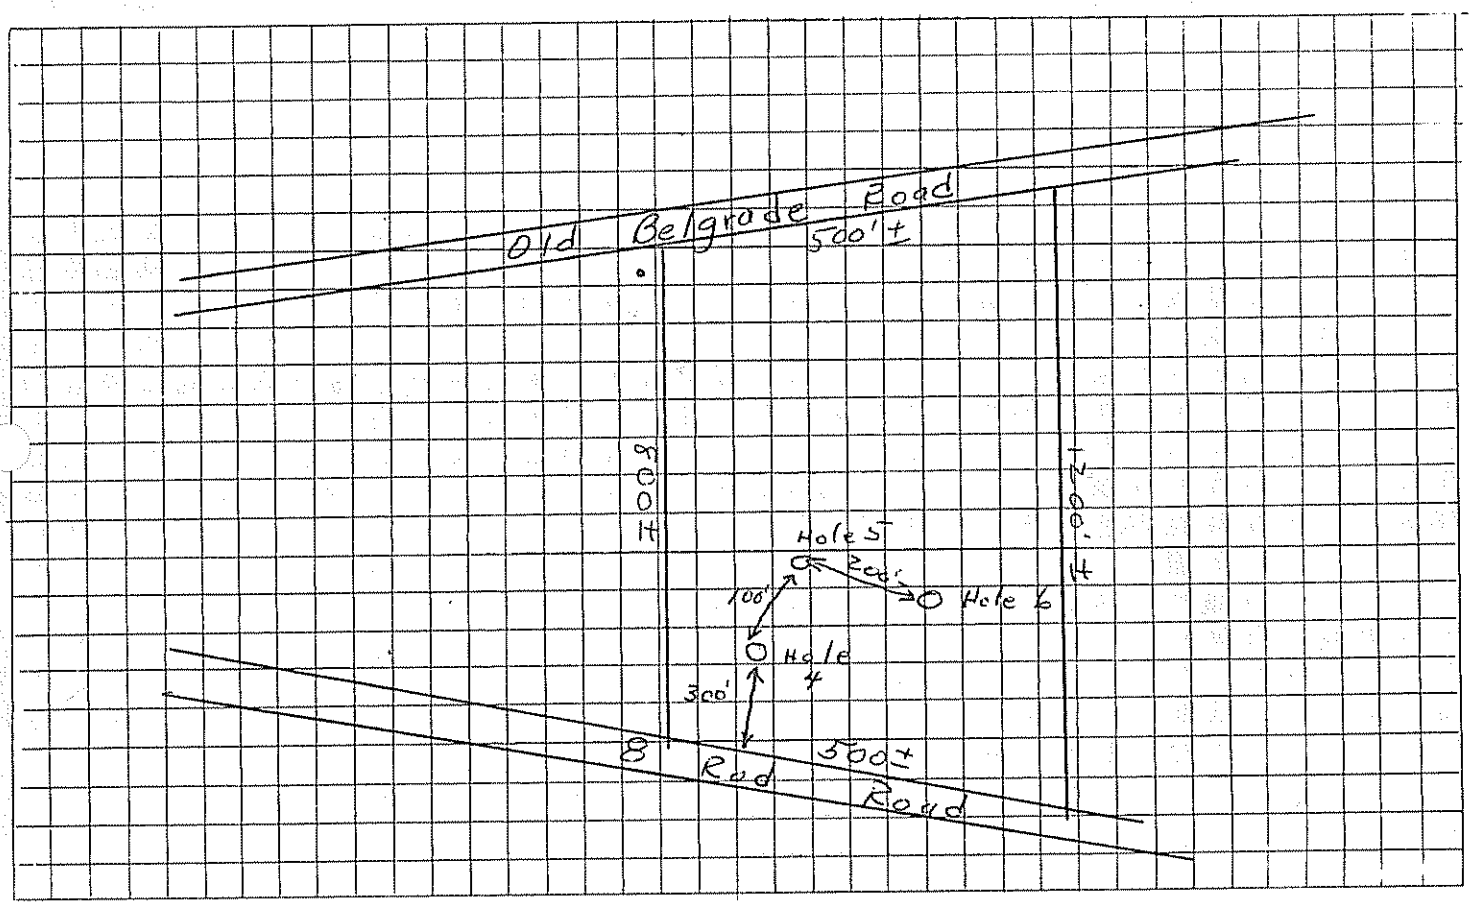


_____ Depth to Water Table
_____ Depth to Bedrock
_____ Depth to Clay or other impervious strata

REMARKS

| HOLE | HOLE DEPTH | TIME | | DEPTH OF WATER SURFACE | | ELAPSED TIME | TOTAL DROP OF WATER | PERCOL. RATE MINUTES/INCH |
|---|---|---|---|---|---|---|---|---|
| | | START | FINISH | START | FINISH | | | |
| #1 | 30 in. | 7:38 | 7:44 | 11½ in. | 13½ in. | 6 min. | 2 in. | 3 min/in |
| #2 | 30 in. | 7:43 | 7:49 | 11 in. | 14 in. | 6 min. | 3 in. | 2 min/in |
| #3 | 30 in. | 7:45 | 7:51 | 6 in. | 8 in. | 6 min. | 2 in. | 3 min/in |
| #4 | in. | | | in. | in. | min. | in. | min/in |
| | | | | | | AVERAGE RATE | | 2.7 min/in |