

006 L7B

# SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION

04046157

**PROPERTY ADDRESS**

Town Or Plantation: **Augusta**

Street: **80 Eight Rd. Rd.**

**PROPERTY OWNER'S NAME**

Last: **Mike Bonenfant** First: **Mike**

Applicant Name: **SAME**

Mailing Address of Owner/Applicant (if Different): **8 RD., RD. AUGUSTA, ME. 04330**

AUGUSTA 3431 TOWN COPY

Date Permit Issued: **4.17.96** \$ **60.00** FEE  Double Fee Charged

*Yvonne R. Fuller* L.P.I. # **850**

Local Plumbing Inspector Signature

*Rmpt insp 4/20/96 GPF*

### OWNER/APPLICANT STATEMENT

I certify that the information submitted is correct to the best of my knowledge and understand that any falsification is reason for the Local Plumbing Inspector to deny a Permit.

*Mike Bonenfant* **4/16/96**

Signature of Owner/Applicant Date

### CAUTION: INSPECTION REQUIRED

I have inspected the installation authorized above and found it to be in compliance with the Subsurface Wastewater Disposal Rules.

Local Plumbing Inspector Signature Date Approved

### PERMIT INFORMATION

**THIS APPLICATION IS FOR:**

1.  NEW SYSTEM

2.  REPLACEMENT SYSTEM

3.  EXPANDED SYSTEM

4.  EXPERIMENTAL SYSTEM

**SEASONAL CONVERSION**  
to be completed by the LPI

5.  SYSTEM COMPLIES WITH RULES

6.  CONNECTED TO SANITARY SEWER

7.  SYSTEM INSTALLED - P# \_\_\_\_\_

8.  SYSTEM DESIGN RECORDED AND ATTACHED

**IF REPLACEMENT SYSTEM:**

YEAR FAILING SYSTEM INSTALLED \_\_\_\_\_

THE FAILING SYSTEM IS

1.  BED 3.  TRENCH

2.  CHAMBER 4.  OTHER \_\_\_\_\_

SIZE OF PROPERTY: **4± AC.** ZONING: **RURAL**

**THIS APPLICATION REQUIRES:**

1.  NO RULE VARIANCE

2.  NEW SYSTEM VARIANCE  
Attach New System Variance Form

3.  REPLACEMENT SYSTEM VARIANCE  
Attach Replacement System Variance Form

a.  Requires Local Plumbing Inspector Approval

b.  Requires State and Local Plumbing Inspector Approval

4.  MINIMUM LOT SIZE VARIANCE

**DISPOSAL SYSTEM TO SERVE:**

1.  SINGLE FAMILY DWELLING

2.  MODULAR OR MOBILE HOME

3.  MULTIPLE FAMILY DWELLING

4.  OTHER \_\_\_\_\_ SPECIFY \_\_\_\_\_

**INSTALLATION IS:**

COMPLETE SYSTEM

1.  NON-ENGINEERED SYSTEM

2.  PRIMITIVE SYSTEM  
(Includes Alternative Toilet)

3.  ENGINEERED (+ 2000 gpd)

INDIVIDUALLY INSTALLED COMPONENTS

4.  TREATMENT TANK (ONLY)

5.  HOLDING TANK \_\_\_\_\_ GAL.

6.  ALTERNATIVE TOILET (ONLY)

7.  NON-ENGINEERED DISPOSAL AREA (ONLY)

8.  ENGINEERED DISPOSAL AREA (ONLY)

9.  SEPARATED LAUNDRY SYSTEM

**TYPE OF WATER SUPPLY**

**PRIVATE**

### DESIGN DETAILS (SYSTEM LAYOUT SHOWN ON PAGE 3)

**TREATMENT TANK**

1.  SEPTIC:  Regular  Low Profile

2.  AEROBIC

SIZE **1000** GALS.

**WATER CONSERVATION**

1.  NONE

2.  LOW VOLUME TOILET

3.  SEPARATED LAUNDRY SYSTEM

4.  ALTERNATIVE TOILET

SPECIFY \_\_\_\_\_

**PUMPING**

1.  NOT REQUIRED

2.  MAY BE REQUIRED  
(DEPENDING ON TREATMENT TANK LOCATION & ELEVATION)

3.  REQUIRED  
DOSE: **50** GALS.

**CRITERIA USED FOR DESIGN FLOW (BEDROOMS, SEATING EMPLOYEES, WATER RECORDS, ETC.)**

**1-1 BEDROOM AT 120 GPD**

**SOIL CONDITIONS USED FOR DESIGN PURPOSES**

PROFILE: **3** CONDITION: **0**

DEPTH TO LIMITING FACTOR: **12** "

**SIZE RATINGS USED FOR DESIGN PURPOSES**

1.  SMALL

2.  MEDIUM

3.  MEDIUM-LARGE

4.  LARGE

5.  EXTRA-LARGE

**DISPOSAL AREA TYPE/SIZE**

1.  BED **1000** Sq. Ft.

2.  CHAMBER \_\_\_\_\_ Sq. Ft.

REGULAR  H-20

3.  TRENCH \_\_\_\_\_ Linear Ft.

4.  OTHER: \_\_\_\_\_

**1-2 BEDROOM AT 180 G.P.D.**

DESIGN FLOW: **300 G.P.D.**  
(GALLONS/DAY)

### SITE EVALUATOR STATEMENT

On **4/13/96** (date) I conducted a site evaluation for this project and certify that the data reported is accurate. The system I propose is in accordance with the Subsurface Wastewater Disposal Rules.

*John A. Philbrick*

John A. Philbrick, Licensed Site Evaluator

256 SE#

**4/4/96**  
Date

Approved for use as HHE 200 by Division of Health Engineering 9/87

# SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION

04046157

Town, City, Plantation

Street, Road, Subdivision

Owner's Name

Augusta



Eight Rd. Rd.

Bonenfant, Mike

## SITE PLAN

Scale: 1" = 50' Ft.  
or as shown

SITE LOCATION PLAN  
(Attach Map from Maine Atlas for New System Variance)

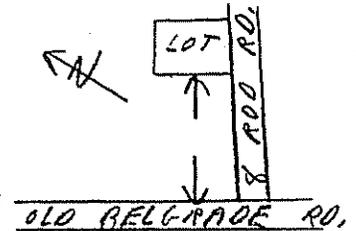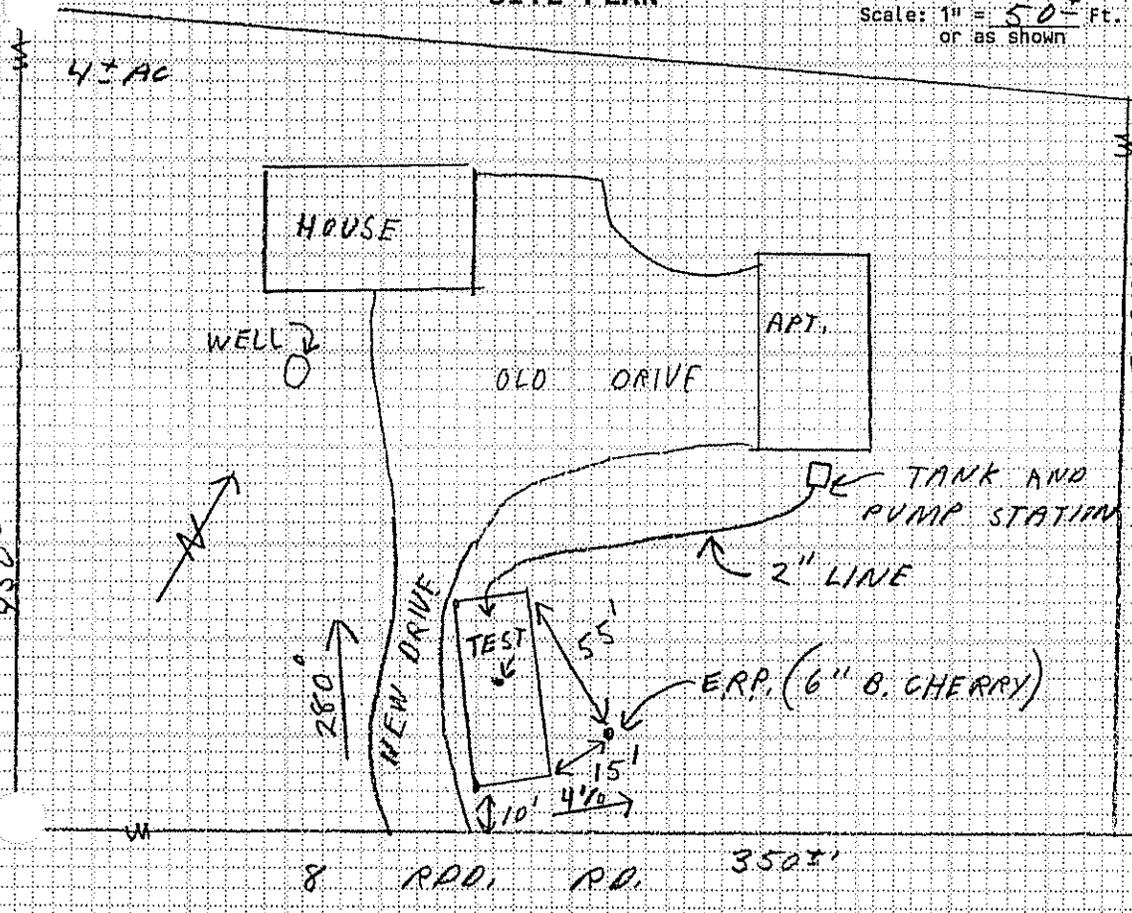

20' x 50' BED  
FLAGS MARK  
CORNERS

## SOIL DESCRIPTION AND CLASSIFICATION

(Location of Observation Holes Shown Above)

Observation Hole 1  Test Pit  Boring  
1 1/2 " Depth of Organic Horizon Above Mineral Soil

Inches	Texture	Consistency	Color	Mottling
0	FINE SANDY	FRIBLE	DARK BR.	NONE
6	LOAM		YELLOW BR.	
10			BR.	
15	FINE	FIRM	GRAY	COMMON
20	LOAMY SAND			DISTINCT
30				
40				
50				

Soil Classification: 3 Profile, 0 Condition  
 Slope: 4 %  
 Limiting Factor: 12"  
 Ground Water  
 Restr. Layer  
 Bedrock

Observation Hole \_\_\_\_\_  Test Pit  Boring  
 \_\_\_\_\_ " Depth of Organic Horizon Above Mineral Soil

Inches	Texture	Consistency	Color	Mottling
0				
6				
10				
15				
20				
30				
40				
50				

Soil Classification: \_\_\_\_\_ Profile, \_\_\_\_\_ Condition  
 Slope: \_\_\_\_\_ %  
 Limiting Factor: \_\_\_\_\_"  
 Ground Water  
 Restr. Layer  
 Bedrock

Site Evaluator Signature

256 SE#

4/4/96 Date

Approved for use as HHE 200 by Division of Health Engineering 9/87

