BICKFORD, ARCHIE

SUBMIT THE FOLLOWING COMPLETED FORM TO YOUR LOCAL PLUMBING INSPECTOR

DATE 7/2/73 NUMBER OF BEDROOMS SIZE OF SEPTIC TANK TYPE OF SOIL Gravelly Sandy loam	OWNER Archie Bickford STREET 35 Oak ST CITY Augusta MAINE TEL. NUMBER 22214
Test Performed by [signature] PE #1576 Local Plumbing Inspector's Signature George J. Smith	LOCATION OF PROPOSED INSTALLATION STREET West River Road & Patrick ST CITY Augusta MAINE TEL. NUMBER —

SKETCH: LOCATION OF BUILDING DISPOSAL SYSTEM, TERRAIN FEATURES, PERCOLATION HOLES, WATER SUPPLIES, ETC.

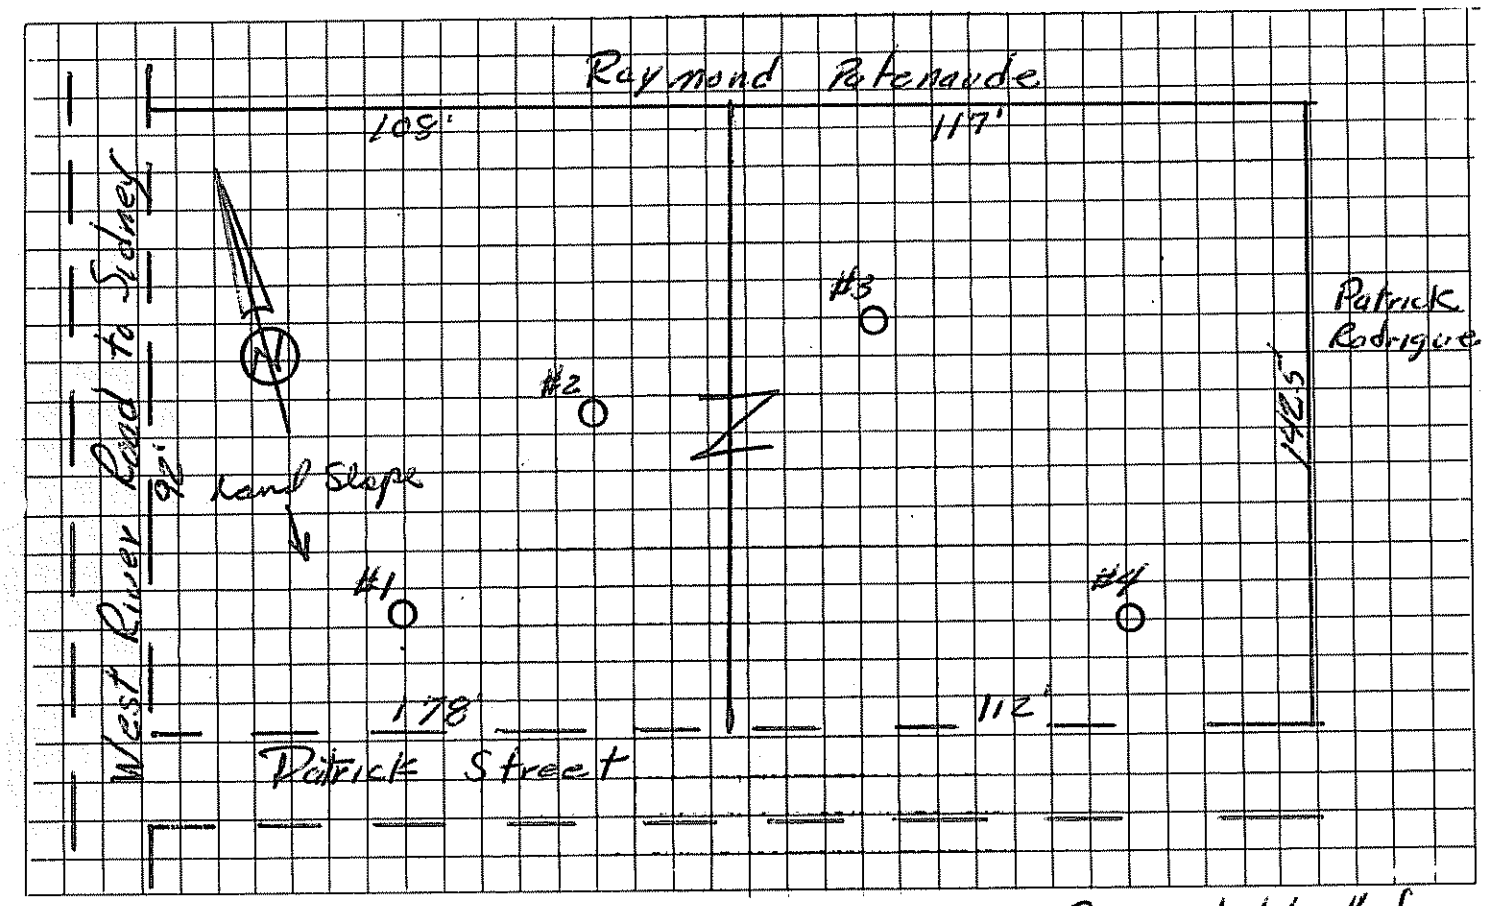

5'+ Depth to Water Table
5'+ Depth to Bedrock
5'+ Depth to Clay or other impervious strata

REMARKS Recomended length of Absorption Trenches as follows:
2 Bedroom 100'
3 Bedroom 150'
4 Bedroom 200'
(Keep 100' away from Rodrigue Well)

HOLE	HOLE DEPTH	TIME START	TIME FINISH	DEPTH OF WATER SURFACE START	DEPTH OF WATER SURFACE FINISH	ELAPSED TIME	TOTAL DROP OF WATER	PERCOL. RATE MINUTES/INCH
#1	36 in.	6:59	7:42	19 in.	28 in.	43 min.	9 in.	4.8 min/in
#2	36 in.	7:00	7:42	18 in.	29 in.	42 min.	11 in.	3.8 min/in
#3	36 in.	7:04	7:43	15 in.	17½ in.	39 min.	2½ in.	15.6 min/in
#4	36 in.	7:02	7:44	14 in.	20½ in.	42 min.	5½ in.	7.7 min/in
						AVERAGE RATE		8.0 min/in

BICKFORD, ARCHIE

SUBMIT THE FOLLOWING COMPLETED FORM TO YOUR LOCAL PLUMBING INSPECTOR

DATE 7/2/73	OWNER Archie Bickford
NUMBER OF BEDROOMS	STREET 35 Oak St
SIZE OF SEPTIC TANK	CITY Augusta MAINE
TYPE OF SOIL Gravelly Sandy Loam	TEL. NUMBER 22214
Test Performed by [signature] PE #1576	LOCATION OF PROPOSED INSTALLATION
Local Plumbing Inspector's Signature George A. Smith	STREET West River Road & Patrick St
	CITY Augusta MAINE
	TEL. NUMBER

SKETCH: LOCATION OF BUILDING DISPOSAL SYSTEM, TERRAIN FEATURES, PERCOLATION HOLES, WATER SUPPLIES, ETC.

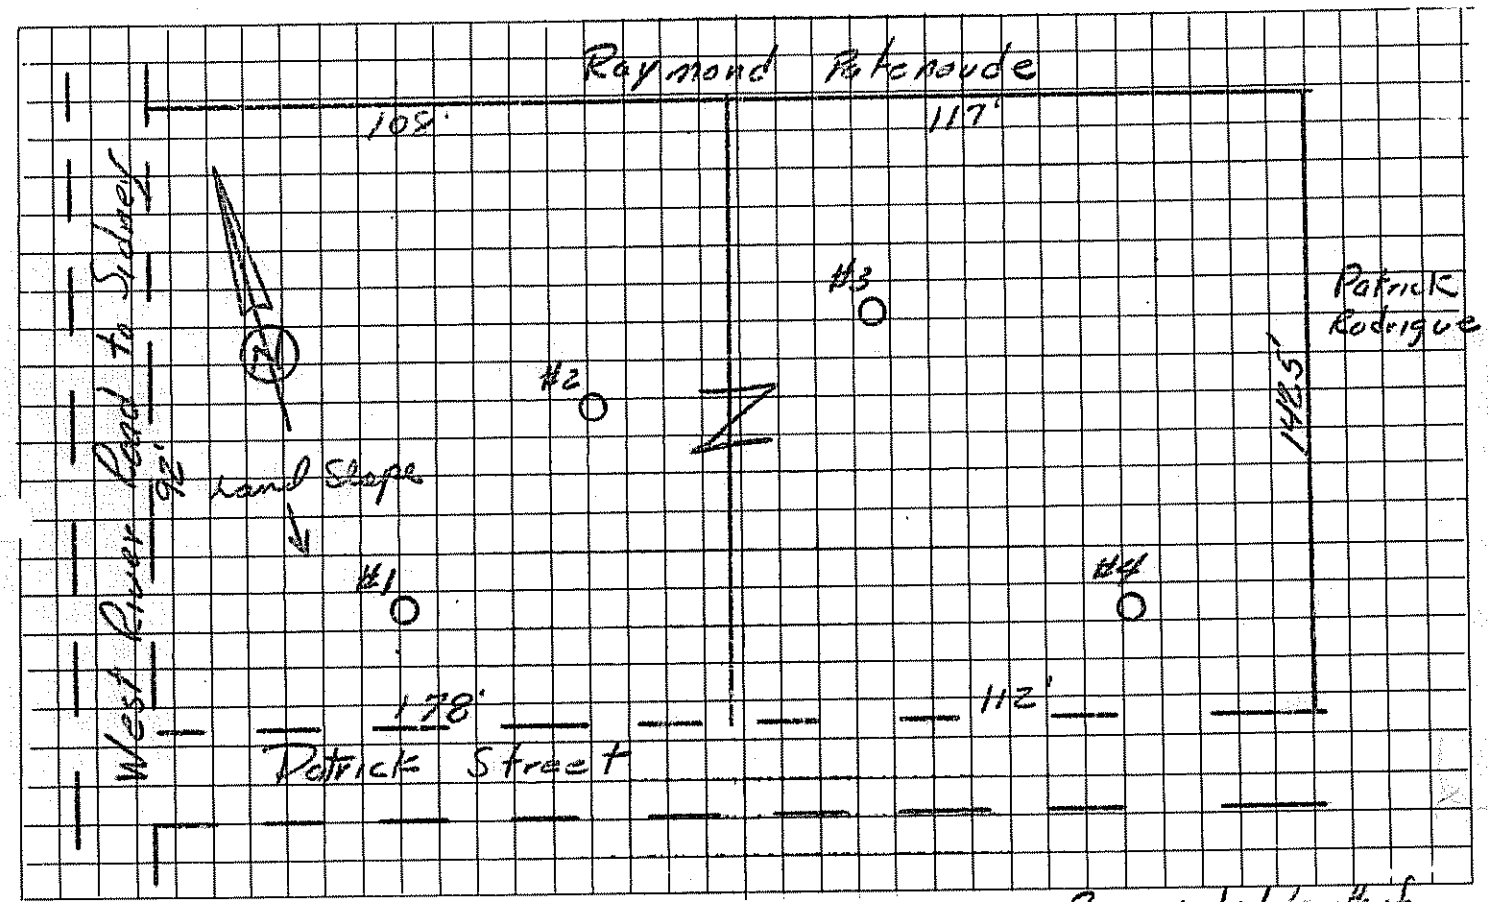

5'+ Depth to Water Table
5'+ Depth to Bedrock
5'+ Depth to Clay or other impervious strata

REMARKS Recomended length of Absorption Trenches as follows:
2 Bedroom 100'
3 Bedroom 150'
4 Bedroom 200'
(Keep 100' away from Rodrigue Well)

HOLE	HOLE DEPTH	TIME START	TIME FINISH	DEPTH OF WATER SURFACE START	DEPTH OF WATER SURFACE FINISH	ELAPSED TIME	TOTAL DROP OF WATER	PERCOL. RATE MINUTES/INCH
#1	36 in.	6:59	7:42	19 in.	28 in.	43 min.	9 in.	4.8 min/in
#2	36 in.	7:00	7:42	18 in.	29 in.	42 min.	11 in.	3.8 min/in
#3	36 in.	7:04	7:43	15 in.	17½ in.	39 min.	2½ in.	15.6 min/in
#4	36 in.	7:02	7:44	14 in.	20½ in.	42 min.	5½ in.	7.7 min/in
						AVERAGE RATE		8.0 min/in