BROCHU, GUY

# SUBMIT THE FOLLOWING COMPLETED FORM TO YOUR LOCAL PLUMBING INSPECTOR

DATE 5/3/74
NUMBER OF BEDROOMS 3
SIZE OF SEPTIC TANK 1000
TYPE OF SOIL Loam Pin gravel

Test Performed by
Rolfe's Plumbing

Local Plumbing Inspector's Signature
George L. Smith

OWNER Guy Brochu
STREET 638 Eastern Ave.
CITY Augusta MAINE
TEL. NUMBER 622-3263

LOCATION OF PROPOSED INSTALLATION
STREET Patrick St
CITY Augusta MAINE
TEL. NUMBER Same

SKETCH: LOCATION OF BUILDING DISPOSAL SYSTEM, TERRAIN FEATURES, PERCOLATION HOLES, WATER SUPPLIES, ETC.

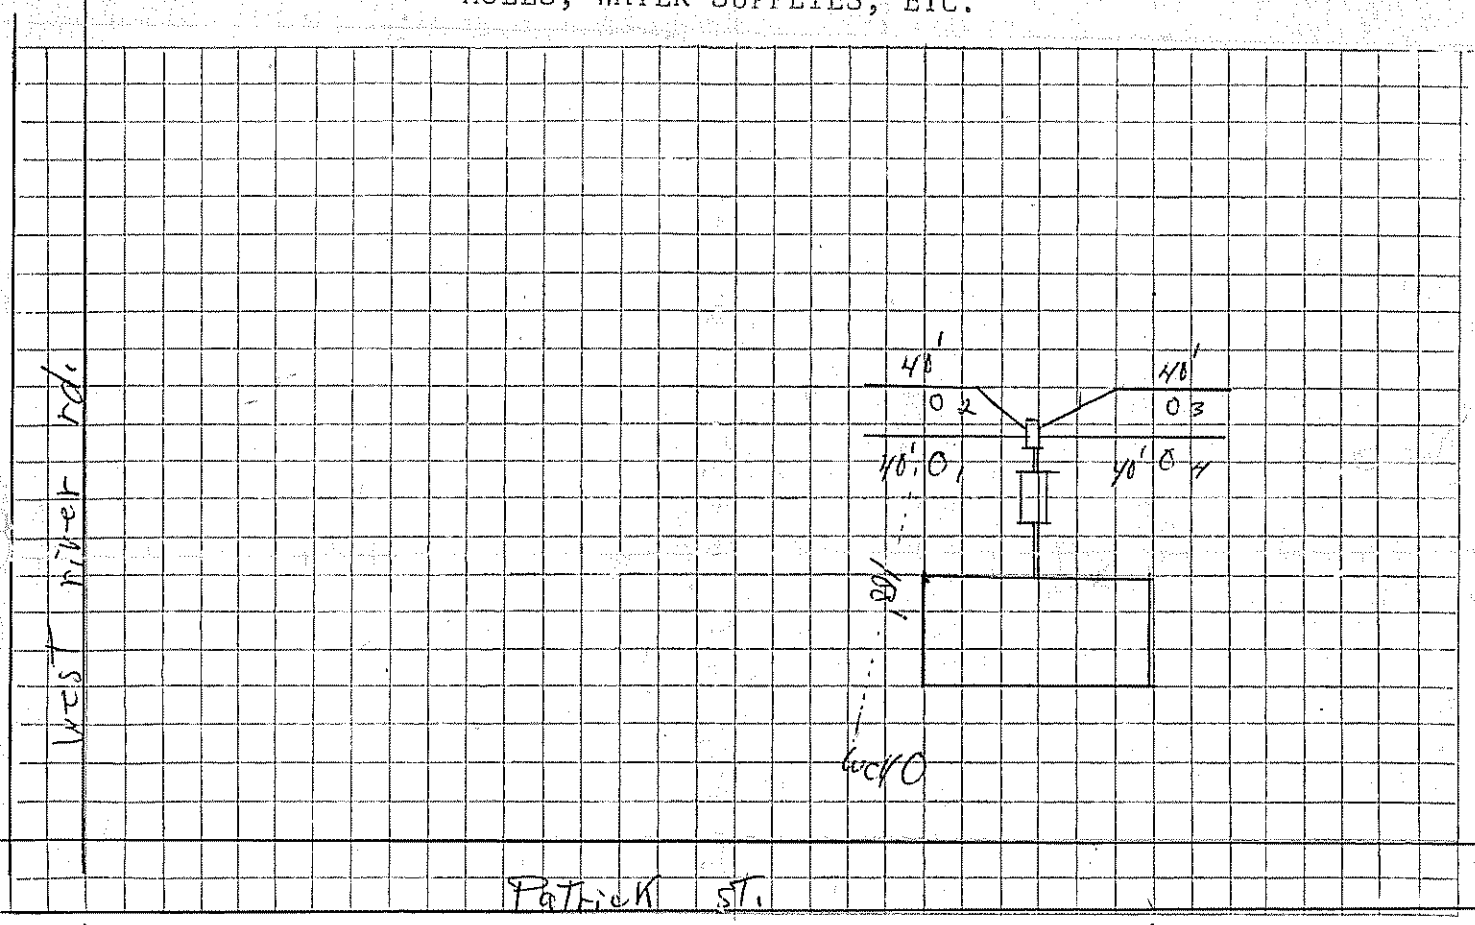


5ft Depth to Water Table
5ft Depth to Bedrock
5ft Depth to Clay or other impervious strata

REMARKS 180' Drain field
3/4x3 stone
or Chushed stone

| HOLE | HOLE DEPTH | TIME START | TIME FINISH | DEPTH OF WATER SURFACE START | DEPTH OF WATER SURFACE FINISH | ELAPSED TIME | TOTAL DROP OF WATER | PERCOL. RATE MINUTES/INCH |
|---|---|---|---|---|---|---|---|---|
| #1 | 36 in. | 3:00 | 4:00 | 32 in. | 30 in. | 60 min. | 2 in. | 30 min/in |
| #2 | 36 in. | 3:05 | 4:05 | 34 in. | 31 in. | 60 min. | 3 in. | 20 min/in |
| #3 | 36 in. | 3:10 | 4:10 | 34 in. | 30 in. | 60 min. | 4 in. | 15 min/in |
| #4 | 36 in. | 3:15 | 4:15 | 34 in. | 31 in. | 60 min. | 3 in. | 20 min/in |
| | | | | | | AVERAGE RATE | | 21+ min/in |