

# SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION

Department of Human Services  
Division of Health Engineering  
(207)289-3826

**PROPERTY ADDRESS**

Town Or Plantation: AUGUSTA

Street Division Lot #: CHURCH HILL RD.

**PROPERTY OWNERS NAME**

Last: HUTCHINS First: BRIAN

Applicant Name: \_\_\_\_\_

Mailing Address of Owner/Applicant (if Different): 101 ROSS RD  
KENNEBUNK ME 04043

1862 TOWN COPY

AUGUSTA

Subsurface Wastewater Disposal System

Date Permit Issued: 5/14/90 \$ 140.00  Double Fee Charged

May R. Lullo L.P.I. # 1850

Local Plumbing Inspector Signature

**Owner/Applicant Statement**

I certify that the information submitted is correct to the best of my knowledge and understand that any falsification is reason for the Local Plumbing Inspector to deny a Permit.

Brian G. Hutchins 05-04-90

Signature of Owner/Applicant Date

**Caution: Inspection Required**

I have inspected the installation authorized above and found it to be in compliance with the Subsurface Wastewater Disposal Rules.

May R. Lullo May 31, 1990

Local Plumbing Inspector Signature Date Approved

### PERMIT INFORMATION

**THIS APPLICATION IS FOR:**

- NEW SYSTEM
- REPLACEMENT SYSTEM
- EXPANDED SYSTEM
- EXPERIMENTAL SYSTEM

**THIS APPLICATION REQUIRES:**

- NO RULE VARIANCE
- NEW SYSTEM VARIANCE  
Attach New System Variance Form
- REPLACEMENT SYSTEM VARIANCE  
Attach Replacement System Variance Form
  - Requiring Local Plumbing Inspector Approval
  - Requires State and Local Plumbing Inspector Approval
- MINIMUM LOT SIZE VARIANCE

**INSTALLATION IS:**

COMPLETE SYSTEM

- NON-ENGINEERED SYSTEM
- PRIMITIVE SYSTEM  
(Includes Alternative Toilet)
- ENGINEERED (+ 2000 gpd)

**SEASONAL CONVERSION**  
to be completed by the LPI

- SYSTEM COMPLIES WITH RULES
- CONNECTED TO SANITARY SEWER
- SYSTEM INSTALLED - P# \_\_\_\_\_
- SYSTEM DESIGN RECORDED AND ATTACHED

**DISPOSAL SYSTEM TO SERVE:**

- SINGLE FAMILY DWELLING
- MODULAR OR MOBILE HOME
- MULTIPLE FAMILY DWELLING
- OTHER \_\_\_\_\_ SPECIFY \_\_\_\_\_

**INDIVIDUALLY INSTALLED COMPONENTS:**

- TREATMENT TANK (ONLY)
- HOLDING TANK \_\_\_\_\_ GAL
- ALTERNATIVE TOILET (ONLY)
- NON-ENGINEERED DISPOSAL AREA (ONLY)
- ENGINEERED DISPOSAL AREA (ONLY)
- SEPARATED LAUNDRY SYSTEM

**IF REPLACEMENT SYSTEM:**  
YEAR FAILING SYSTEM INSTALLED N/A

**THE FAILING SYSTEM IS:**

- BED
- CHAMBER
- TRENCH
- OTHER: \_\_\_\_\_

SIZE OF PROPERTY: 30+ ACRES

ZONING: RESIDENTIAL

**TYPE OF WATER SUPPLY**  
Proposed Drilled Well

### DESIGN DETAILS (SYSTEM LAYOUT SHOWN ON PAGE 3)

**TREATMENT TANK**

- SEPTIC:  Regular  Low Profile
- AEROBIC

SIZE: 1,000 GALS.

**WATER CONSERVATION**

- NONE
- LOW VOLUME TOILET
- SEPARATED LAUNDRY SYSTEM
- ALTERNATIVE TOILET

SPECIFY: \_\_\_\_\_

**PUMPING**

- NOT REQUIRED
- MAY BE REQUIRED  
(DEPENDENT ON TREATMENT TANK LOCATION AND ELEVATION)
- REQUIRED

DOSE: \_\_\_\_\_ GALS.

**CRITERIA USED FOR DESIGN FLOW (BEDROOMS, SEATING, EMPLOYEES, WATER RECORDS, ETC.)**

MOBILE HOME SITE  
3-SITE @ 225  
- 20% REDUCTION AS NO LAUNDRY  
180

DESIGN FLOW: 180 PER SITE  
(GALLONS/DAY)

**SOIL CONDITIONS USED FOR DESIGN PURPOSES**

PROFILE	CONDITION
<u>9</u>	<u>C</u>

DEPTH TO LIMITING FACTOR: 15

**SIZE RATINGS USED FOR DESIGN PURPOSES**

- SMALL
- MEDIUM
- MEDIUM-LARGE
- LARGE
- EXTRA LARGE

**DISPOSAL AREA TYPE/SIZE**

- BED \_\_\_\_\_ Sq. Ft.
- CHAMBER 450 Sq. Ft.  
 REGULAR  H-20
- TRENCH \_\_\_\_\_ Linear Ft.
- OTHER: \_\_\_\_\_

### SITE EVALUATOR STATEMENT

5-25-90 (date) I conducted a site evaluation for this project and certify that the data reported is accurate. The system I propose is in accordance with the Subsurface Wastewater Disposal Rules.

[Signature]  
Site Evaluator Signature  
(Local Plumbing Inspector's Signature if permit is for Seasonal Conversion.)

181  
SE#

5-2-90  
Date

Unit 522  
245 Stone Street

# SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION

Department of Human Services  
Division of Health Engineering

Town, City, Plantation

*AUGUSTA*

Street, Road, Subdivision

*CHURCH HILL RD.*


Owners Name

*B. HUTCHINS*

## SITE PLAN

Scale 1" = 560 Ft.

SITE LOCATION PLAN (Attach Map from Maine Atlas for New System Variance)

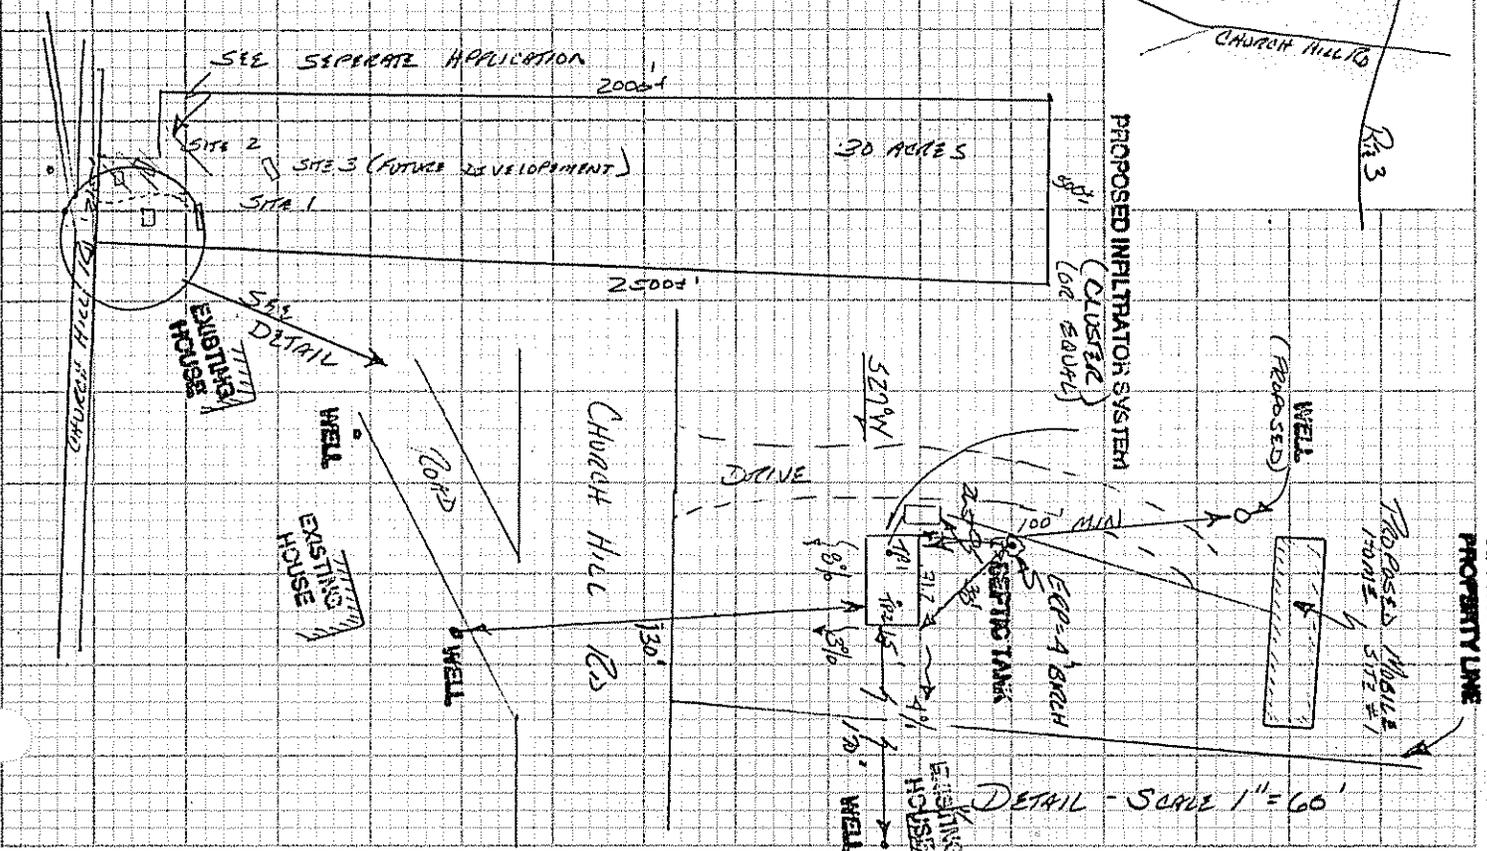

### SOIL DESCRIPTION AND CLASSIFICATION

(Location of Observation Holes Shown Above)

Observation Hole TP-1  Test Pit  Boring

N/A " Depth of Organic Horizon Above Mineral Soil

Texture	Consistency	Color	Mottling
LOAM	FRIABLE	BROWN	NONE
SILT LOAM			EVIDENT
		OLIVE BROWN	
SILTY CLAY	FIRM	OLIVE GRAY	FEW FAINT TO COMMON DISTINCT

Soil Profile <u>9</u>	Classification <u>C</u>	Slope <u>8</u> %	Limiting Factor <u>15</u>	<input checked="" type="checkbox"/> Ground Water
	Condition			<input type="checkbox"/> Restrictive Layer
				<input type="checkbox"/> Bedrock

Observation Hole TP-2  Test Pit  Boring

N/A " Depth of Organic Horizon Above Mineral Soil

Texture	Consistency	Color	Mottling
LOAM	FRIABLE	BROWN	NONE
SILT LOAM			EVIDENT
		OLIVE BROWN	
SILTY CLAY	FIRM	OLIVE GRAY	FEW FAINT TO COMMON DISTINCT

Soil Profile <u>9</u>	Classification <u>C</u>	Slope <u>3</u> %	Limiting Factor <u>15</u>	<input checked="" type="checkbox"/> Ground Water
	Condition			<input type="checkbox"/> Restrictive Layer
				<input type="checkbox"/> Bedrock


*Site Evaluator Signature*

181  
SE#


5-2-90  
Date

# SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION

Department of Human Services  
Division of Health Engineering

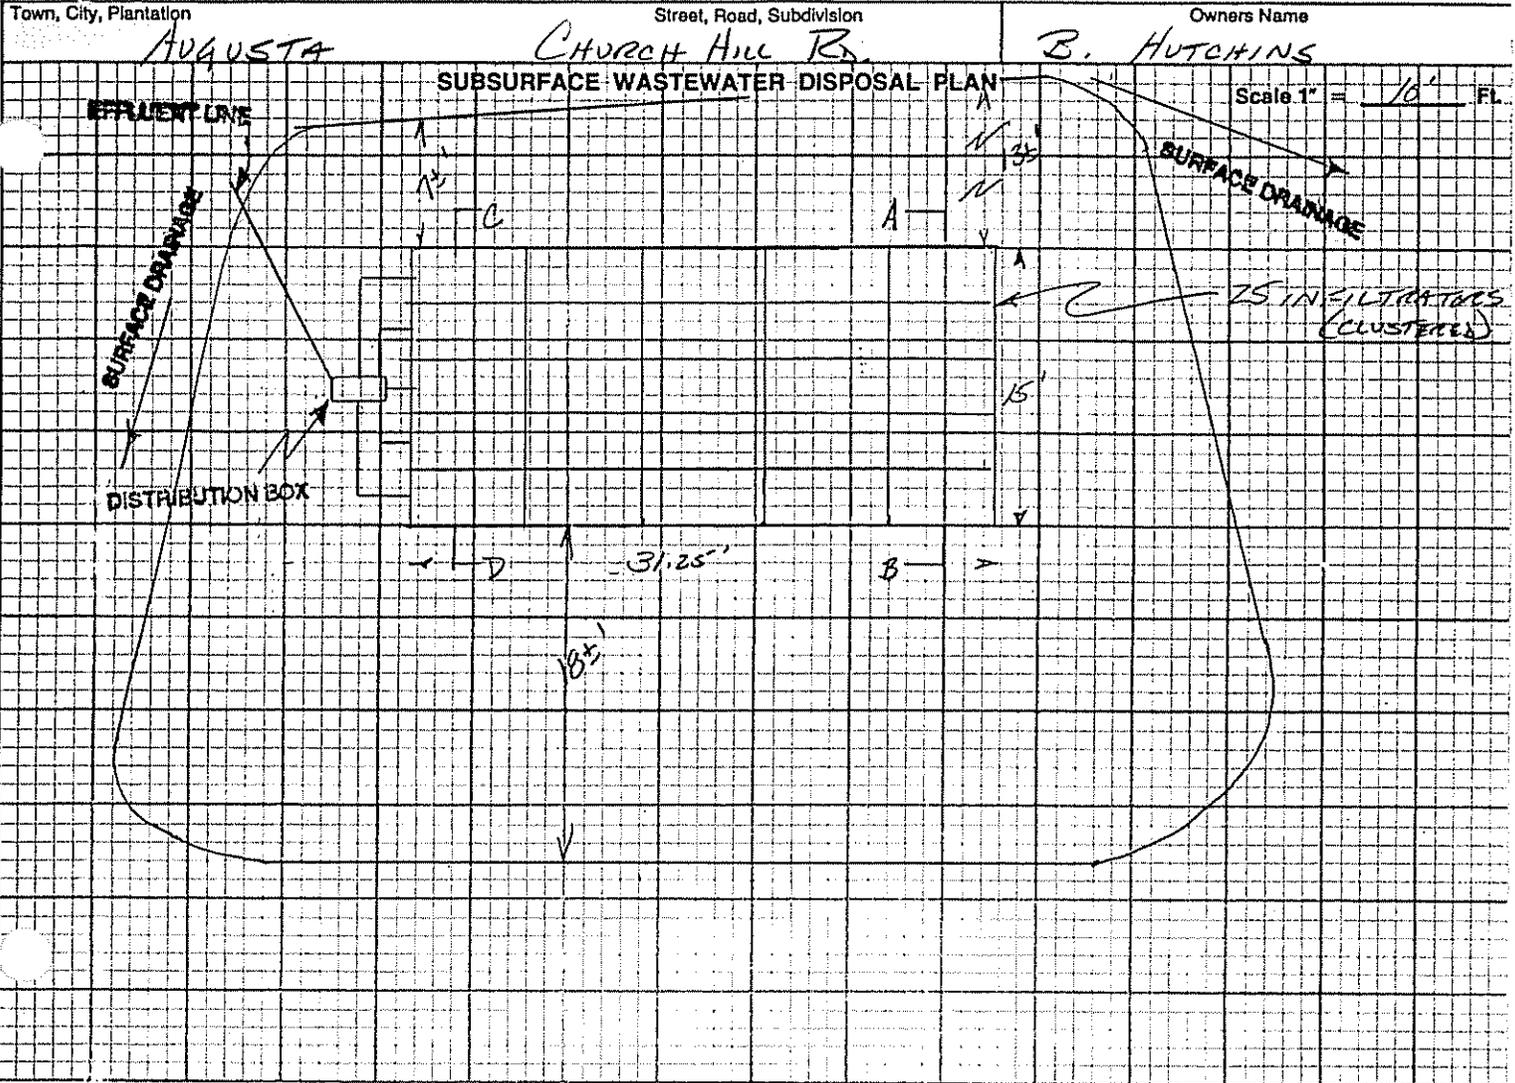

FILL REQUIREMENTS		CONSTRUCTION ELEVATIONS		ELEVATION REFERENCE POINT LOCATION & DESCRIPTION	
Depth of Fill (Upslope)	20-36"	Reference Elevation Is	00"	FLAGGED NAIL IN 4" BIRCH TREE 29" ABOVE EXISTING GRADE	
Depth of Fill (Downslope)	34-40"	Bottom of Disposal Area	-49"		
		Top of Distribution Lines or Chambers	-34"		

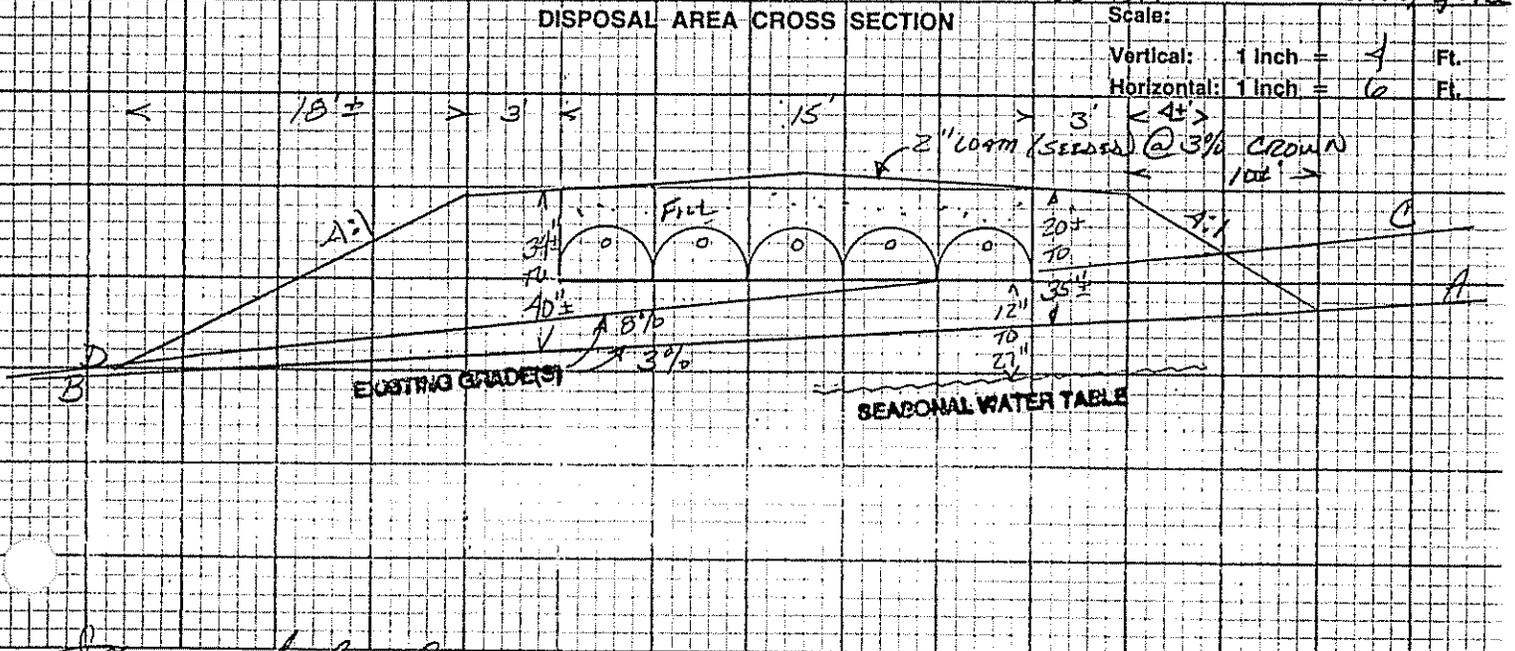

*[Signature]*  
Site Evaluator Signature

181  
SE#

5-2-90  
Date

NOTES

1. All constructions shall conform to "State of Maine - Subsurface Wastewater Disposal Rules-Chapter 241" latest revision.
2. All fill shall be sandy loam or coarser, with sufficient fines for adequate compaction.
3. Wells shall be located a minimum of 100' from subsurface disposal systems. Systems shall be a minimum of 20' from any structure.
4. Property lines shown are as provided by owner and no guarantee of accuracy is implied. Actual property lines must be confirmed by survey.
5. A septic tank outlet filter is recommended when installing a mechanical garbage disposal.
6. Pump stations, when required, shall be installed watertight to prevent the infiltration of ground and/or surface water. Pumps shall be installed to manufacturers recommendations and sized for actual installed T.D.H.. For uninterrupted service during maintenance or repair, duplex pump systems are required.
7. Force mains and pressure lines shall be flushed of foreign material and pumps shall be checked for proper on/off cycle before being put into service.
8. Applicability of design must be re-evaluated when location of structures are substantially different than those shown on the site plan, or when other structures, additions or appurtenances (I.E. Swimming pools) are considered.
9. Systems put into service prior to establishing proper cover shall be provided with adequate erosion control to prevent damage to the system.
10. Provide low profile septic tank when determined as necessary in the field. Septic tanks may be field located a minimum of 8' from any buildings.
11. A "Minimum Lot Size Variance" is required for any lot less than 20,000 square feet in area (unless grandfathered).
12. Force Mains, Pump Stations, and/or gravity piping subject to freezing shall be adequately insulated.
13. The LPI shall inform the owner and designer of any local ordinance exceeding the rules (Chapt-241) prior to issuing a permit, so that the application may be properly amended to conform to such ordinance.
14. All designs are subject to review by local, State, or Federal authority. Designers liability shall be limited to revisions required by regulatory agency.