Archie Bickford
Rowe, Maynard

SUBMIT THE FOLLOWING COMPLETED FORM TO YOUR LOCAL PLUMBING INSPECTOR

DATE 11-27-72	OWNER Maynard Rowe
NUMBER OF BEDROOMS 2	STREET Bolton Hill Rd
SIZE OF SEPTIC TANK 1000	CITY Augusta MAINE
TYPE OF SOIL Stony Fine Sandy Loam	TEL. NUMBER
Test Performed by Walter B Lovell RE # 1576	LOCATION OF PROPOSED INSTALLATION
Local Plumbing Inspector's Signature C. J. Morton	STREET Bolton Hill Rd.
	CITY Augusta MAINE
	TEL. NUMBER

SKETCH: LOCATION OF BUILDING DISPOSAL SYSTEM, TERRAIN FEATURES, PERCOLATION HOLES, WATER SUPPLIES, ETC.

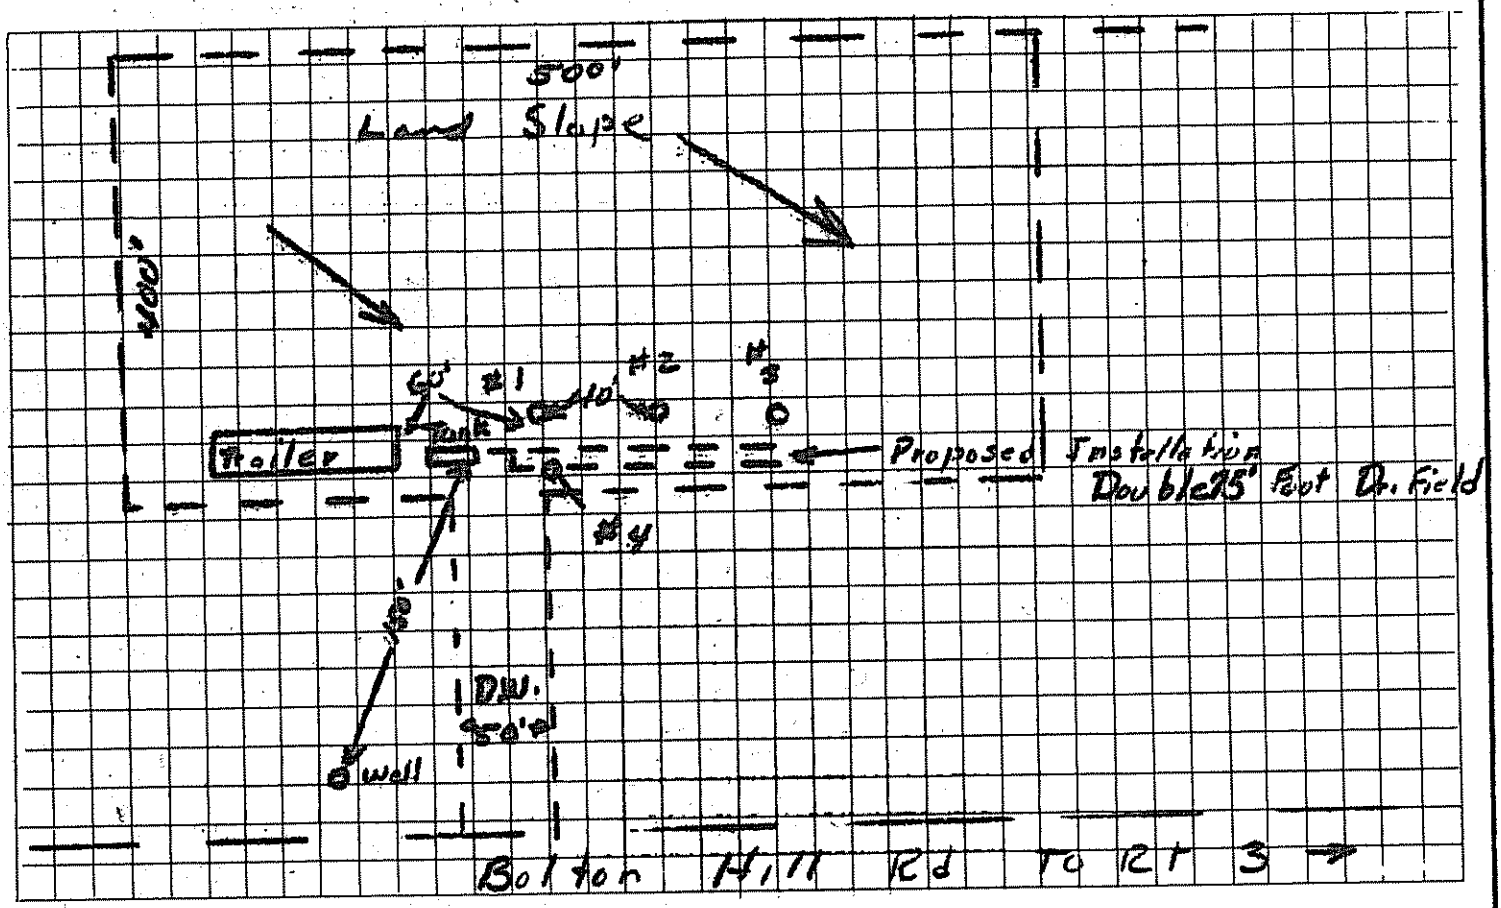

5' None Depth to Water Table
6' None Depth to Bedrock
Over 5' Depth to Clay or other impervious strata

REMARKS

HOLE	HOLE DEPTH	TIME START	TIME FINISH	DEPTH OF WATER SURFACE START	DEPTH OF WATER SURFACE FINISH	ELAPSED TIME	TOTAL DROP OF WATER	PERCOL. RATE MINUTES/INCH
#1	36 in.	3:18	4:40	22 in.	25 in.	82 min.	3 in.	27 min/in
#2	36 in.	3:20	4:41	24 in.	28 in.	81 min.	4 in.	20 min/in
#3	36 in.	3:22	4:41	18 in.	20 in.	79 min.	2 in.	40 min/in
#4	36 in.	3:24	4:43	17 in.	24 in.	79 min.	7 in.	11 min/in
						AVERAGE RATE		25 min/in