

VOID

SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION

Maine Department of Human Services
Division of Health Engineering, Station 11
(207) 287-5672 FAX (207) 287-4172

PROPERTY LOCATION		>> Caution: Permit Required - Attach In Space Below <<
City, Town, or Plantation	AUGUSTA	
Street or Road	29 Divided Lane MUD MILL ROAD	
Subdivision, Lot #	R2, Box 2480 Augusta, ME 04330	

OWNER/APPLICANT INFORMATION	
Name (last, first, MI)	STOVER SCOTT Owner Applicant
Mailing Address of	R2, Box 2480 339 Riverside Dr. #38 Augusta, ME 04330 Augusta, ME 04330
Daytime Tel. #	622-2391 622-2391
	Municipal Tax Map # <u>12</u> Lot # <u>21</u>

Owner or Applicant Statement	Caution: Inspections Required
I state that the information submitted is correct to the best of my knowledge and understand that any falsification is reason for the Department and/or Local Plumbing Inspector to deny a Permit. <u>Scot Stover</u> 1-15-03 Signature of Owner or Applicant Date	I have inspected the installation authorized above and found it to be in compliance with the Subsurface Wastewater Disposal Rules Application. Local Plumbing Inspector Signature (2nd) Date Approved

PERMIT INFORMATION

TYPE OF APPLICATION 1. <input checked="" type="checkbox"/> First Time System 2. <input type="checkbox"/> Replacement System Type Replaced: _____ or Installed: _____ 3. <input type="checkbox"/> Expanded System a. <input type="checkbox"/> One-time exempted b. <input type="checkbox"/> Non-exempted 4. <input type="checkbox"/> Experimental System 5. <input type="checkbox"/> Seasonal Conversion	THIS APPLICATION REQUIRES 1. <input checked="" type="checkbox"/> No Rule Variance 2. <input type="checkbox"/> First Time System Variance a. <input type="checkbox"/> Local Plumbing inspector Approval b. <input type="checkbox"/> State & Local Plumbing Inspector Approval 3. Replacement System Variance a. <input type="checkbox"/> Local Plumbing Inspector Approval b. <input type="checkbox"/> State & Local Plumbing Inspector Approval 4. <input type="checkbox"/> Minimum Lot Size Variance 5. <input type="checkbox"/> Seasonal Conversion Approval	DISPOSAL SYSTEM COMPONENT(S) 1. <input checked="" type="checkbox"/> Complete Non-engineered System 2. <input type="checkbox"/> Primitive System (graywater & all toilet) 3. <input type="checkbox"/> Alternative Toilet, specify: _____ 4. <input type="checkbox"/> Non-Engineered Treatment Tank (only) 5. <input type="checkbox"/> Holding Tank, _____ gallons 6. <input type="checkbox"/> Non-engineered Disposal Field (only) 7. <input type="checkbox"/> Separated Laundry System 8. <input type="checkbox"/> Complete Engineered System (2000 gpd or more) 9. <input type="checkbox"/> Engineered Treatment Tank (only) 10. <input type="checkbox"/> Engineered Disposal Field (only) 11. <input type="checkbox"/> Pre-treatment, specify: 12. <input type="checkbox"/> Miscellaneous components
SIZE OF PROPERTY <u>1 Acre</u> <input type="checkbox"/> sq. ft. <input checked="" type="checkbox"/> acres	DISPOSAL SYSTEM TO SERVE 1. <input checked="" type="checkbox"/> Single Family Dwelling Unit, No. of Bedrooms: <u>2</u> 2. <input type="checkbox"/> Multiple Family Dwelling, No. of Units: _____ 3. <input type="checkbox"/> Other: _____ SPECIFY	PROPOSED TYPE OF WATER SUPPLY 1. <input checked="" type="checkbox"/> Drilled Well 2. <input type="checkbox"/> Dug Well 3. <input type="checkbox"/> Private 4. <input type="checkbox"/> Public 5. <input type="checkbox"/> Other:

DESIGN DETAILS (SYSTEM LAYOUT SHOWN ON PAGE 3)

TREATMENT TANK 1. <input checked="" type="checkbox"/> Concrete <u>WITH ZAEEL</u> a. <input checked="" type="checkbox"/> Regular <u>A-1800</u> b. <input checked="" type="checkbox"/> Low Profile <u>FILTER</u> <u>OR EQUAL</u> 2. <input type="checkbox"/> Plastic 3. <input type="checkbox"/> Other: _____ CAPACITY <u>1000</u> gallons	DISPOSAL FIELD TYPE & SIZE 1. <input type="checkbox"/> Stone Bed 2. <input type="checkbox"/> Stone Trench 3. <input checked="" type="checkbox"/> Proprietary Device a. <input type="checkbox"/> Cluster array c. <input checked="" type="checkbox"/> Linear b. <input checked="" type="checkbox"/> Regular load d. <input type="checkbox"/> H-20 load 4. <input type="checkbox"/> Other: _____ SIZE <u>300</u> sq. ft. <input type="checkbox"/> lin. ft. <u>180 LIN FT. GLEO FLOW</u>	GARBAGE DISPOSAL UNIT 1. <input checked="" type="checkbox"/> No 3. <input type="checkbox"/> Maybe 2. <input type="checkbox"/> Yes >> Specify one below: a. <input type="checkbox"/> Multi-compartment Tank b. <input type="checkbox"/> Tanks in Series c. <input type="checkbox"/> Increase in Tank Capacity d. <input type="checkbox"/> Filter on Tank Outlet	DESIGN FLOW <u>180</u> gallons per day BASED ON: 1. <input checked="" type="checkbox"/> Table 501.1 (dwelling unit(s)) 2. <input type="checkbox"/> Table 501.2 (other facilities) SHOW CALCULATIONS - for other facilities - <u>10'x30'</u> <u>4 ROWS @ 30'</u> <u>GLEO FLOW PIPE</u> <u>3' ON CENTER</u> 3. <input type="checkbox"/> Section 503.0 (meter readings) ATTACH WATER-METER DATA
SOIL DATA & DESIGN CLASS PROFILE CONDITION DESIGN <u>21 C 11</u> at Observation Hole # _____ Depth <u>18</u> - Elevation _____ OF MOST LIMITING SOIL FACTOR	DISPOSAL FIELD SIZING 1. <input type="checkbox"/> Small -- 2.0 sq. ft./gpd 2. <input type="checkbox"/> Medium -- 2.6 sq. ft./gpd 3. <input checked="" type="checkbox"/> Medium-Large -- 3.3 sq. ft./gpd 4. <input type="checkbox"/> Large -- 4.1 sq. ft./gpd 5. <input type="checkbox"/> Extra Large -- 5.0 sq. ft./gpd	PUMPING 1. <input type="checkbox"/> Not Required 2. <input checked="" type="checkbox"/> May Be Required 3. <input type="checkbox"/> Required >> Specify only for engineered or experimental systems: DOSE: _____ gallons	

SITE EVALUATOR STATEMENT		
I certify that on <u>1-26-02</u> (date) I completed a site evaluation on this property and state that the data reported are accurate and that the proposed system is in compliance with the State of Maine Subsurface Wastewater Disposal Rules (10-144A CMR 241).		
<u>David Studer</u> Site Evaluator Signature	<u>275</u> SE #	<u>1-26-02</u> Date
<u>DAVID L. STUDER</u> Site Evaluator Name Printed	<u>845-2352</u> Telephone #	

SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION

Department of Human Services
Division of Health Engineering
(207) 287-2672 FAX (207) 287-4172

Town, City, Plantation
AUGUSTA




Street, Road Subdivision
MUD MILL ROAD

Owner's Name
SCOTT STOVER

SITE PLAN

Scale 1" = 400 Ft.
or as shown

SITE LOCATION PLAN
(Map from Maine Atlas recommended)

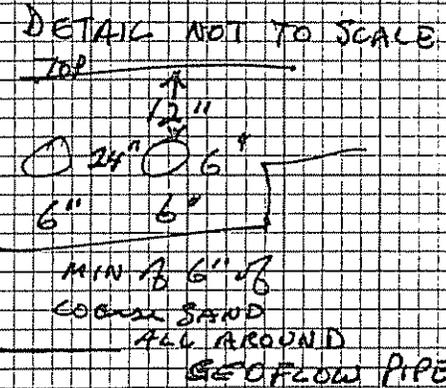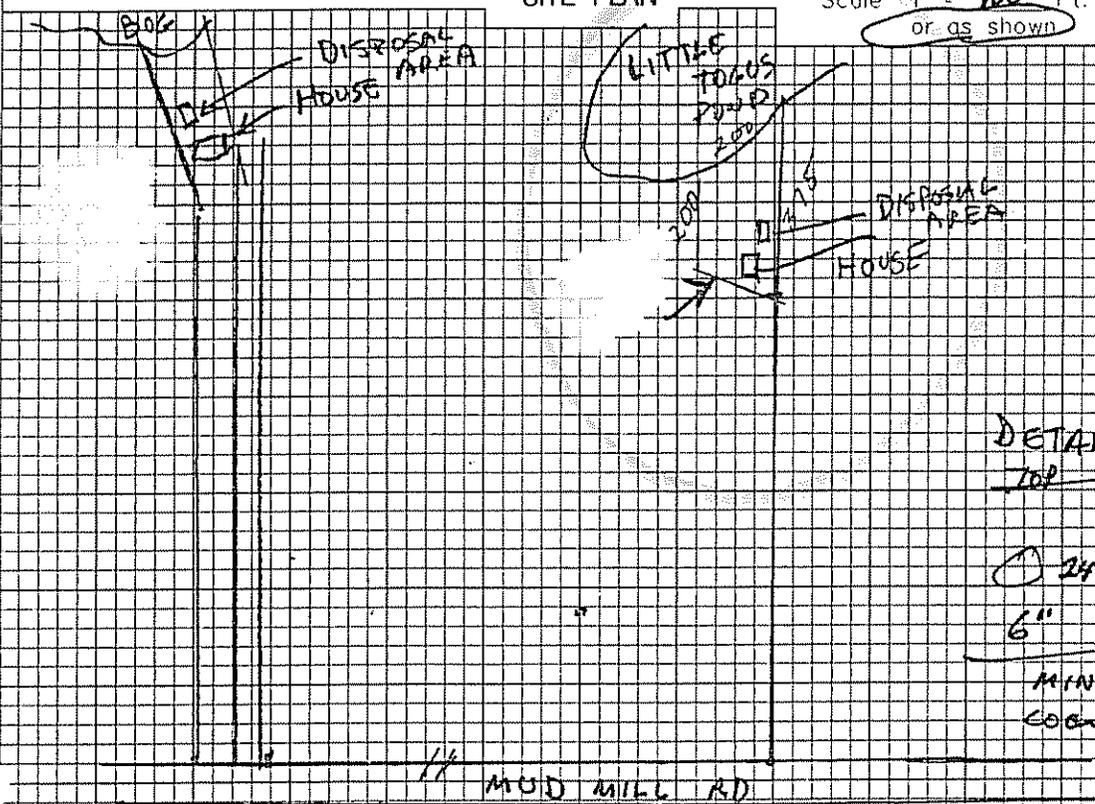

SOIL DESCRIPTION AND CLASSIFICATION (Location of Observation Holes Shown Above)

Observation Hole TP-1 Test Pit Boring
" Depth of Organic Horizon Above Mineral Soil

Texture	Consistency	Color	Mottling
LOAM		DK BN	
ROCKY GRAVELLY SANDY LOAM TO LOAMY SAND	FRIBLE	DK YELLOW	
		OLIVE	MOTTLING
LIMIT OF INVESTIGATION			

Soil Classification: 2 C Profile Condition
Slope: 19%
Limiting Factor: 18"
 Ground Water
 Restrictive Layer
 Bedrock
 Pit Depth

Observation Hole _____ Test Pit Boring
" Depth of Organic Horizon Above Mineral Soil

Texture	Consistency	Color	Mottling

Soil Classification: _____ Profile Condition
Slope: _____ %
Limiting Factor: _____"
 Ground Water
 Restrictive Layer
 Bedrock
 Pit Depth

Site Evaluator Signature: David Studer

SE: 275

Date: 1-26-02

SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION

Department of Human Services
Division of Health Engineering
(207) 287-5672 FAX (207) 287-4172

Town, City, Plantation

Street, Road, Subdivision

Owner's Name

AUGUSTA

MVD MILL RD

SCOTT STOVER


SUBSURFACE WASTEWATER DISPOSAL PLAN

SCALE 1" = 20 FT.

TANK TO HOUSE IS
AT LEAST 8'

MIN. 1/4" PER FOOT DROP
FOUNDATION TO TANK

MIN. 1/8" PER FOOT
DROP FROM
TANK TO PIPE

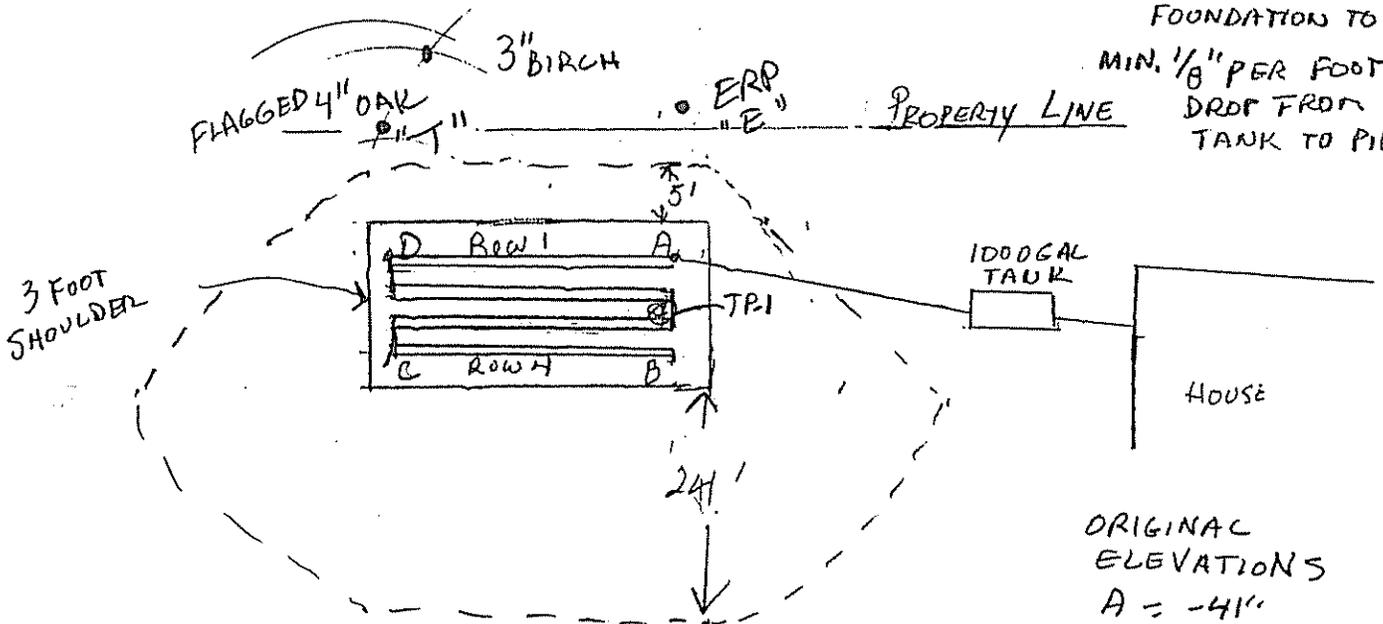

4 Rows of 30'
3' ON CENTER SERIAL DISTRIBUTION
2' EDGE OF PIPE TO EDGE OF PIPE

ORIGINAL ELEVATIONS
A = -41"
B = -64"
C = -60"
D = -42"
TP1 = -53"

FILL REQUIREMENTS


Depth of Fill (Upslope) 18"-19"
Depth of Fill (Downslope) 19"-23"

CONSTRUCTION ELEVATIONS

Finished Grade Elevation 12" OVER GEOWEAVE
Top of Distribution Pipe or Proprietary Device SEE BELOW
Bottom of Disposal Area

ELEVATION REFERENCE POINT
NAIL IN 3" BIRCH
20" ABOVE GRADE
Reference Elevation "0"

DISPOSAL AREA CROSS SECTION

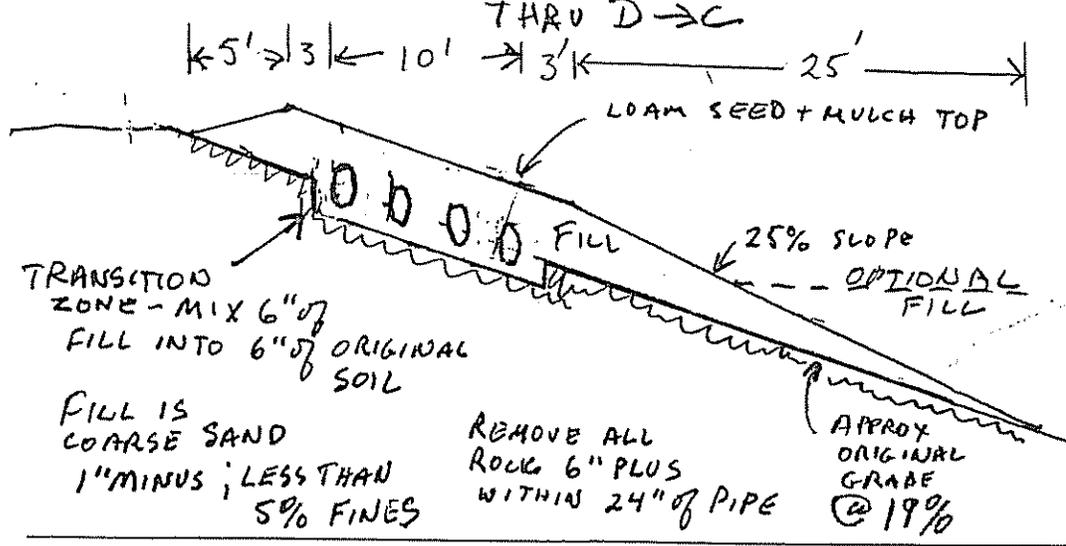

SCALE:
VERTICAL: 1" = 5'
HORIZONTAL: 1" = 10'

Row	TOP	BOTTOM
1	-35"	-47"
2	-41"	-53"
3	-47"	-59"
4	-53"	-65"

David Studer
Site Evaluator Signature

275
SE

1-26-02
Date

ADDENDUM TO HHE-200 AND ADDITIONAL INFORMATION ABOUT YOUR SEPTIC SYSTEM

- 1. You should have your septic system tank pumped out and checked every two years to along the life of the system.**
- 2. Water softeners should drain to a separate gray water disposal system.**
- 3. Your septic system must be installed level and all joints, etc. must be water tight. This applies to the pump tank if your system requires pumping. Distribution boxes shall have Equalizers installed on the outlets.**
- 4. Low volume toilets and water conservation measures are recommended, even if your design does not require them.**
- 5. All construction shall conform to the State of Maine Subsurface Waste Disposal Rules chapter 241.**
- 6. All fill shall be loamy medium sharp sand or coarser, with sufficient fines for compaction. Fill shall be place in 8 inch lifts. Top 4 inches of cover shall be loam or sandy loam, to assure a good catch of grass.**
- 7. All wells shall be at least 100 feet from the leaching field unless a variance is granted.**
- 8. Property lines are as provided by the owner and no accuracy is implied. Actual lines must be confirmed by a survey.**
- 9. All Residential installations of new tanks shall have a Zabel Model A1800 filter or equal installed, unless pumping. Provide a low profile septic tank when determined to be cessary in the field.**
- 10. Force mains, pump stations, and/or gravity piping subject to freezing shall be adequately insulated.**
- 11. Systems shall be provided with adequate erosion control until adequate vegetated cover is established.**
- 12. The design flow of the system should not be exceeded in any day.**
- 13. Remove all vegetation and organic material under the leach field and fill extensions. Caution-- avoid compaction of original soil under the bed and fill extentions during construction.**
- 14. The LPI shall inform the owner and designer of any local ordinances or requirements exceeding the Rules, prior to issuing a permit, so that the application may be properly amended.**
- 15. GeoFlow Pipe shall be installed according to Installation Handbook Dated April 1,1993 or latest revision. For installation advice and best price order GeoFlow Pipe direct from manufacturer. Call Norman Clavet (207) 783-0224 or Tom Caouette (207) 786-0264**

SEPTIC SYSTEM USER NOTES

1. This septic system has been designed to meet requirements of the State of Maine Subsurface Waste disposal rules, 10-44A CMR 241. Because site Evaluators are not notified when local ordinances are enacted which exceed state requirements, it is the owner's responsibility to ensure that this system design (HHE-200 form) is in compliance with local ordinances. This can be done by contacting your local LPI and asking about local ordinances which differ from those required in the Rules.
2. It is the owner's responsibility to obtain any local, state or federal permit(s) that may be required for the installation of this septic system (work within or adjacent to a wetland may require a state and/or federal permit). Contact the Maine Dept. of Environmental Protection at 289-2111 or the Army Corps of Engineers at 623-8367, if you have any questions.
3. The use of a garbage grinder on a septic system is not recommended and is not part of this design. If a garbage grinder is to be used, additional tank capacity, filters such as the Zabel A-100, and more frequent tank pumping is required.
4. It is recommended that the owner install low volume toilets (1 1/2 gallon or less per flush) and other flow reducing fixtures to minimize water consumption. This should extend the life of the system, all other things being equal.
5. It is the owner's responsibility to limit water consumption and waste water so that the septic system design capacity is not exceeded on any day. Activities which generate large amounts of wastewater should be spread out over several days rather than doing a number of them on a particular day. Excessive use of a system on any day (typically weekends) can cause the system to fail, even if the flow averaged out over the month or week is below design volume.
6. Do not connect roof or floor drains to a septic system. The system is not designed to handle this water and may cause premature failure. Do not dispose of backwash from water softeners or water treatment devices for the same reason.
7. Do not dispose of any hazardous or toxic substances in a septic system, such as paint, paint thinners & solvents, varnishes, photographic solutions, pesticides, insecticides, organic solvents or degreasers, and drain cleaners or openers. Instead of a commercial degreaser or drain opener, use one of the following:
 - a. A plunger or mechanical snake, or
 - b. Pour 1 handful of baking soda and 1/2 cup of white vinegar down the drain pipe and cover for one minute. Repeat as necessary, or
 - c. Pour 1/2 cup salt and 1/2 cup baking soda down the drain followed by 6 cups of boiling water. Let sit several hours or overnight. Then flush with water.
8. Do not dispose of any inert or non-biodegradable substances into your septic system such as disposable diapers, cat box litter, coffee grounds, cigarette filters, sanitary napkins, facial tissues and wet strength paper towels.
9. Do not dispose of large quantities of fats or grease into your septic system unless an external grease trap has been installed for that purpose. Generally, an internal grease trap is inadequate to handle excessive amounts of grease or fat.
10. Do not add any septic tank cleaner or additive to your septic system to improve its function or prolong its useful operating life. This includes yeast, horse manure, or commercial products. No effective product or material is recognized by State authorities and some products may cause your system to fail.
11. Maintain your septic system by regularly having the septic tank pumped. Some biological breakdown of solid and grease occurs in the tank but the rate of accumulation virtually always exceeds the rate of breakdown. If your tank is not pumped often enough, solids and greases may build up to the point where they enter the disposal area. Once this material reaches the disposal area it will clog the soil surface and likely cause premature failure.
12. I recommend having your septic tank pumped or inspected after one year of use. The pumper can advise you how often you need to have the tank pumped based on what he finds at this inspection. Typically a tank is pumped every 2 to 5 years. Adjust the pumping frequency with changes in how you use the system--the more you use the system, the more frequently the tank should be pumped.
13. Divert all surface water away from the septic tank and disposal area. Roof area that contributes runoff water to septic system site should have gutters installed to divert water to another location.
14. PLEASE- If you have any questions about your system or how to use it call and ask me for advice at 1-(800) 763-4088. You can also call the Division of Health Engineering at 289-5672.
DAVID STUDER, LSE #275
93 SPRAGUE RD., WASHINGTON, ME, 04574