SUBMIT THE FOLLOWING COMPLETED FORM TO YOUR LOCAL PLUMBING INSPECTOR

Davenport Richard

DATE August 23 1972	OWNER Richard C. Davenport
NUMBER OF BEDROOMS (2)	STREET Togus Pond Rd.
SIZE OF SEPTIC TANK 750 gallon	CITY Augusta MAINE
TYPE OF SOIL Gravelly	TEL. NUMBER 623-4090
Test Performed by Wallace L. Thomas Water 7523	LOCATION OF PROPOSED INSTALLATION
Local Plumbing Inspector's Signature C. J. Martin	STREET as above
	CITY MAINE
	TEL. NUMBER

SKETCH: LOCATION OF BUILDING DISPOSAL SYSTEM, TERRAIN FEATURES, PERCOLATION HOLES, WATER SUPPLIES, ETC.

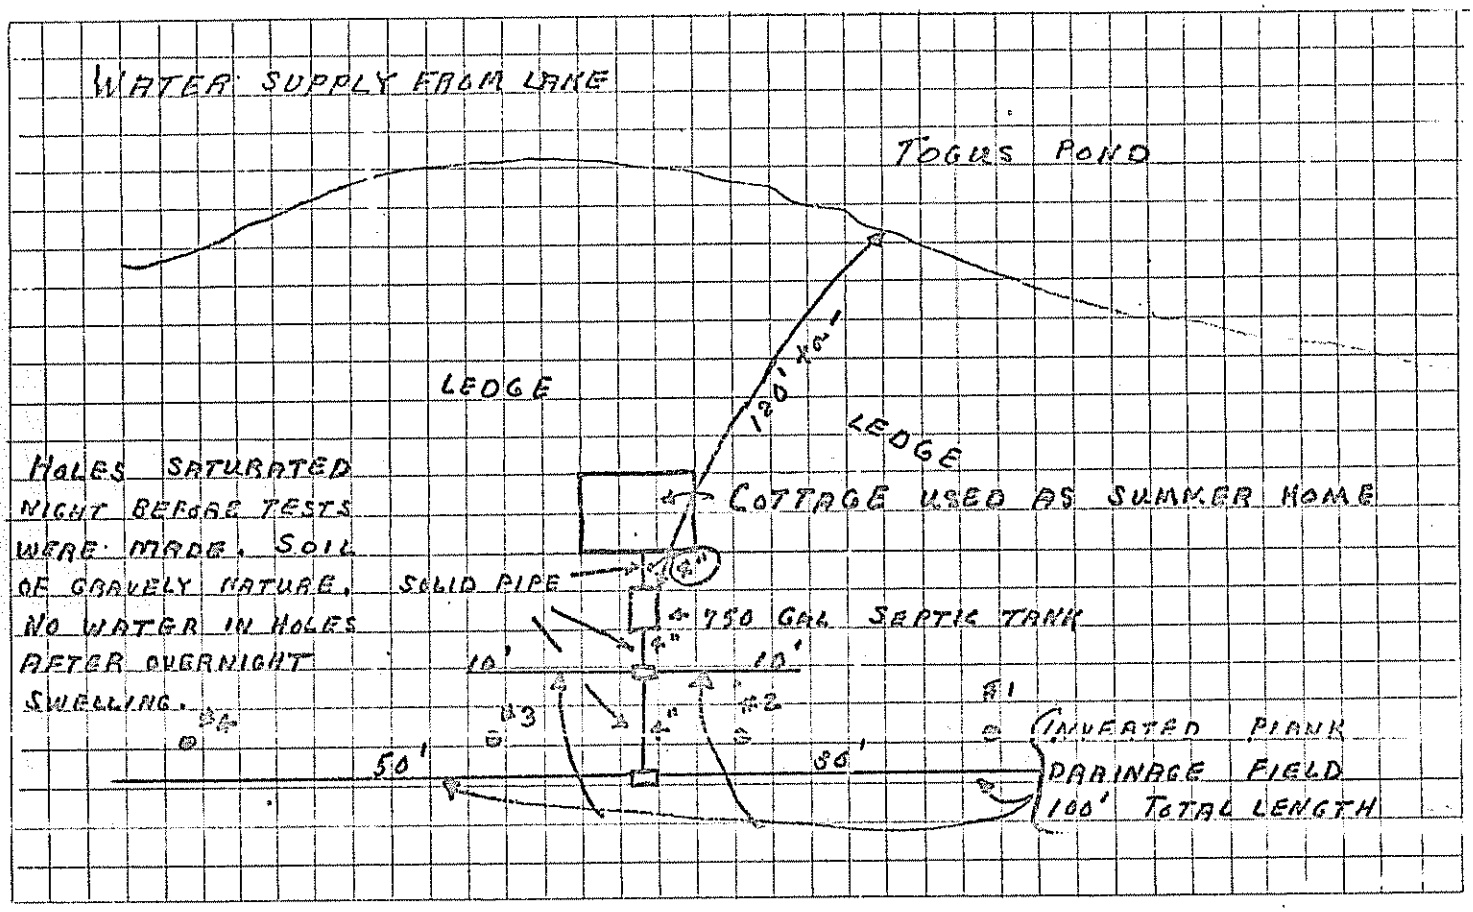

_____ Depth to Water Table
_____ Depth to Bedrock
_____ Depth to Clay or other impervious strata

REMARKS

HOLE	HOLE DEPTH	TIME START	TIME FINISH	DEPTH OF WATER ~~SURFACE~~ START	DEPTH OF WATER ~~SURFACE~~ FINISH	ELAPSED TIME	TOTAL DROP OF WATER	PERCOL. RATE MINUTES/INCH
#1	36 in.	8:45 AM	9:33 AM	6" in.	2" in.	48 min.	4 in.	12 min/in
#2	36 in.	8:50	9:30	6 in.	2 in.	40 min.	4 in.	10 min/in
#3	36 in.	8:51	9:31	6 in.	2 in.	40 min.	4 in.	10 min/in
#4	36 in.	9:05	9:33	6 in.	2 in.	28 min.	4 in.	7 min/in
						AVERAGE RATE		9.75 min/in