WING, ROBERT

SUBMIT THE FOLLOWING COMPLETED FORM TO YOUR LOCAL PLUMBING INSPECTOR

DATE Oct 20 1972	OWNER Robert Wing
NUMBER OF BEDROOMS 2	STREET ~~Woodard Road~~ 139 Conn St
SIZE OF SEPTIC TANK 500 gal (exist)	CITY Auburn MAINE
TYPE OF SOIL Weathered Clay	TEL. NUMBER [illegible]
Test Performed by K. Cotton for E.S. Cotton	LOCATION OF PROPOSED INSTALLATION
Local Plumbing Inspector's Signature C. T. Morton	STREET Woodard Road
	CITY Auburn MAINE
	TEL. NUMBER

SKETCH: LOCATION OF BUILDING DISPOSAL SYSTEM, TERRAIN FEATURES, PERCOLATION HOLES, WATER SUPPLIES, ETC.

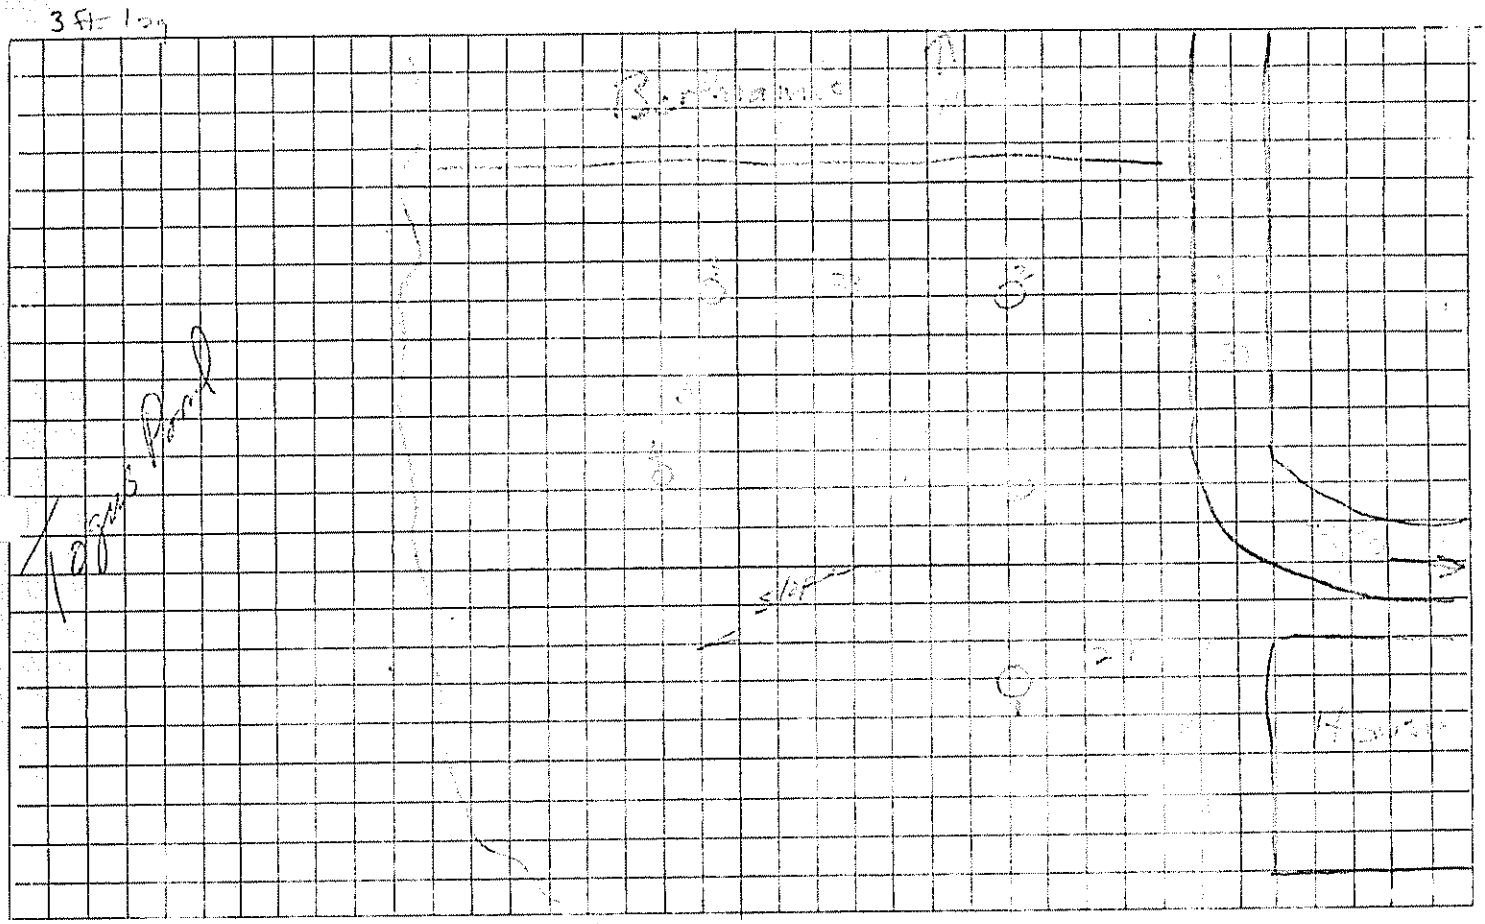

— Depth to Water Table
— Depth to Bedrock
— Depth to Clay or other impervious strata ?

REMARKS

Test performed Oct 19 1972

HOLE	HOLE DEPTH	TIME START	TIME FINISH	DEPTH OF WATER SURFACE START	DEPTH OF WATER SURFACE FINISH	ELAPSED TIME	TOTAL DROP OF WATER	PERCOL. RATE MINUTES/INCH
#1	43 ½ in.	5 09	6 08	33 ½ in.	35 ½ in.	59 min.	2 in.	26.1 min/in
#2	37 ½ in.	5 11	6 10	29 ½ in.	30 ½ in.	[illegible] min.	[illegible] in.	47.[illegible] min/in
#3	31 ½ in.	5 11	6 11	26 in.	27 ½ in.	[illegible] min.	1 in.	[illegible] min/in
#4	3[illegible] in.	5 12	6:12	25 in.	[illegible] in.	[illegible] min.	[illegible] in.	[illegible] min/in
						AVERAGE RATE		37 min/in

182' of Trench Req'd