SUBMIT THE FOLLOWING COMPLETED FORM TO YOUR LOCAL PLUMBING INSPECTOR

Trial, Larry

DATE JULY 29, 1972
NUMBER OF BEDROOMS THREE
SIZE OF SEPTIC TANK 1000 Gals.
TYPE OF SOIL STONY FINE SANDY LOAM

OWNER LARRY TRIAL
STREET Rt. 6, PULLEN ROAD
CITY AUGUSTA, MAINE
TEL. NUMBER 622-3767

Test Performed by
Lawrence H. Cote, P.E.

Local Plumbing Inspector's Signature

LOCATION OF PROPOSED INSTALLATION
STREET SAME - across Pullen
CITY Road MAINE
TEL. NUMBER

SKETCH: LOCATION OF BUILDING DISPOSAL SYSTEM, TERRAIN FEATURES, PERCOLATION HOLES, WATER SUPPLIES, ETC.

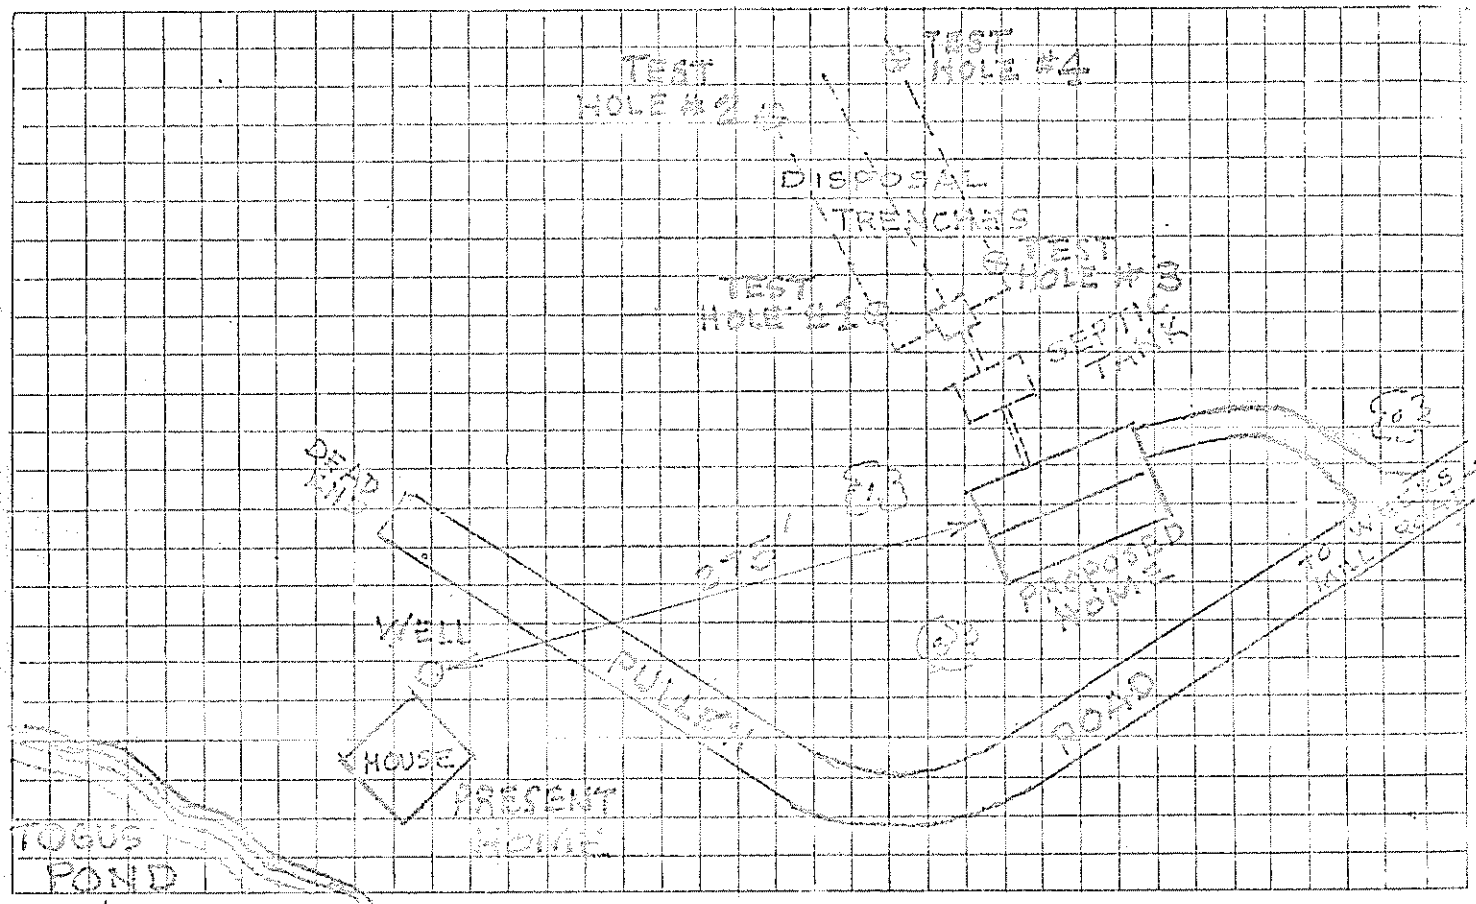

OVER 4' Depth to Water Table
OVER 6' Depth to Bedrock
Depth to Clay or other impervious strata
None Found in all diggings

REMARKS Test Holes were all 3' deep before Gravel added to hole

HOLE	HOLE DEPTH	TIME		DEPTH OF WATER SURFACE		ELAPSED TIME	TOTAL DROP OF WATER	PERCOL. RATE MINUTES/INCH
		START	FINISH	START	FINISH			
#1	36 in.	7:04 pm	7:29 pm	12 3/4 in.	21 1/2 in.	25 min.	8 3/4 in.	2.86 min/in
#2	36 in.	7:14 pm	7:37 pm	10 1/2 in.	19 in.	23 min.	8 1/2 in.	2.71 min/in
#3	36 in.	7:08 pm	7:32 pm	9 1/2 in.	20 in.	24 min.	10.5 in.	2.29 min/in
#4	36 in.	7:10 pm	7:35 pm	10 1/4 in.	21 1/2 in.	25 min.	11 in.	2.27 min/in
						AVERAGE RATE		2.53 min/in