Cote, Sylvio

SUBMIT THE FOLLOWING COMPLETED FORM TO YOUR LOCAL PLUMBING INSPECTOR

DATE 3-24-73	OWNER Sylvio Cote
NUMBER OF BEDROOMS 3	STREET Old Oakland Rd
SIZE OF SEPTIC TANK 1000	CITY Augusta MAINE
TYPE OF SOIL Sandy	TEL. NUMBER 6225368
Test Performed by [signature] PE # 1576	LOCATION OF PROPOSED INSTALLATION
Local Plumbing Inspector's Signature George L. Smith	STREET
	CITY Same MAINE
	TEL. NUMBER

SKETCH: LOCATION OF BUILDING DISPOSAL SYSTEM, TERRAIN FEATURES, PERCOLATION HOLES, WATER SUPPLIES, ETC.

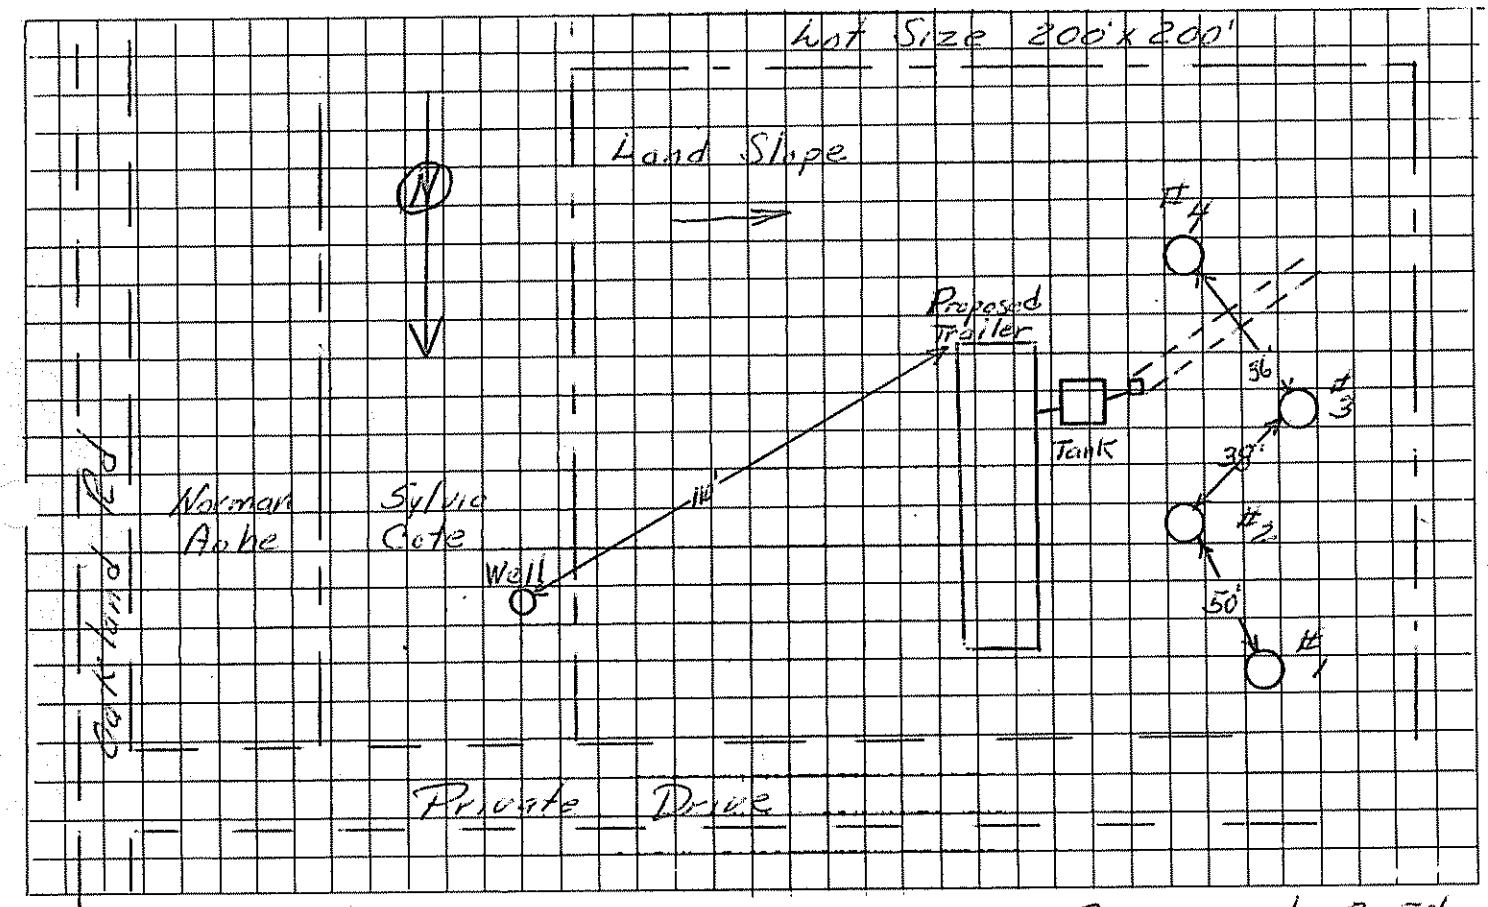

5'+ Depth to Water Table
50'+ Depth to Bedrock
5'+ Depth to Clay or other impervious strata

REMARKS Recommend 2-50' Absorption Tenches as Shown

HOLE	HOLE DEPTH	TIME START	TIME FINISH	DEPTH OF WATER SURFACE START	DEPTH OF WATER SURFACE FINISH	ELAPSED TIME	TOTAL DROP OF WATER	PERCOL. RATE MINUTES/INCH
#1	36 in.	12:07	12:20	22 in.	26 in.	13 min.	4 in.	3+ min/in
#2	36 in.	12:08	12:22	18 in.	23 in.	14 min.	5 in.	3- min/in
#3	36 in.	12:09	12:23	18 in.	24 in.	14 min.	6 in.	2+ min/in
#4	36 in.	12:10	12:24	20 in.	24 in.	14 min.	4 in.	4- min/in
						AVERAGE RATE		3 min/in