Southwick Eugene

SUBMIT THE FOLLOWING COMPLETED FORM TO YOUR LOCAL PLUMBING INSPECTOR

DATE April 21 1972 NUMBER OF BEDROOMS 2 SIZE OF SEPTIC TANK 1000 gal TYPE OF SOIL Rocky Clay Till	OWNER Eugene Southwick STREET CITY Hallowell MAINE TEL. NUMBER
Test Performed by Guy R Allen — Guy Allen Local Plumbing Inspector's Signature George L. Smith	LOCATION OF PROPOSED INSTALLATION STREET Allenwood Park CITY Augusta MAINE TEL. NUMBER

SKETCH: LOCATION OF BUILDING DISPOSAL SYSTEM, TERRAIN FEATURES, PERCOLATION HOLES, WATER SUPPLIES, ETC.

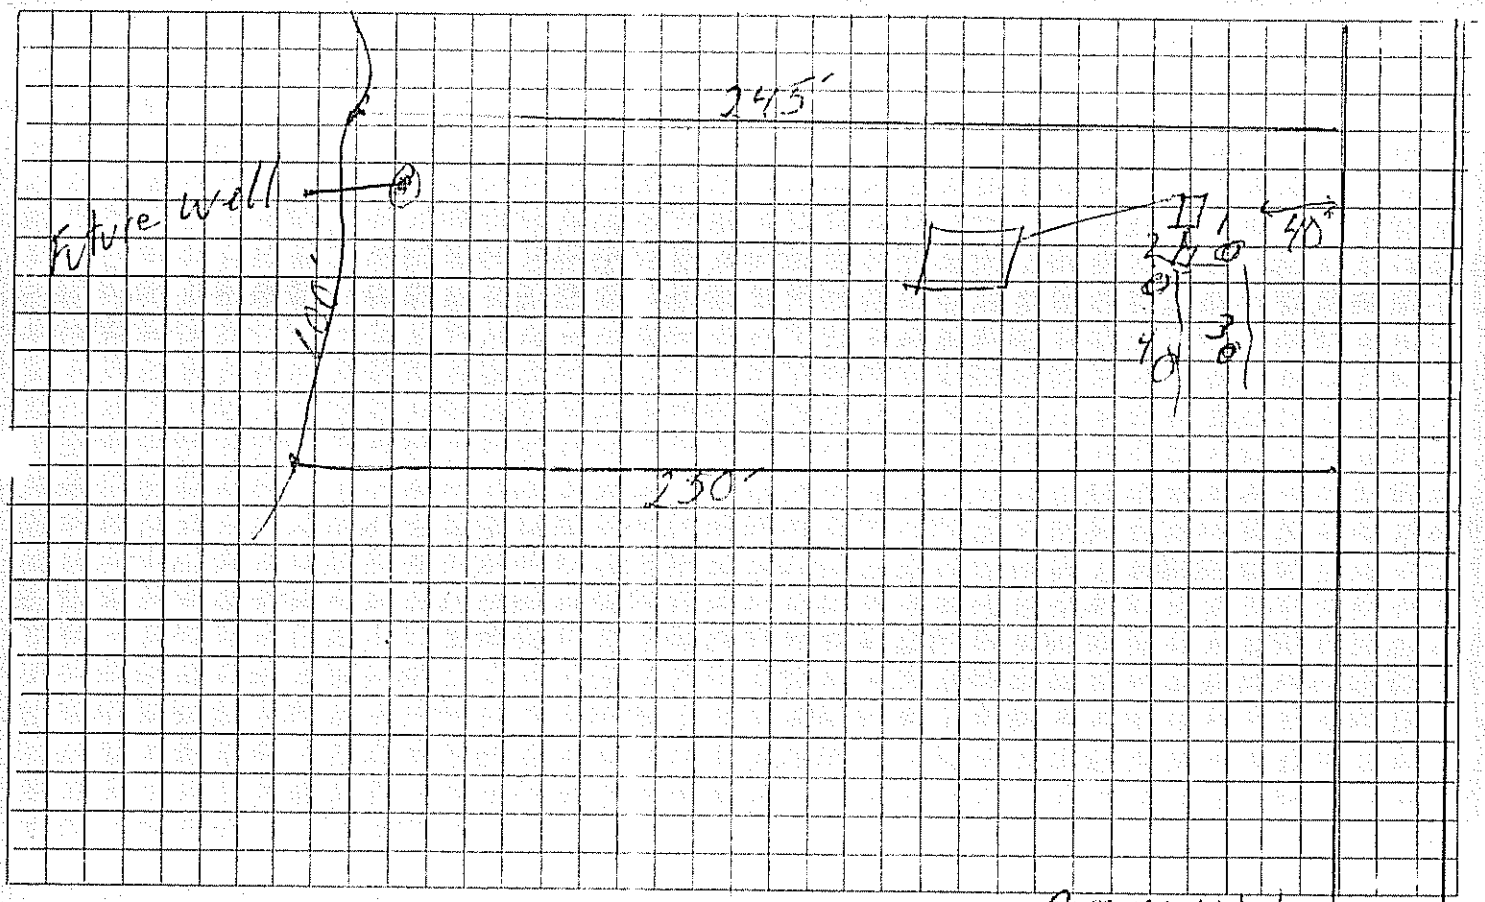

+8 Depth to Water Table
+9 Depth to Bedrock
___ Depth to Clay or other impervious strata

REMARKS Recommended Distribution Box
2 Trenches 60' each

HOLE	HOLE DEPTH	TIME START	TIME FINISH	DEPTH OF WATER SURFACE START	DEPTH OF WATER SURFACE FINISH	ELAPSED TIME	TOTAL DROP OF WATER	PERCOL. RATE MINUTES/INCH
#1	36 in.	7:22	8:00	24 in.	28 in.	38 min.	4 in.	9.5 min/in
#2	38 in.	7:23	8:01	29 in.	34 in.	38 min.	5 in.	7.6 min/in
#3	37 in.	7:25	8:02	29 in.	33 in.	37 min.	4 in.	9.2 min/in
#4	35 in.	7:27	8:03	28 in.	33 in.	36 min.	5 in.	7.2 min/in
						AVERAGE RATE		8.38 min/in