BENSON CDC

SUBMIT THE FOLLOWING COMPLETED FORM TO YOUR LOCAL PLUMBING INSPECTOR

DATE 8/13/74 Lot (2)
NUMBER OF BEDROOMS 3
SIZE OF SEPTIC TANK 1000
TYPE OF SOIL Loam Sandy

OWNER C.D.C. INC.
STREET 150 Mt. Vernon Ave
CITY Augusta MAINE
TEL. NUMBER 622 5919

Test Performed by
Rolfe's Plumbing

Local Plumbing Inspector's Signature
George L. Smith

LOCATION OF PROPOSED INSTALLATION
STREET ~~Clairmont~~ Burns Road
CITY Augusta MAINE
TEL. NUMBER

SKETCH: LOCATION OF BUILDING DISPOSAL SYSTEM, TERRAIN FEATURES, PERCOLATION HOLES, WATER SUPPLIES, ETC.

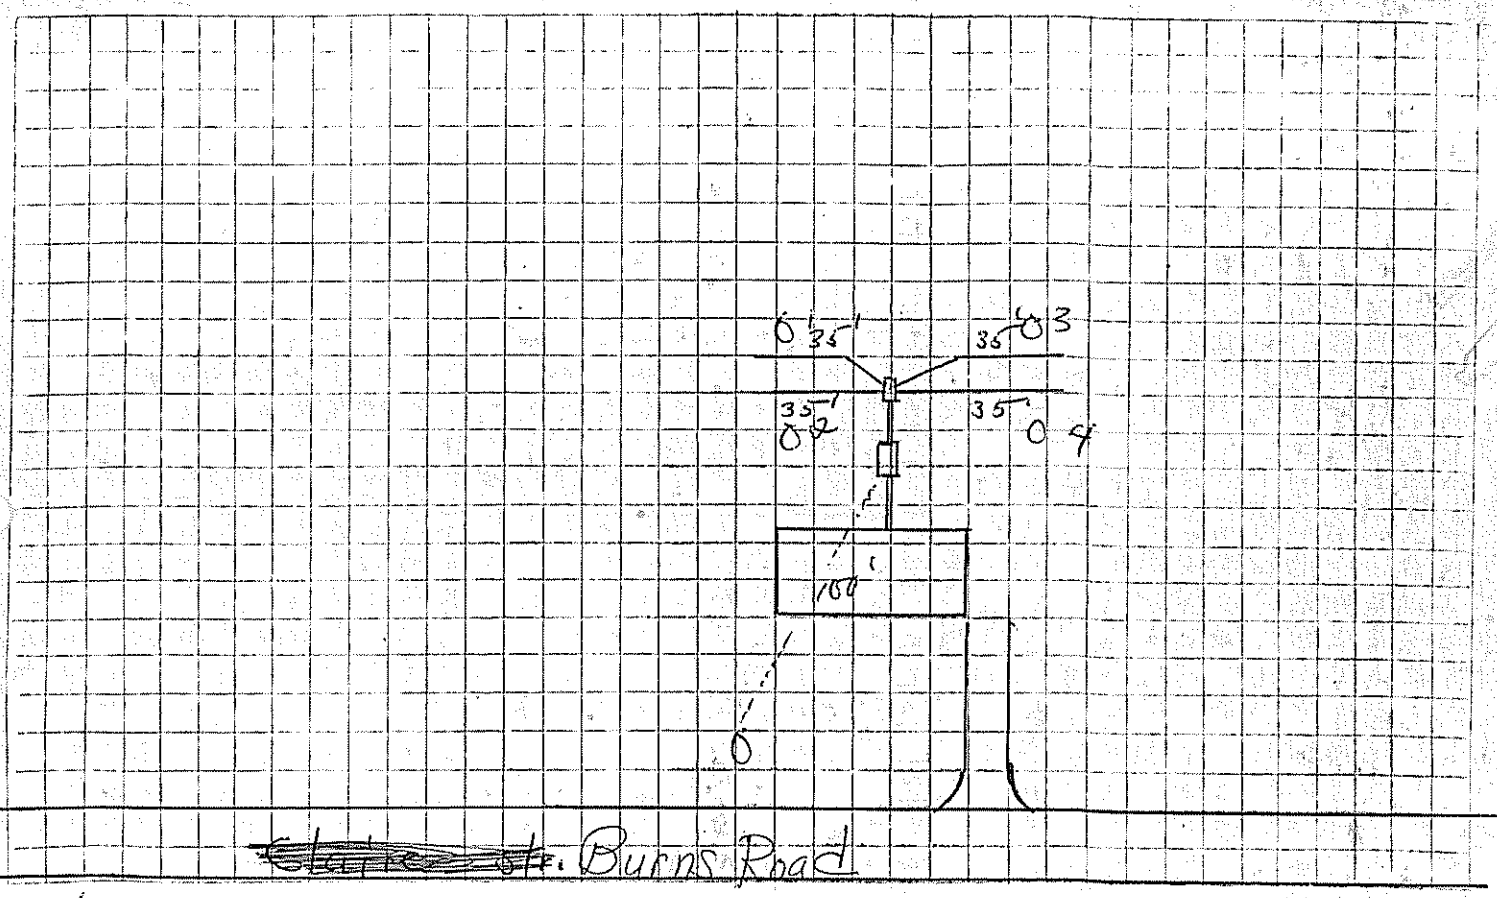

5+ Depth to Water Table
80' Depth to Bedrock
5+ Depth to Clay or other impervious strata

REMARKS 3/4 to 3 stone or crushed stone

HOLE	HOLE DEPTH	TIME START	TIME FINISH	DEPTH OF WATER SURFACE START	DEPTH OF WATER SURFACE FINISH	ELAPSED TIME	TOTAL DROP OF WATER	PERCOL. RATE MINUTES/INCH
#1	36 in.	8:20	8:20	28 in.	22 in.	60 min.	6 in.	10 min/in
#2	36 in.	8:27	8:27	30 in.	22 in.	60 min.	8 in.	7 min/in
#3	36 in.	8:29	8:29	30 in.	24 in.	60 min.	6 in.	10 min/in
#4	36 in.	8:37	8:37	27 in.	20 in.	60 min.	7 in.	8 min/in
						AVERAGE RATE		8+ min/in

BENSON

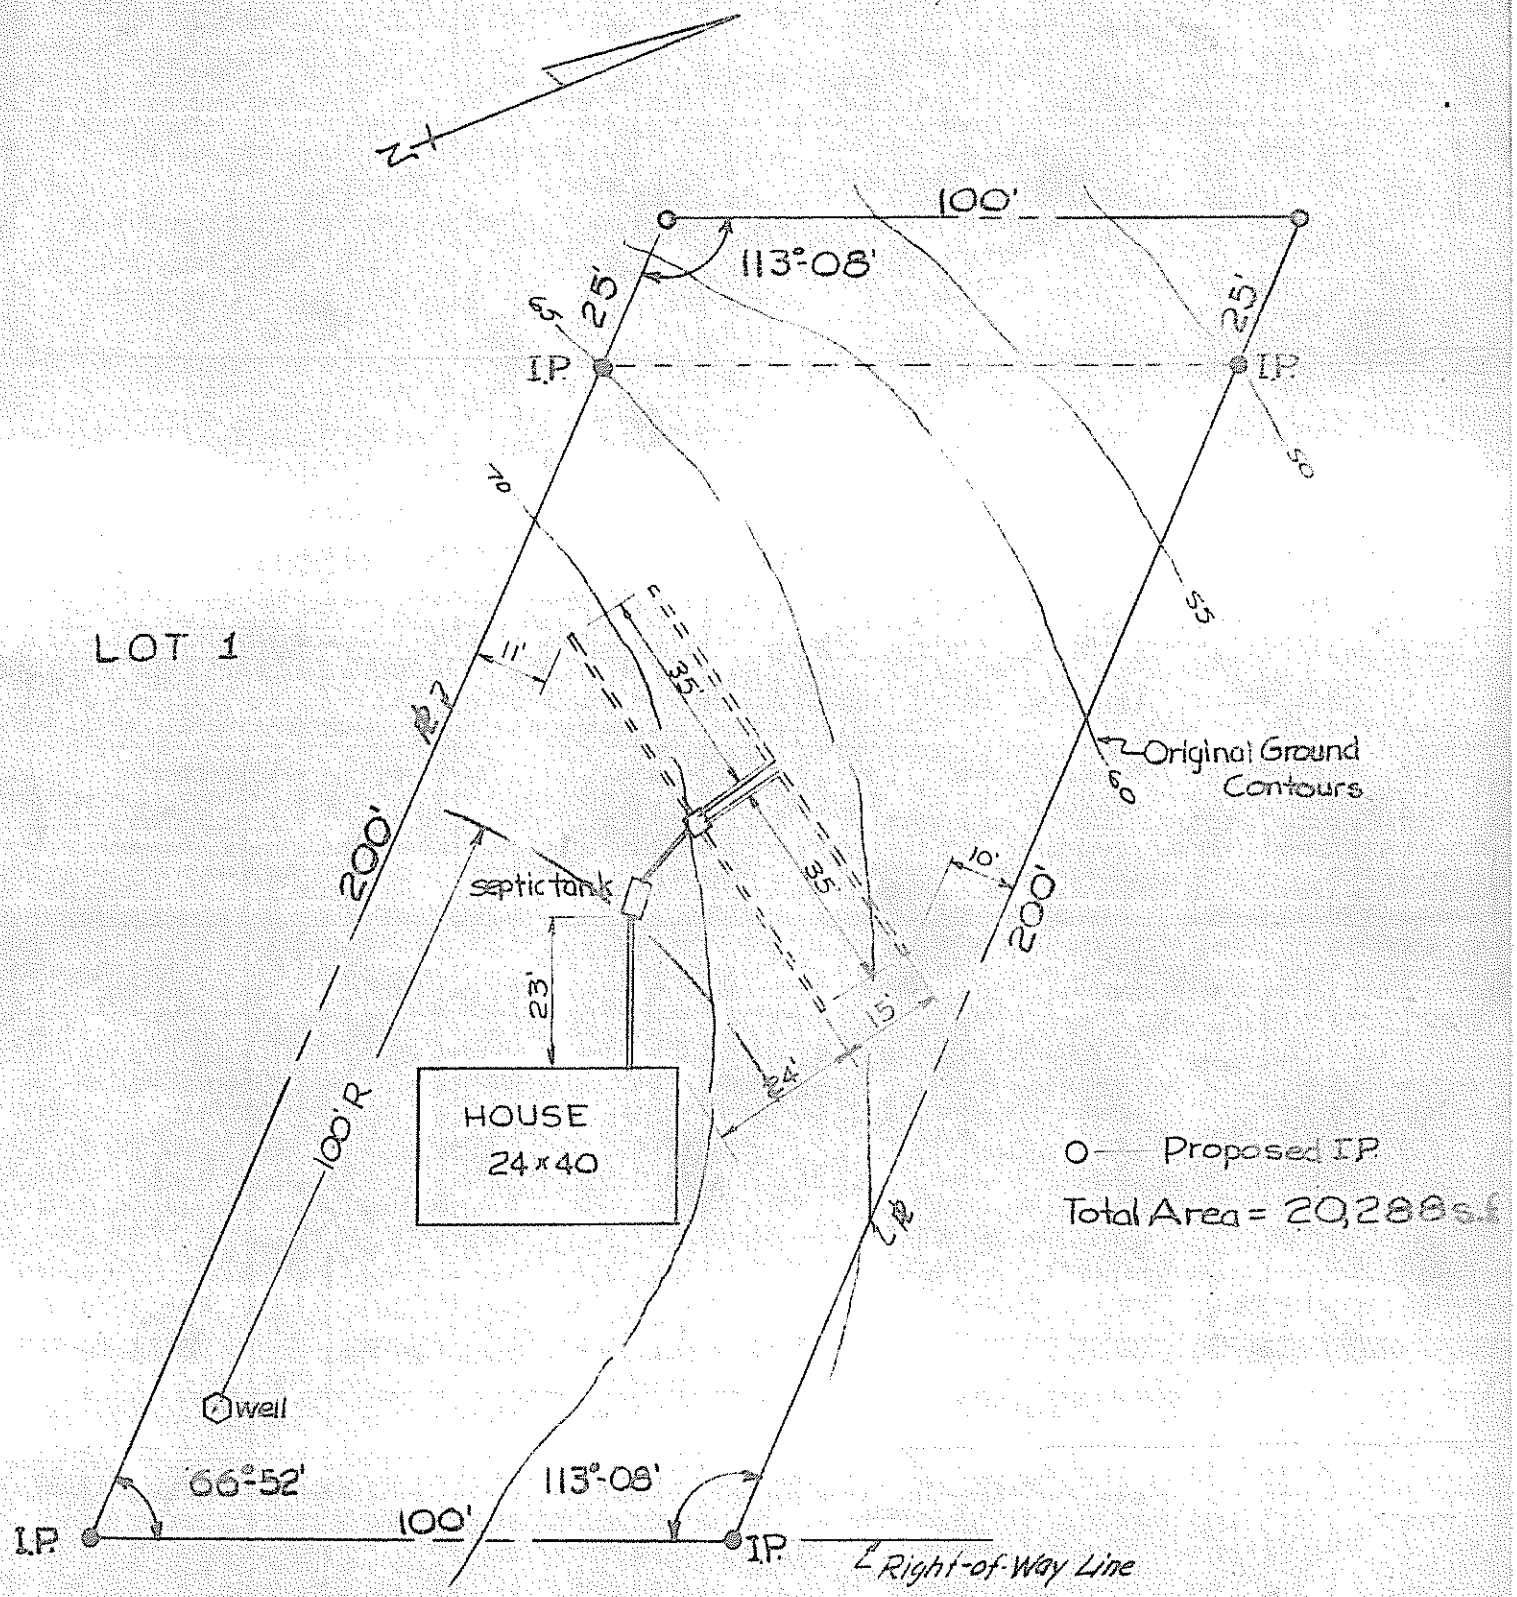

LOT LAYOUT- 2 & 2A
CDC SUBDIVISION
BURNS ROAD AUGUSTA, ME.

H.R. DOTEN
Consulting Engineer
128 State Street Augusta, Maine

MAY 21, 1974

SCALE 1" = 30'