SUBMIT THE FOLLOWING COMPLETED FORM TO YOUR LOCAL PLUMBING INSPECTOR

Drake Fred

DATE Sept. 6, 1972	OWNER Fred Drake Jr & Linda Drake
NUMBER OF BEDROOMS 2	STREET 8 Lonsdale St.
SIZE OF SEPTIC TANK 1000	CITY Hallowell, MAINE
TYPE OF SOIL Rocky Buxton Silt Loam	TEL. NUMBER 622-5826
Test Performed by Maynard P. Libby R.L.S #965	LOCATION OF PROPOSED INSTALLATION
Local Plumbing Inspector's Signature [illegible]	STREET Riverside Drive (Rt. 201)
	CITY Augusta, MAINE
	TEL. NUMBER None

SKETCH: LOCATION OF BUILDING DISPOSAL SYSTEM, TERRAIN FEATURES, PERCOLATION HOLES, WATER SUPPLIES, ETC. City water service

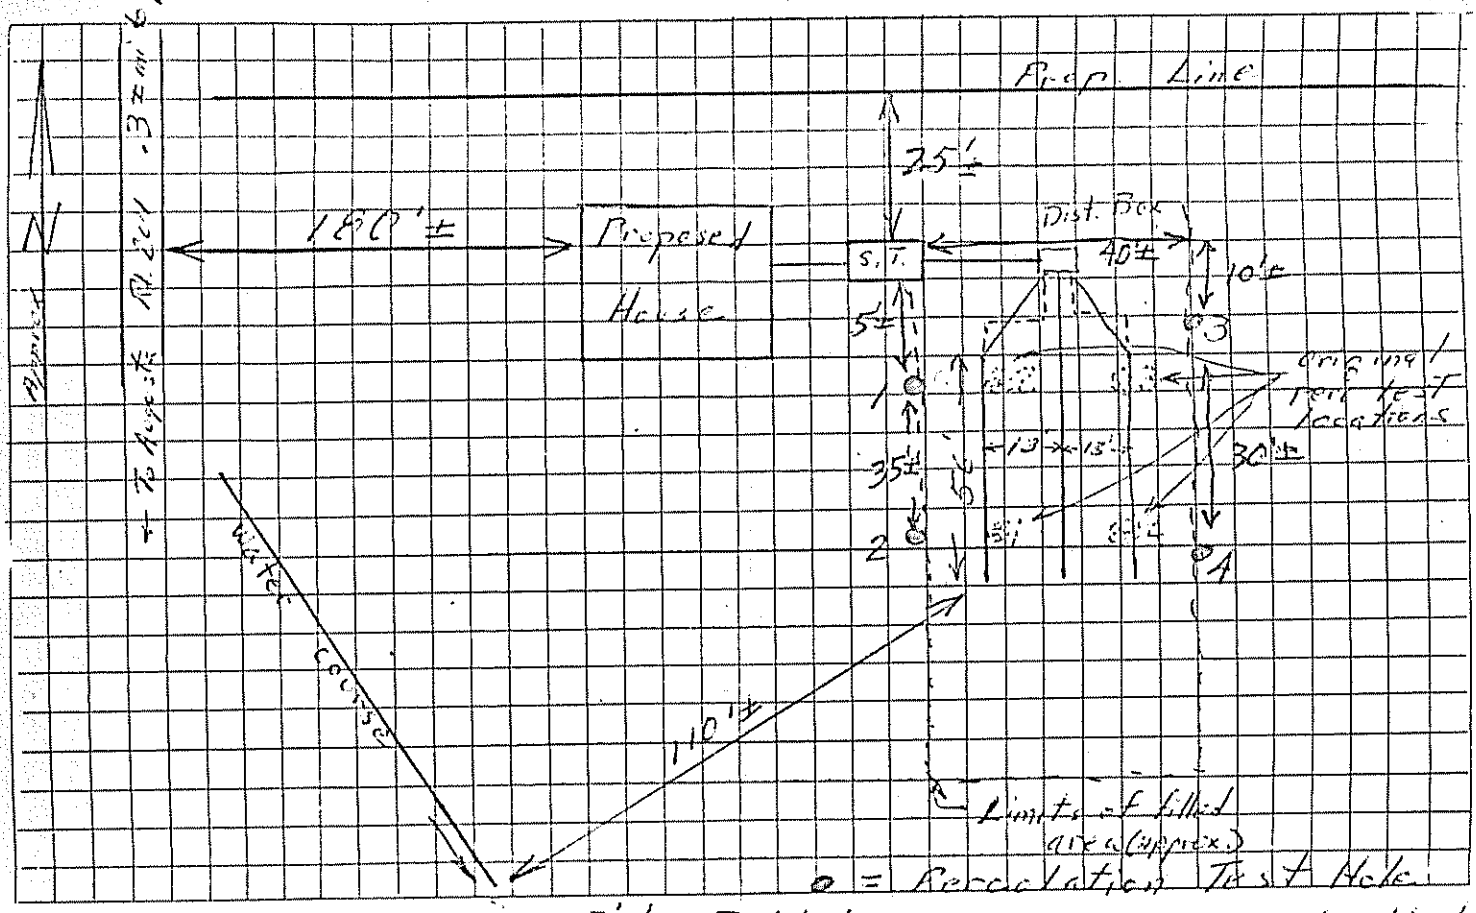

6.5' Depth to Water Table in 7' deep Test hole

Depth to Bedrock None encountered

30" Depth to Clay or other impervious strata

REMARKS: Soil type questionable due to rock content & more rapid permeability than normal with Buxton silt loam.

HOLE	HOLE DEPTH	TIME START	TIME FINISH	DEPTH OF WATER SURFACE START	DEPTH OF WATER SURFACE FINISH	ELAPSED TIME	TOTAL DROP OF WATER	PERCOL. RATE MINUTES/INCH
#1	28 in.	10:06	11:38	21 in.	25 in.	92 min.	4 in.	23.0 min/in
#2	28 in.	10:09	10:51	22 in.	26 in.	42 min.	4 in.	10.5 min/in
#3	28 in.	10:10	11:30	21 in.	25 in.	80 min.	4 in.	20.0 min/in
#4	28 in.	10:12	10:49	22 in.	26 in.	37 min.	4 in.	9.25 min/in
						AVERAGE RATE		15.7 min/in

MPL