BELL, ROBERT

SUBMIT THE FOLLOWING COMPLETED FORM TO YOUR LOCAL PLUMBING INSPECTOR

DATE [illegible]	OWNER [illegible]
NUMBER OF BEDROOMS 2	STREET [illegible]
SIZE OF SEPTIC TANK 1000	CITY [illegible] MAINE
TYPE OF SOIL [illegible]	TEL. NUMBER
Test Performed by [illegible] PE # 1576	LOCATION OF PROPOSED INSTALLATION
Local Plumbing Inspector's Signature LOVETT	STREET [illegible]
	CITY [illegible] MAINE
	TEL. NUMBER

SKETCH: LOCATION OF BUILDING DISPOSAL SYSTEM, TERRAIN FEATURES, PERCOLATION HOLES, WATER SUPPLIES, ETC.

289 - 3185 Map 11 Lot 103

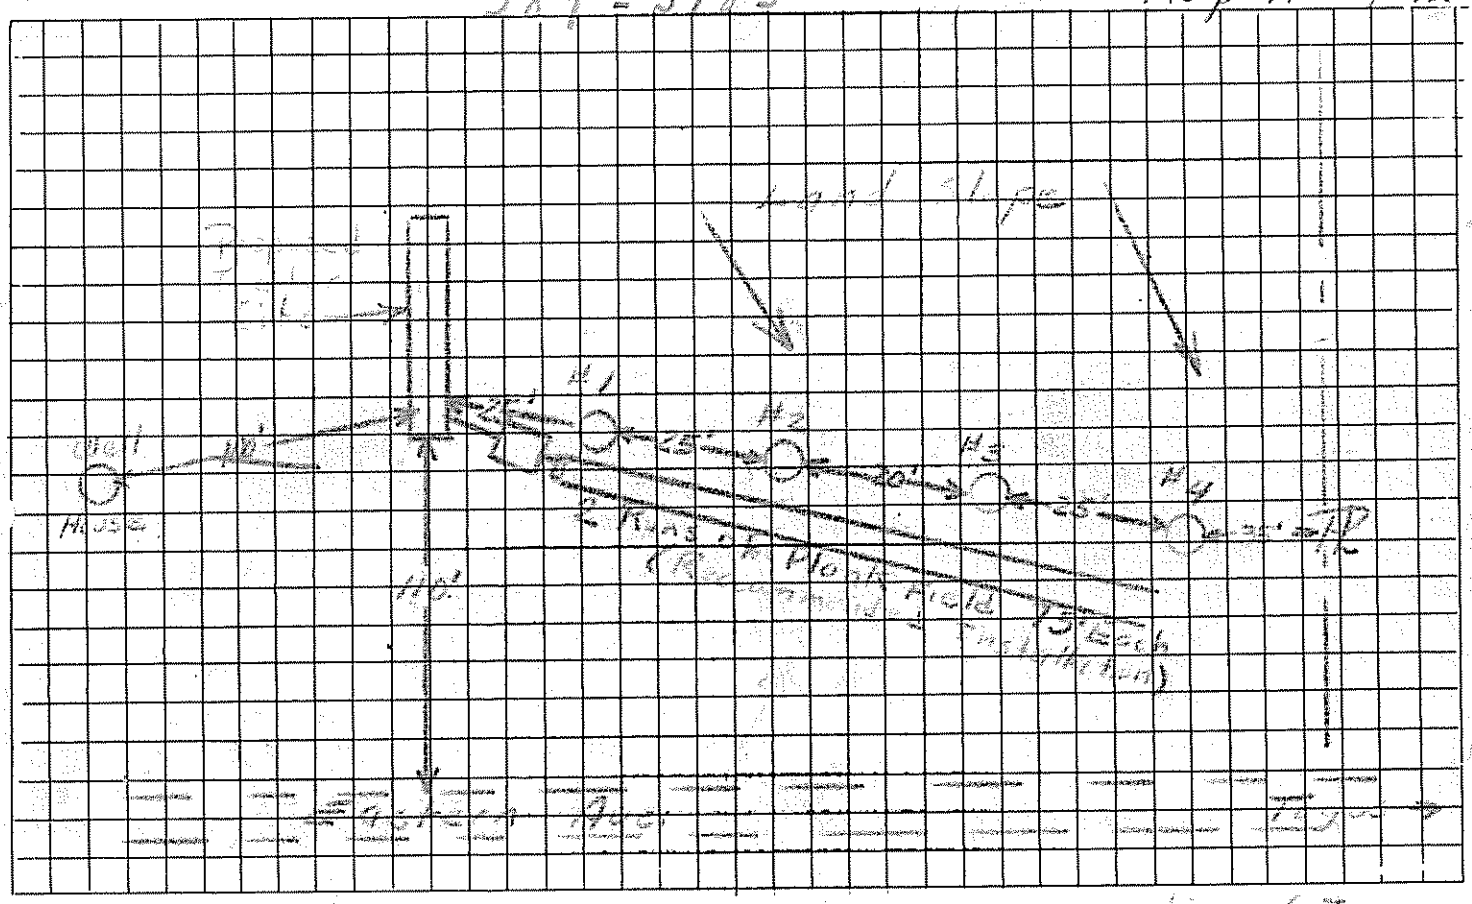

Depth to Water Table
Depth to Bedrock
Depth to Clay or other impervious strata

REMARKS Location of Trench To be adjusted To best fit Land Slope by Installer.

HOLE	HOLE DEPTH	TIME START	TIME FINISH	DEPTH OF WATER SURFACE START	DEPTH OF WATER SURFACE FINISH	ELAPSED TIME	TOTAL DROP OF WATER	PERCOL. RATE MINUTES/INCH
#1	Bottom 33½ in.	7:15	7:35	20 in.	22 in.	20 min.	2 in.	10 min/in
#2	34½ in.	7:10	7:40	20 in.	22½ in.	30 min.	2 in.	15 min/in
#3	36 in.	7:16	7:36	22 in.	24 in.	20 min.	2 in.	10 min/in
#4	36 in.	7:21	7:47	21 in.	29 in.	26 min.	8 in.	3 min/in
						AVERAGE RATE		9½ min/in