SUBMIT THE FOLLOWING COMPLETED FORM TO YOUR LOCAL PLUMBING INSPECTOR

BROCHU, RAYMOND

DATE August 30 1972	OWNER Raymond Brochu
NUMBER OF BEDROOMS 3	STREET EASTERN AVE.
SIZE OF SEPTIC TANK 1000 "	CITY Augusta MAINE
TYPE OF SOIL Gravel	TEL. NUMBER 622-5016
Test Performed by John E. Lord Jr.	LOCATION OF PROPOSED INSTALLATION
Local Plumbing Inspector's Signature George V. Smith	STREET Eastern Ave.
	CITY Augusta MAINE
	TEL. NUMBER

SKETCH: LOCATION OF BUILDING DISPOSAL SYSTEM, TERRAIN FEATURES, PERCOLATION HOLES, WATER SUPPLIES, ETC.

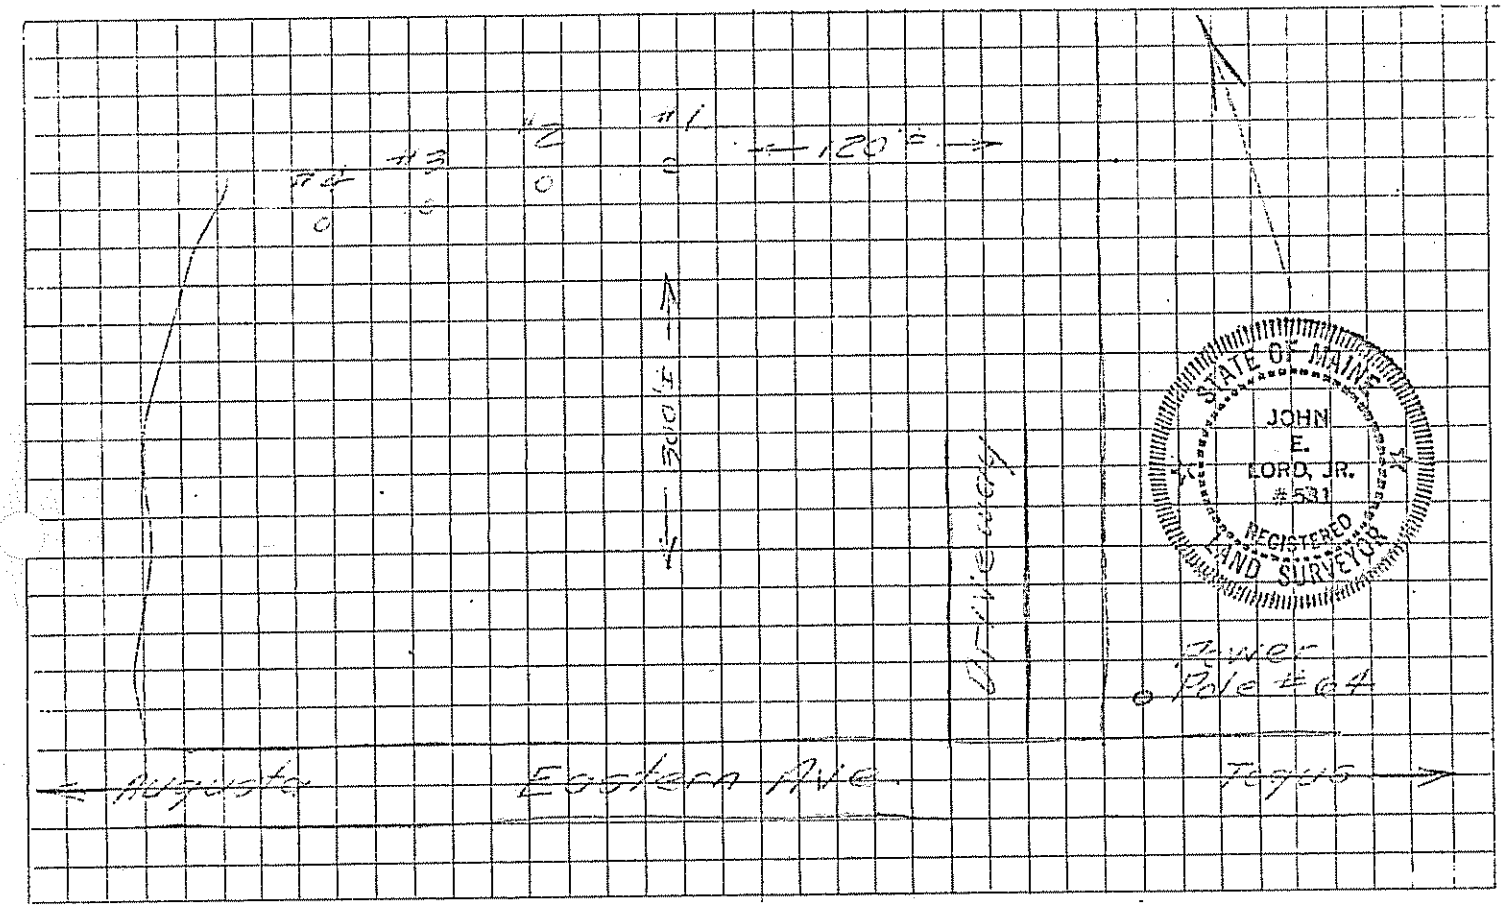

_____ Depth to Water Table
_____ Depth to Bedrock
_____ Depth to Clay or other impervious strata

REMARKS

HOLE	HOLE DEPTH	TIME START	TIME FINISH	DEPTH OF WATER SURFACE START	DEPTH OF WATER SURFACE FINISH	ELAPSED TIME	TOTAL DROP OF WATER	PERCOL. RATE MINUTES/INCH
#1	35 in.	12:03	12:15	26 in.	30 in.	12 min.	4 in.	3 min/in
#2	36 in.	12:05	12:17	25 in.	29 in.	12 min.	4 in.	3 min/in
#3	34 in.	12:07	12:23	24 in.	28 in.	16 min.	4 in.	4 min/in
#4	30 in.	12:08	12:32	21 in.	25 in.	24 min.	4 in.	6 min/in
						AVERAGE RATE		5 min/in

125 Lin. ft. of Trench

SUBMIT THE FOLLOWING COMPLETED FORM TO YOUR LOCAL PLUMBING INSPECTOR

BROCHU, RAYMOND

DATE August 30 1972	OWNER Raymond Brochu
NUMBER OF BEDROOMS 3	STREET EASTERN AVE.
SIZE OF SEPTIC TANK 1000	CITY Augusta MAINE
TYPE OF SOIL Gravel	TEL. NUMBER 622-3016
Test Performed by John E. Lord Jr.	LOCATION OF PROPOSED INSTALLATION
Local Plumbing Inspector's Signature NO-TEST NOT WITH STATE CODE	STREET Eastern Ave.
	CITY Augusta MAINE
	TEL. NUMBER

SKETCH: STATE VISITED LOCATION LOCATION OF BUILDING DISPOSAL SYSTEM, TERRAIN FEATURES, PERCOLATION HOLES, WATER SUPPLIES, ETC.

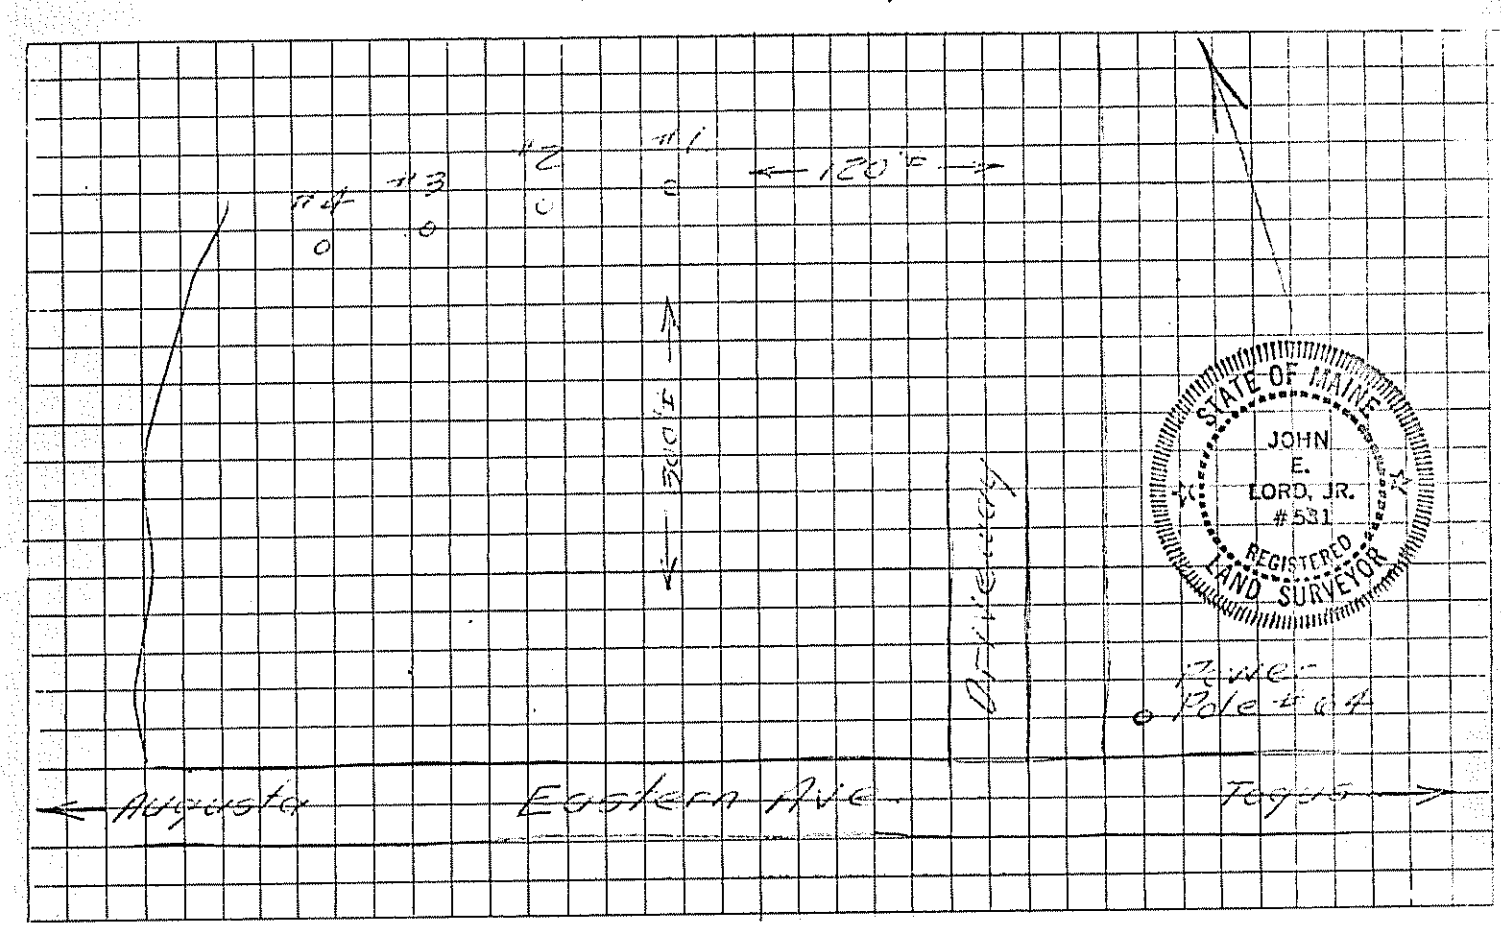

_____ Depth to Water Table
_____ Depth to Bedrock
_____ Depth to Clay or other impervious strata

REMARKS

HOLE	HOLE DEPTH	TIME START	TIME FINISH	DEPTH OF WATER SURFACE START	DEPTH OF WATER SURFACE FINISH	ELAPSED TIME	TOTAL DROP OF WATER	PERCOL. RATE MINUTES/INCH
#1	35 in.	12:03	12:15	26 in.	30 in.	12 min.	4 in.	3 min/in
#2	36 in.	12:05	12:17	25 in.	29 in.	12 min.	4 in.	3 min/in
#3	34 in.	12:07	12:23	24 in.	28 in.	16 min.	4 in.	4 min/in
#4	30 in.	12:08	12:32	21 in.	25 in.	24 min.	4 in.	6 min/in
						AVERAGE RATE		5 min/in

125 Lin. ft. of Trench